


VH-BLKBR COPYRIGHT (C) 2021




ELEVATION

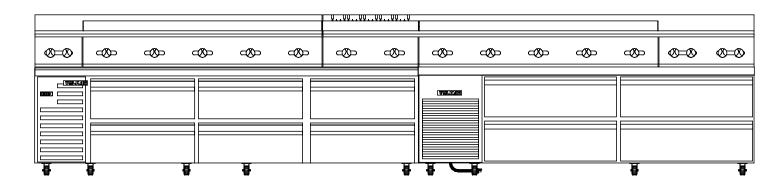


VH-BLKBR COPYRIGHT (C) 2021



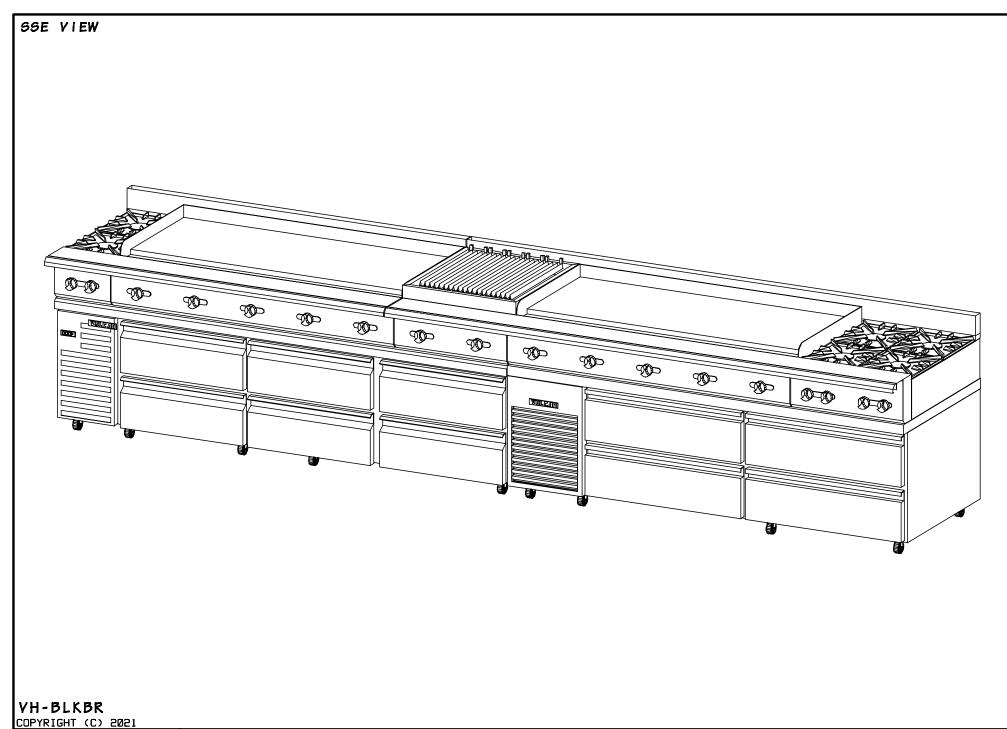



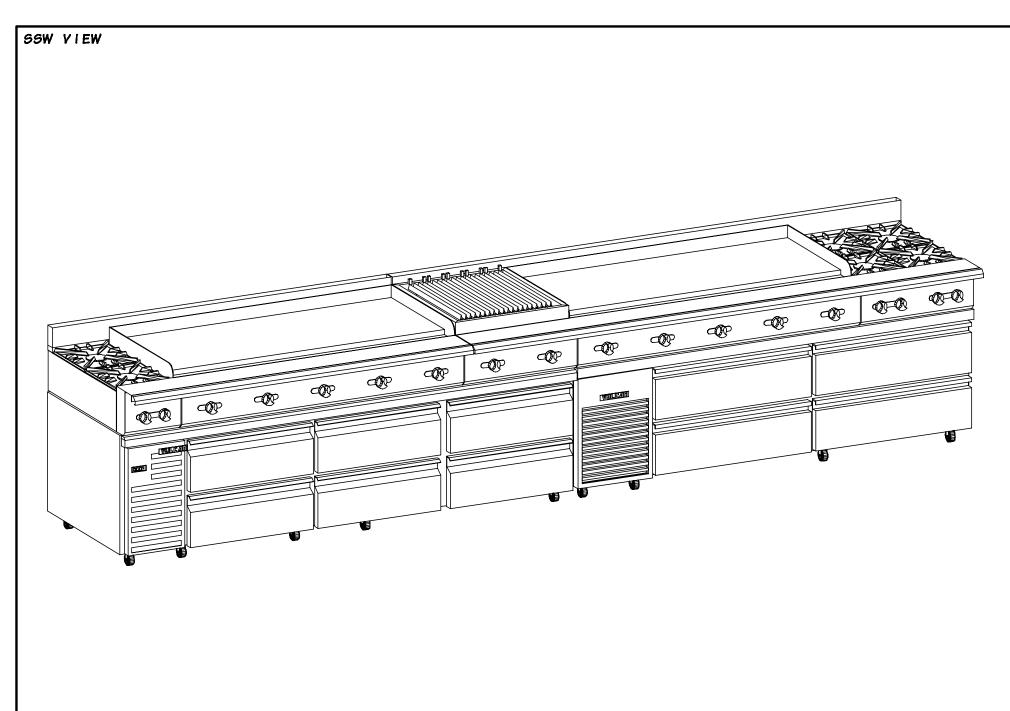

VH-BLKBR COPYRIGHT (C) 2021



GENERAL NOTES - PLEASE READ

VENTILATION:

ALL COOKING EQUIPMENT MUST BE VENTILATED BY AN APPROVED APPLIANCE IN ACCORDANCE WITH ALL APPLICABLE CODES.

FIRE SUPPRIESSION:

ALL COOKING EQUIPMENT MUST BE PROTECTED BY AN APPROVED FIRE SUPPRESSION SYSTEM IN ACCORDANCE WITH ALL APPLICABLE CODES.

CONNECTIONS:

ALL PIPING, FITTINGS, AND INTERCONNECTION SERVICES SHOWN ARE TO BE SUPPLIED AND INSTALLED BY LICENSED CONTRACTORS IN ACCORDANCE WITH ALL LOCAL CODES.

GAS CONNECTIONS:

EXTERNAL GAS REGULATORS, FLEXIBLE GAS LINES AND RESTRAINING CABLES PROVIDED WITH THE EQUIPMENT MUST BE INSTALLED BY LICENSED CONTRACTORS IN ACCORDANCE WITH ALL LOCAL CODES. INCOMING GAS MANIFOLD SUPPLY PRESSURE MUST NOT EXCEED 0.5 PSI (14" W.C.)

BY OTHERS:

VERIFY ALL EQUIPMENT LISTED AS BY OTHERS FOR SIZE AND MECHANICAL SERVICE REQUIREMENTS.

NOTE:

IN LINE WITH THE POLICY TO CONTINUALLY IMPROVE ITS PRODUCTS, THE MANUFACTURES RESERVE THE RIGHT TO CHANGE MATERIALS AND SPECIFICATIONS WITHOUT NOTICE.

GAS

(SS) STEAM SUPPLY

CONNECTION POINT

(C) COLD WATER

(H) HOT WATER

WATER

(D) DRAIN

(f) POWER

<\$> SWITCH

d CORD SET

(C≠ CONV OUTLET RECP

DUPLEX RECPTACLE

SINGLE RECPTACLE

HOT + COLD

CR STEAM RETURN

ST STEAM TAKE OFF

VE EXHAUST VENT

VS SUPPLY VENT

(RF) REFRIGERATION

04-30-2021 : 09:12:17a

Chris Turley RHI SOLUTIONS

PROJECT CODE

BLKBR

v. 425-251*-0*531

Email:chris@rhi-solutions.com

VH-BLKBR

COPYRIGHT (C) 2021



CHRIS TURLEY

BLACK BEAR DINNER MEDFORD

04-30-21