

GAS CONNECTION #1
LOCATED IN ITEM: 952
PIPE SIZE: 0.75 NPT
CP HEIGHT: 32" AFF
TOTAL GAS LOAD: 108 MBTU
INCLUDES ITEMS: 952
NOTE:

GAS CONNECTION #2
LOCATED IN ITEM: 1022
PIPE SIZE: 1.25 NPT
CP HEIGHT: 32" AFF
TOTAL GAS LOAD: 382 MBTU
INCLUDES ITEMS: 1022 1021
NOTE:

GAS CONNECTION #3
LOCATED IN ITEM: 1027
PIPE SIZE: 0.75 NPT
CP HEIGHT: 32" AFF
TOTAL GAS LOAD: 99 MBTU
INCLUDES ITEMS: 1027 1026
NOTE:

GAS CONNECTION #4
LOCATED IN ITEM: 1071
PIPE SIZE: 0.75 NPT
CP HEIGHT: 32" AFF
TOTAL GAS LOAD: 190 MBTU
INCLUDES ITEMS: 1171
NOTE:

GAS CONNECTION #5
LOCATED IN ITEM: 1176
PIPE SIZE: 1.25 NPT
CP HEIGHT: 32" AFF
TOTAL GAS LOAD: 371 MBTU
INCLUDES ITEMS: 1182 1179 1176
NOTE:

1176	1 EA	V2FT36S	RANGE
①	75 MBTU	1.25	32 AFF
1021	1 EA	VGMT36S	RANGE
①	140 MBTU	1.25	MANIFOLD
1022	1 EA	V6B36C	RANGE
①	242 MBTU	1.25	32 AFF
②	120 (1)	4.0A	5-15
1179	1 EA	VGMT36S	RANGE
①	140 MBTU	1.25	MANIFOLD
1182	1 EA	VCB36C	CHAR BROILER
①	131 MBTU	1.25	MANIFOLD
952	1 EA	948RX	GRIDDLE
①	120 MBTU	0.75	32 AFF
②	120 (1)	2.0A	5-15
955	1 EA	ARS48	REFRIGERATED BASE
②	120 (1)	6.7A	5-15
953	1 EA	36IRB	CHEESE MELTER
①	30 MBTU	0.75	78 AFF INTERPLUMB

GENERAL NOTES - PLEASE READ

VENTILATION:
ALL COOKING EQUIPMENT MUST BE VENTILATED BY AN APPROVED APPLIANCE IN ACCORDANCE WITH ALL APPLICABLE CODES.

FIRE SUPPRESSION:
ALL COOKING EQUIPMENT MUST BE PROTECTED BY AN APPROVED FIRE SUPPRESSION SYSTEM IN ACCORDANCE WITH ALL APPLICABLE CODES.

CONNECTIONS:
ALL PIPING, FITTINGS, AND INTERCONNECTION SERVICES SHOWN ARE TO BE SUPPLIED AND INSTALLED BY LICENSED CONTRACTORS IN ACCORDANCE WITH ALL LOCAL CODES.

GAS CONNECTIONS:
EXTERNAL GAS REGULATORS, FLEXIBLE GAS LINES AND RESTRAINING CABLES PROVIDED WITH THE EQUIPMENT MUST BE INSTALLED BY LICENSED CONTRACTORS IN ACCORDANCE WITH ALL LOCAL CODES. INCOMING GAS MANIFOLD SUPPLY PRESSURE MUST NOT EXCEED 0.5 PSI (4" W.C.)



BY OTHERS:
VERIFY ALL EQUIPMENT LISTED AS BY OTHERS FOR SIZE AND MECHANICAL SERVICE REQUIREMENTS.

NOTE:
IN LINE WITH THE POLICY TO CONTINUALLY IMPROVE ITS PRODUCTS, THE MANUFACTURERS RESERVE THE RIGHT TO CHANGE MATERIALS AND SPECIFICATIONS WITHOUT NOTICE.

●	CONNECTION POINT
○	COLD WATER
○	HOT WATER
○	HOT + COLD WATER
○	DRAIN
○	POWER
○	SWITCH
○	CORD SET
○	CONV OUTLET RECP
○	DUPLEX RECP/TABLE
○	SINGLE RECP/TABLE
○	GAS
○	STEAM SUPPLY
○	STEAM RETURN
○	STEAM TAKE OFF
○	EXHAUST VENT
○	SUPPLY VENT
○	REFRIGERATION

10-20-2020

PROJECT CODE
BRRC6

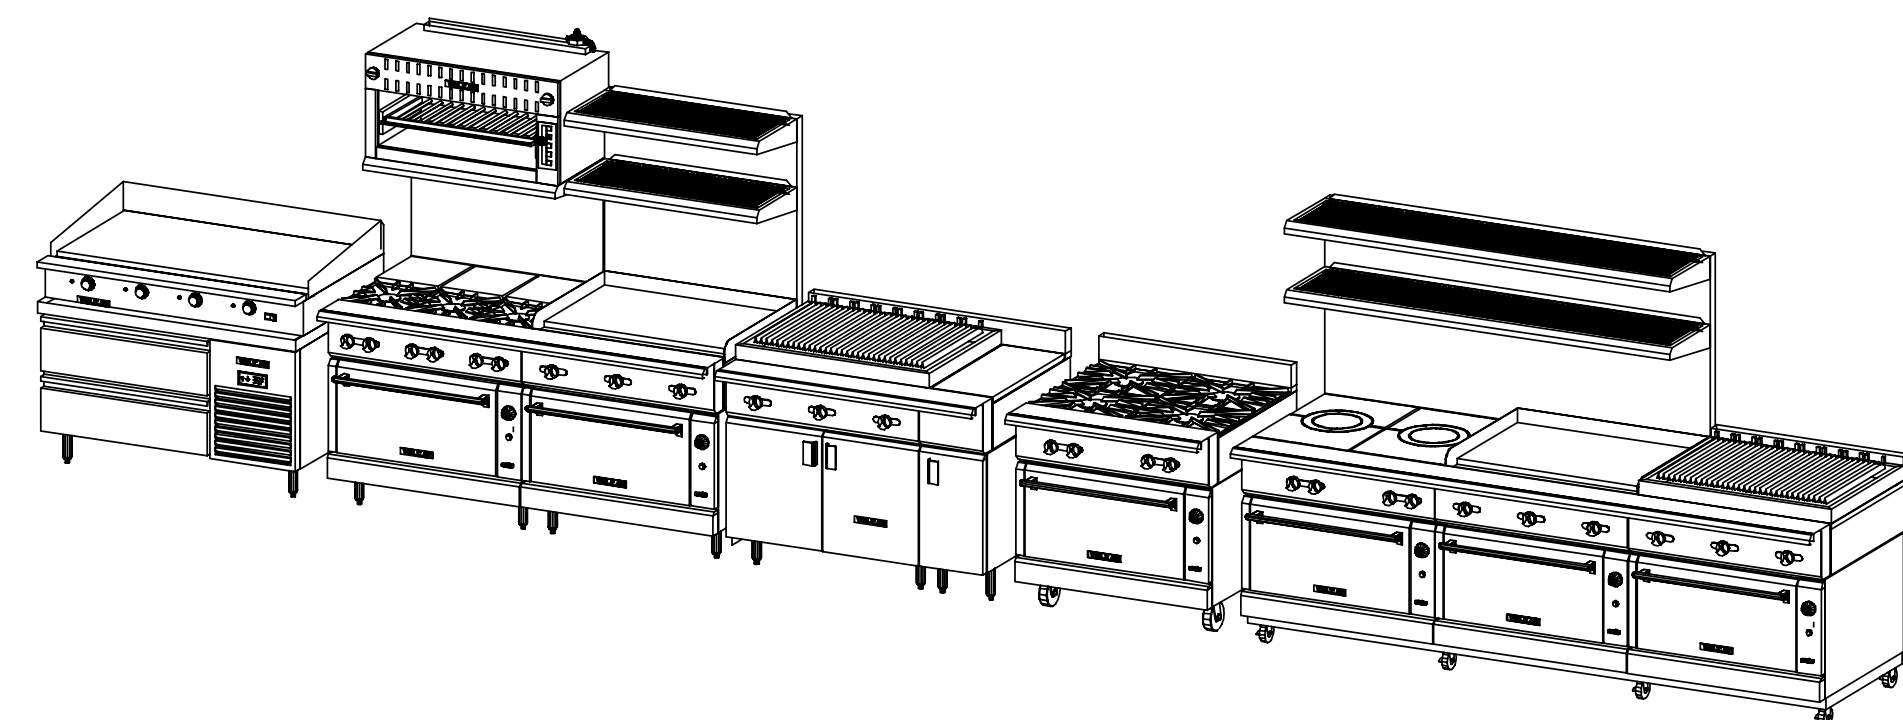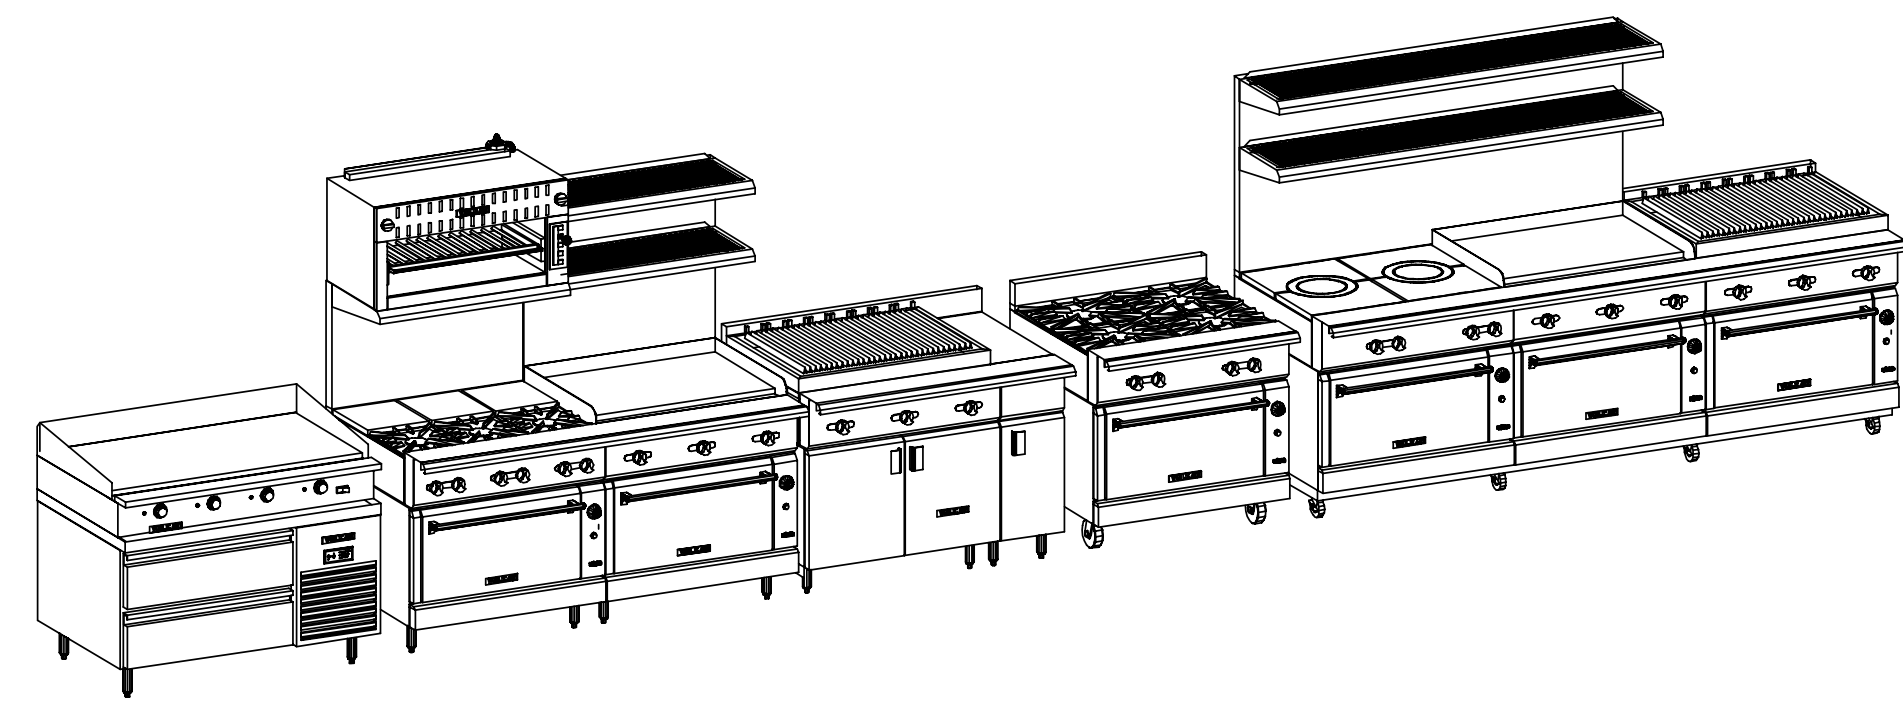

BRRC Boca Raton - 6

REVISIONS		By	Date	Revision
			04	10/20/20
			05	04/15/2021
			06	04/15/2021

NEXT STEP DESIGN
913 WEST ST.
ANNAPOLIS, MD 21401

SCALE:
AS NOTED
DATE: 10-20-2020
DRAWN BY: DDB
VH-BRCC6

VULCAN

THE VULCAN HART COMPANY
BALTIMORE, MARYLAND
410-284-0660