
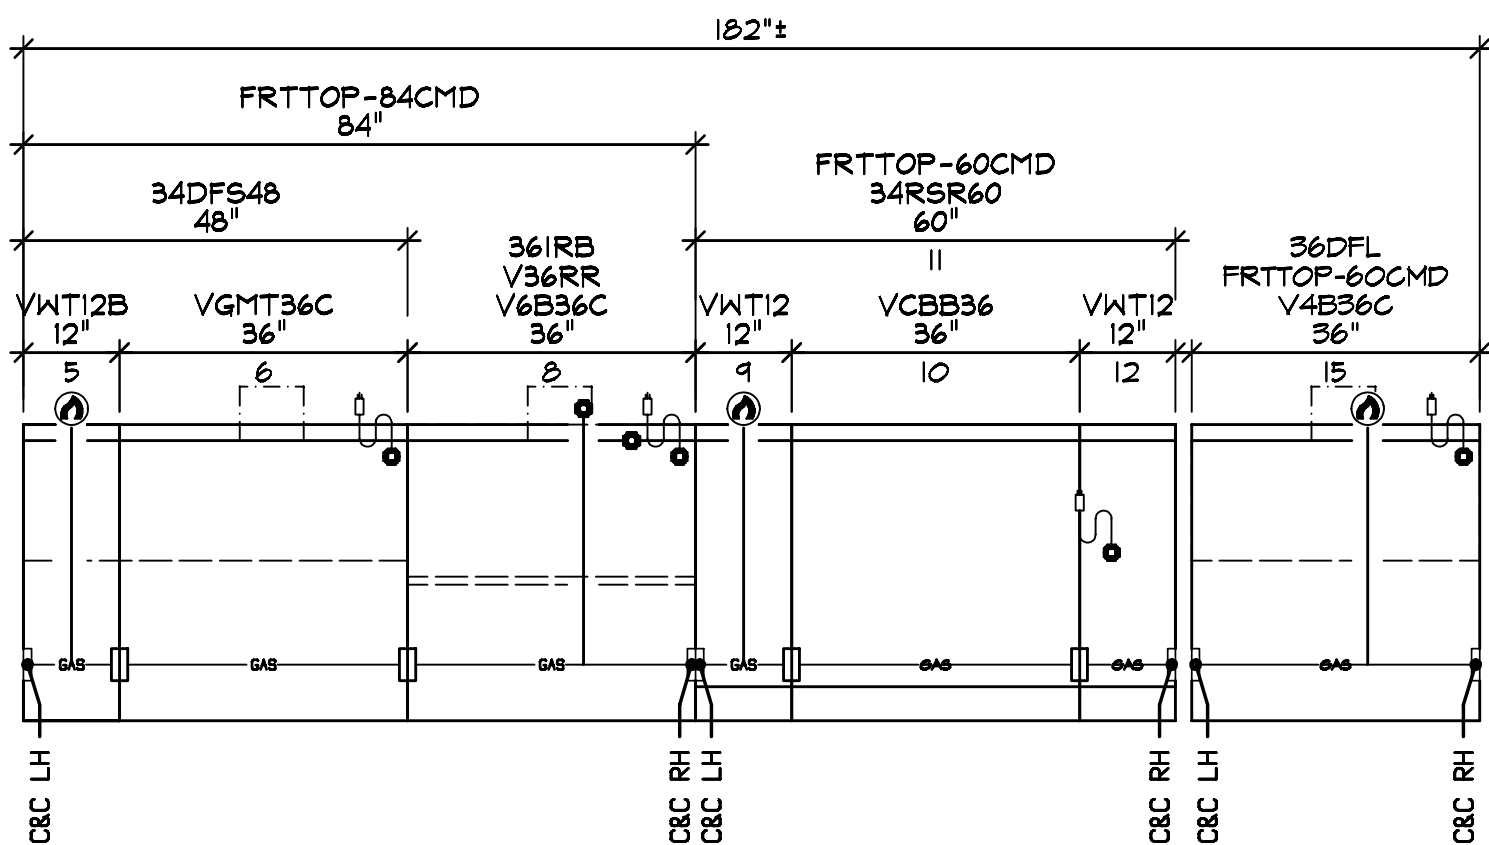
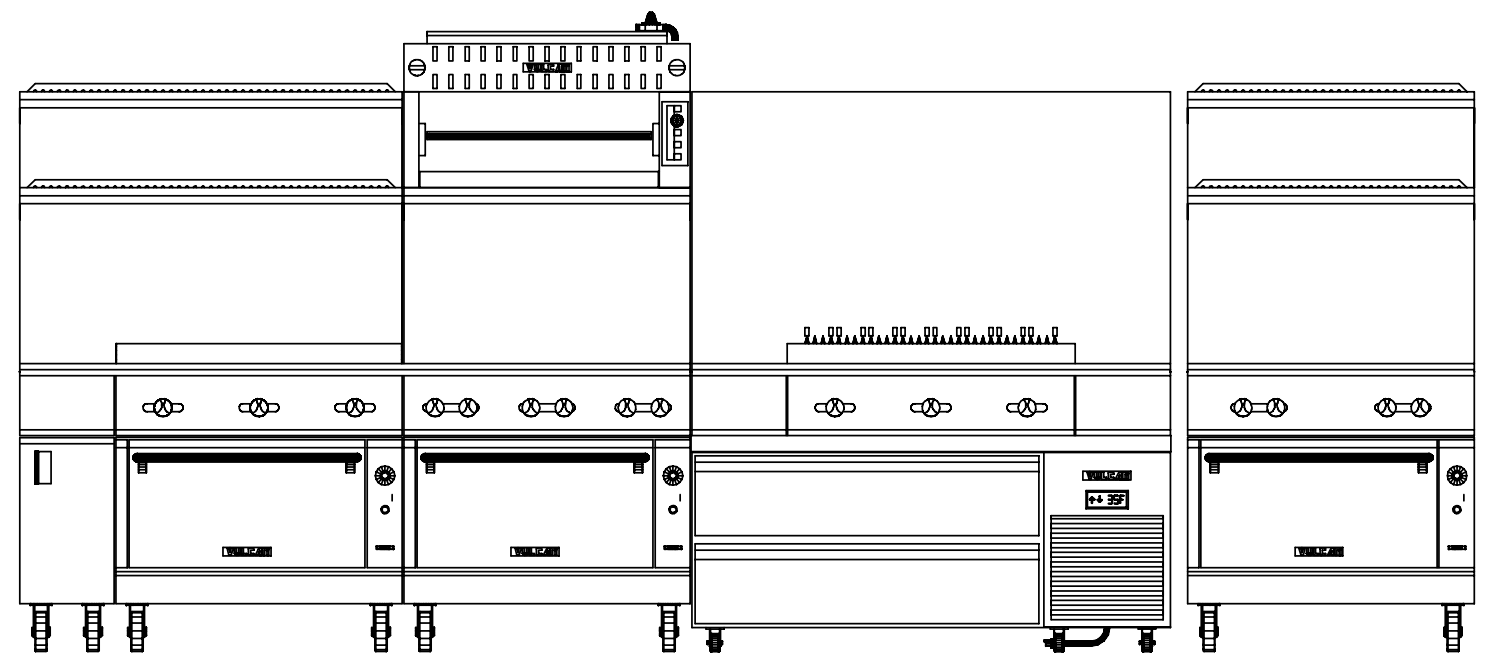


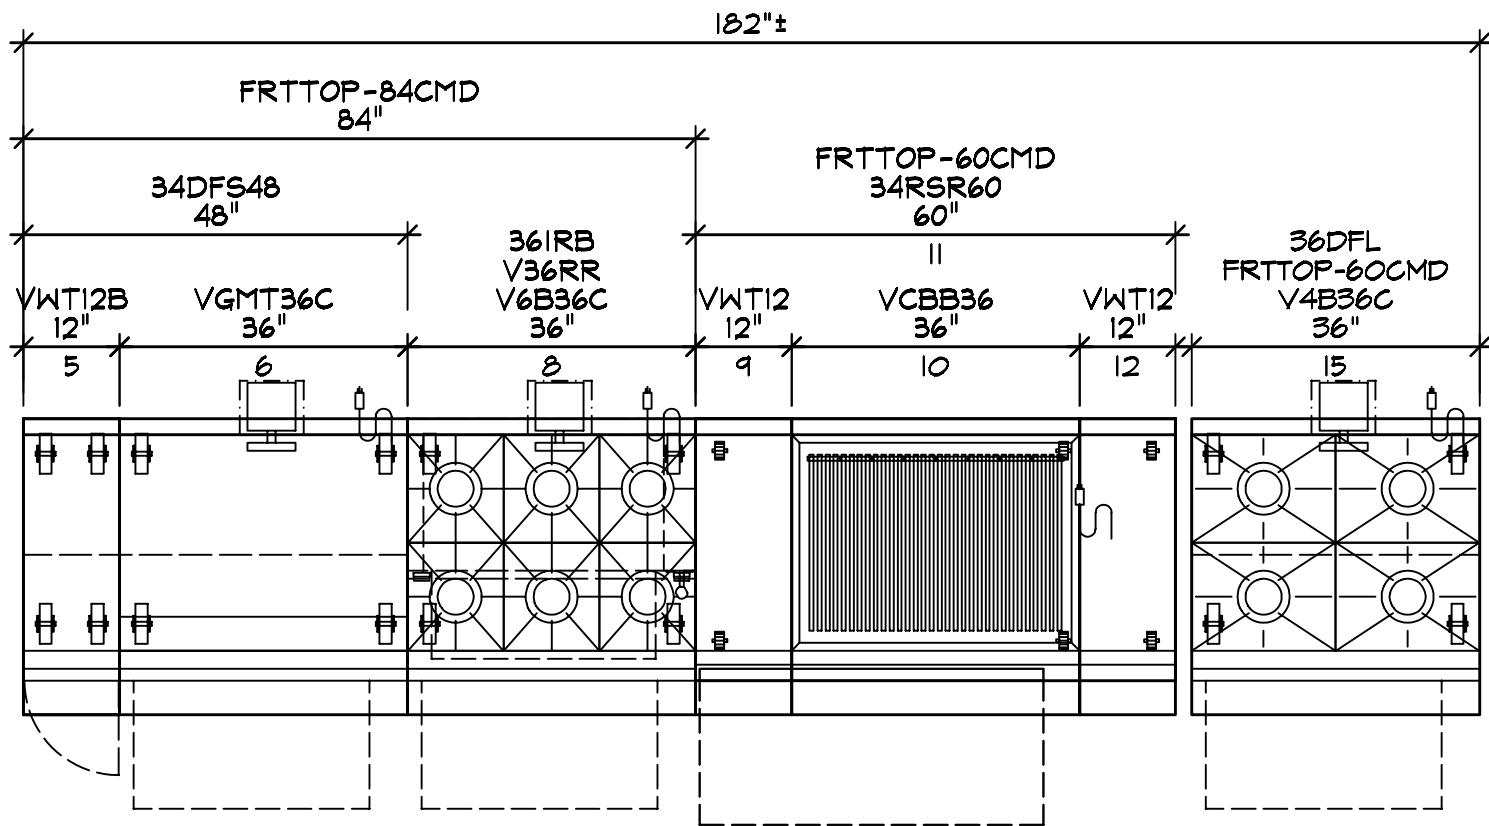

GAS CONNECTION #1
LOCATED IN ITEM: 5
PIPE SIZE: 1.25 NPT
CP HEIGHT: 32" AFF
TOTAL GAS LOAD: 412 MBTU
INCLUDES ITEMS: 8, 1, 8, 8, 6
NOTE:

GAS CONNECTION #2
LOCATED IN ITEM: 9
PIPE SIZE: 1.25 NPT
CP HEIGHT: 32" AFF
TOTAL GAS LOAD: 99 MBTU
INCLUDES ITEMS: 10
NOTE:

5	1 EA	VWT12B	SPREADER		
①	0 MBTU	1.25	32 AFF	G1	
6	1 EA	VGMT36C	RANGE		
①	140 MBTU	1.25	MANIFOLD		
②	120 (1)	4.9A	5-15		
8	1 EA	V6B36C	RANGE		
①	242 MBTU	1.25	MANIFOLD		
②	120 (1)	4.0A	5-15		
8.1	1 EA	361RB	SALAMANDER		
①	30 MBTU	0.75	INTERPLUMB		
9	1 EA	VWT12	SPREADER		
①	0 MBTU	1.25	32 AFF	G2	
10	1 EA	VCBB36	CHRAIROILER		
①	99 MBTU	1.25	MANIFOLD		
11	1 EA	VSC60	REFRIGERATED BASE		
②	120 (1)	7.8A	5-15		
11	1 EA	VWT12	SPREADER		
①	0 MBTU	1.25	End Cap		
15	1 EA	V4B36C	RANGE		
①	172 MBTU	1.25	32 AFF		
②	120 (1)	4.0A	5-15		

GENERAL NOTES - PLEASE READ

VENTILATION:
ALL COOKING EQUIPMENT MUST BE VENTILATED BY AN APPROVED APPLIANCE IN ACCORDANCE WITH ALL APPLICABLE CODES.

FIRE SUPPRESSION:
ALL COOKING EQUIPMENT MUST BE PROTECTED BY AN APPROVED FIRE SUPPRESSION SYSTEM IN ACCORDANCE WITH ALL APPLICABLE CODES.

CONNECTIONS:
ALL PIPING, FITTINGS, AND INTERCONNECTION SERVICES SHOWN ARE TO BE SUPPLIED AND INSTALLED BY LICENSED CONTRACTORS IN ACCORDANCE WITH ALL LOCAL CODES.

GAS CONNECTIONS:
EXTERNAL GAS REGULATORS, FLEXIBLE GAS LINES AND RESTRAINING CABLES PROVIDED WITH THE EQUIPMENT MUST BE INSTALLED BY LICENSED CONTRACTORS IN ACCORDANCE WITH ALL LOCAL CODES. INCOMING GAS MANIFOLD SUPPLY PRESSURE MUST NOT EXCEED 0.5 PSI (4" W.C.)

BY OTHERS:
VERIFY ALL EQUIPMENT LISTED AS BY OTHERS FOR SIZE AND MECHANICAL SERVICE REQUIREMENTS.

NOTE:
IN LINE WITH THE POLICY TO CONTINUALLY IMPROVE ITS PRODUCTS, THE MANUFACTURERS RESERVE THE RIGHT TO CHANGE MATERIALS AND SPECIFICATIONS WITHOUT NOTICE.

●	CONNECTION POINT
⬇	COLD WATER
⬆	HOT WATER
⬇	HOT + COLD WATER
⬇	DRAIN
⬆	POWER
⬆	SWITCH
⬆	CORD SET
⬆	CONV OUTLET RECP
⬆	DUPLEX RECP
⬆	SINGLE RECP
⬆	GAS
⬆	STEAM SUPPLY
⬆	STEAM RETURN
⬆	STEAM TAKE OFF
⬆	EXHAUST VENT
⬆	SUPPLY VENT
⬆	REFRIGERATION

01-19-2021
01-19-2021 : 12:25:34p
01-19-2021 : 12:29:34p
01-19-2021 : 12:45:23p
01-19-2021 : 12:47:53p

PROJECT CODE
HILME

VULCAN
THE VULCAN HART COMPANY
BALTIMORE, MARYLAND
410-284-0660

Hilton Marina Events
For Lauderdale FL

REVISIONS	By	Date	Revision
	ddb	1/20/21	Large Format

NEXT STEP DESIGN
913 WEST ST.
ANNAPOLIS, MD 21401

SCALE:
AS NOTED
DATE: 01-20-2021
DRAWN BY: DDB
VH-HILME