
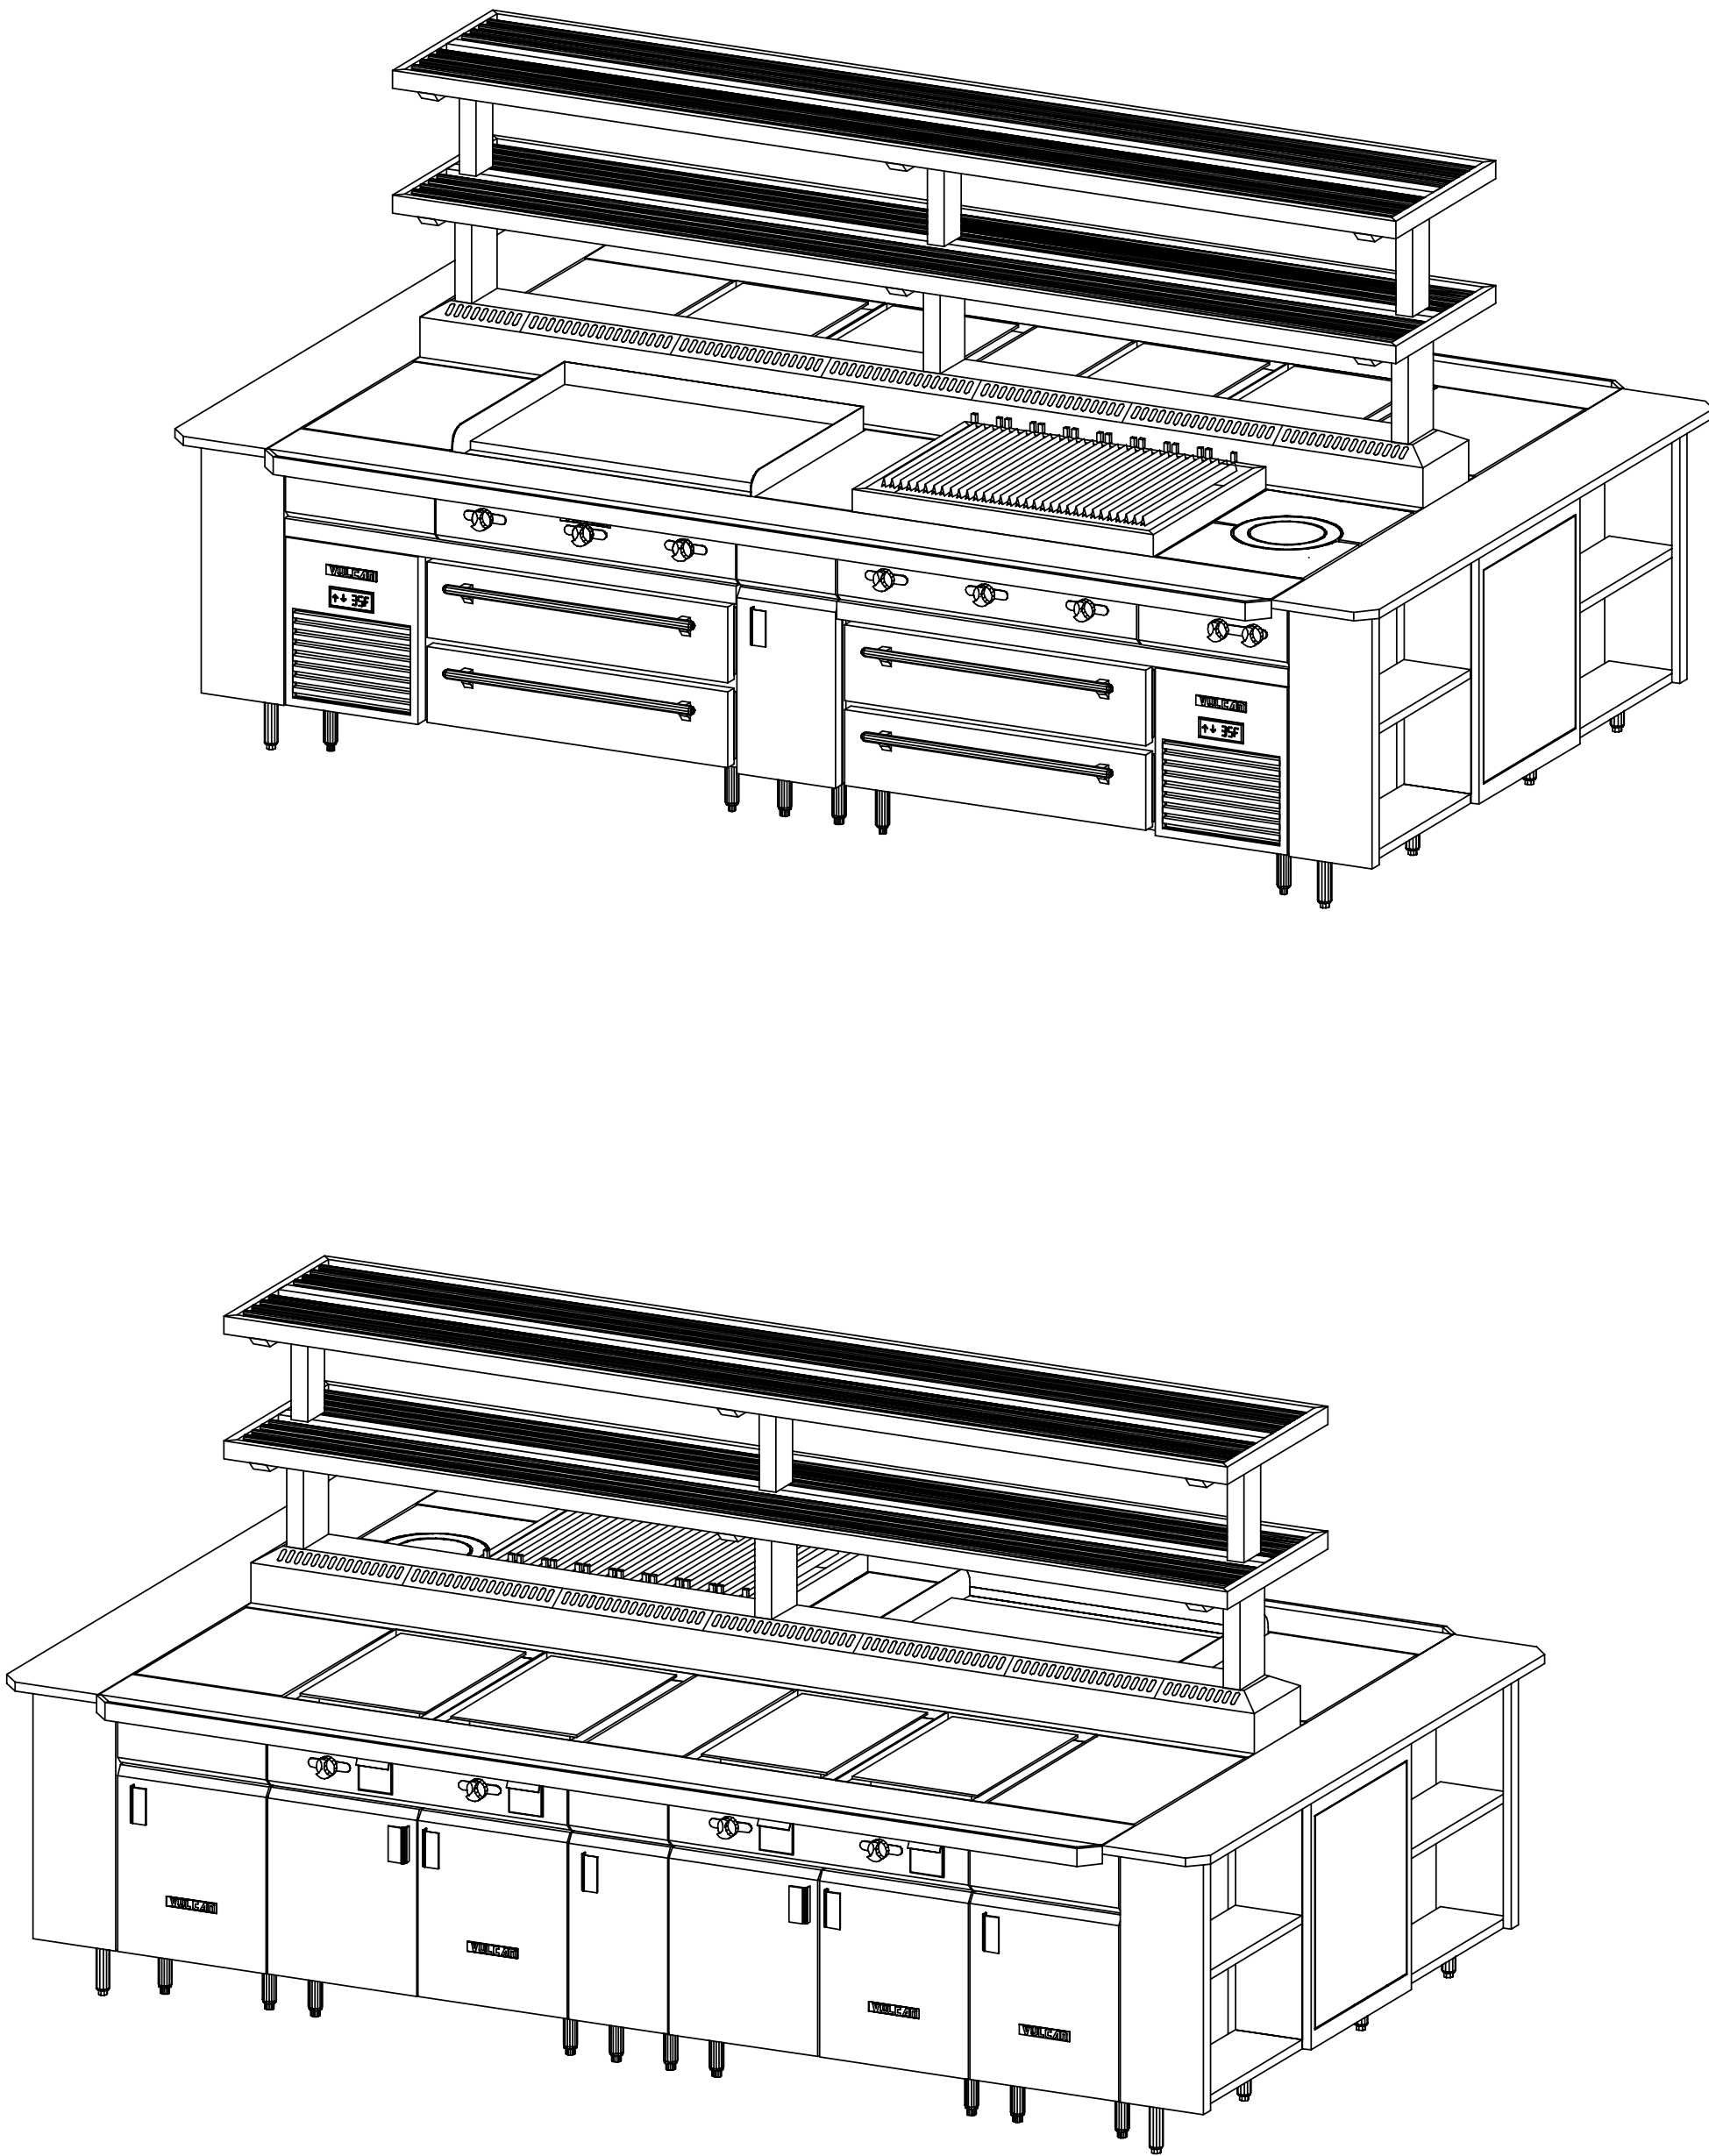


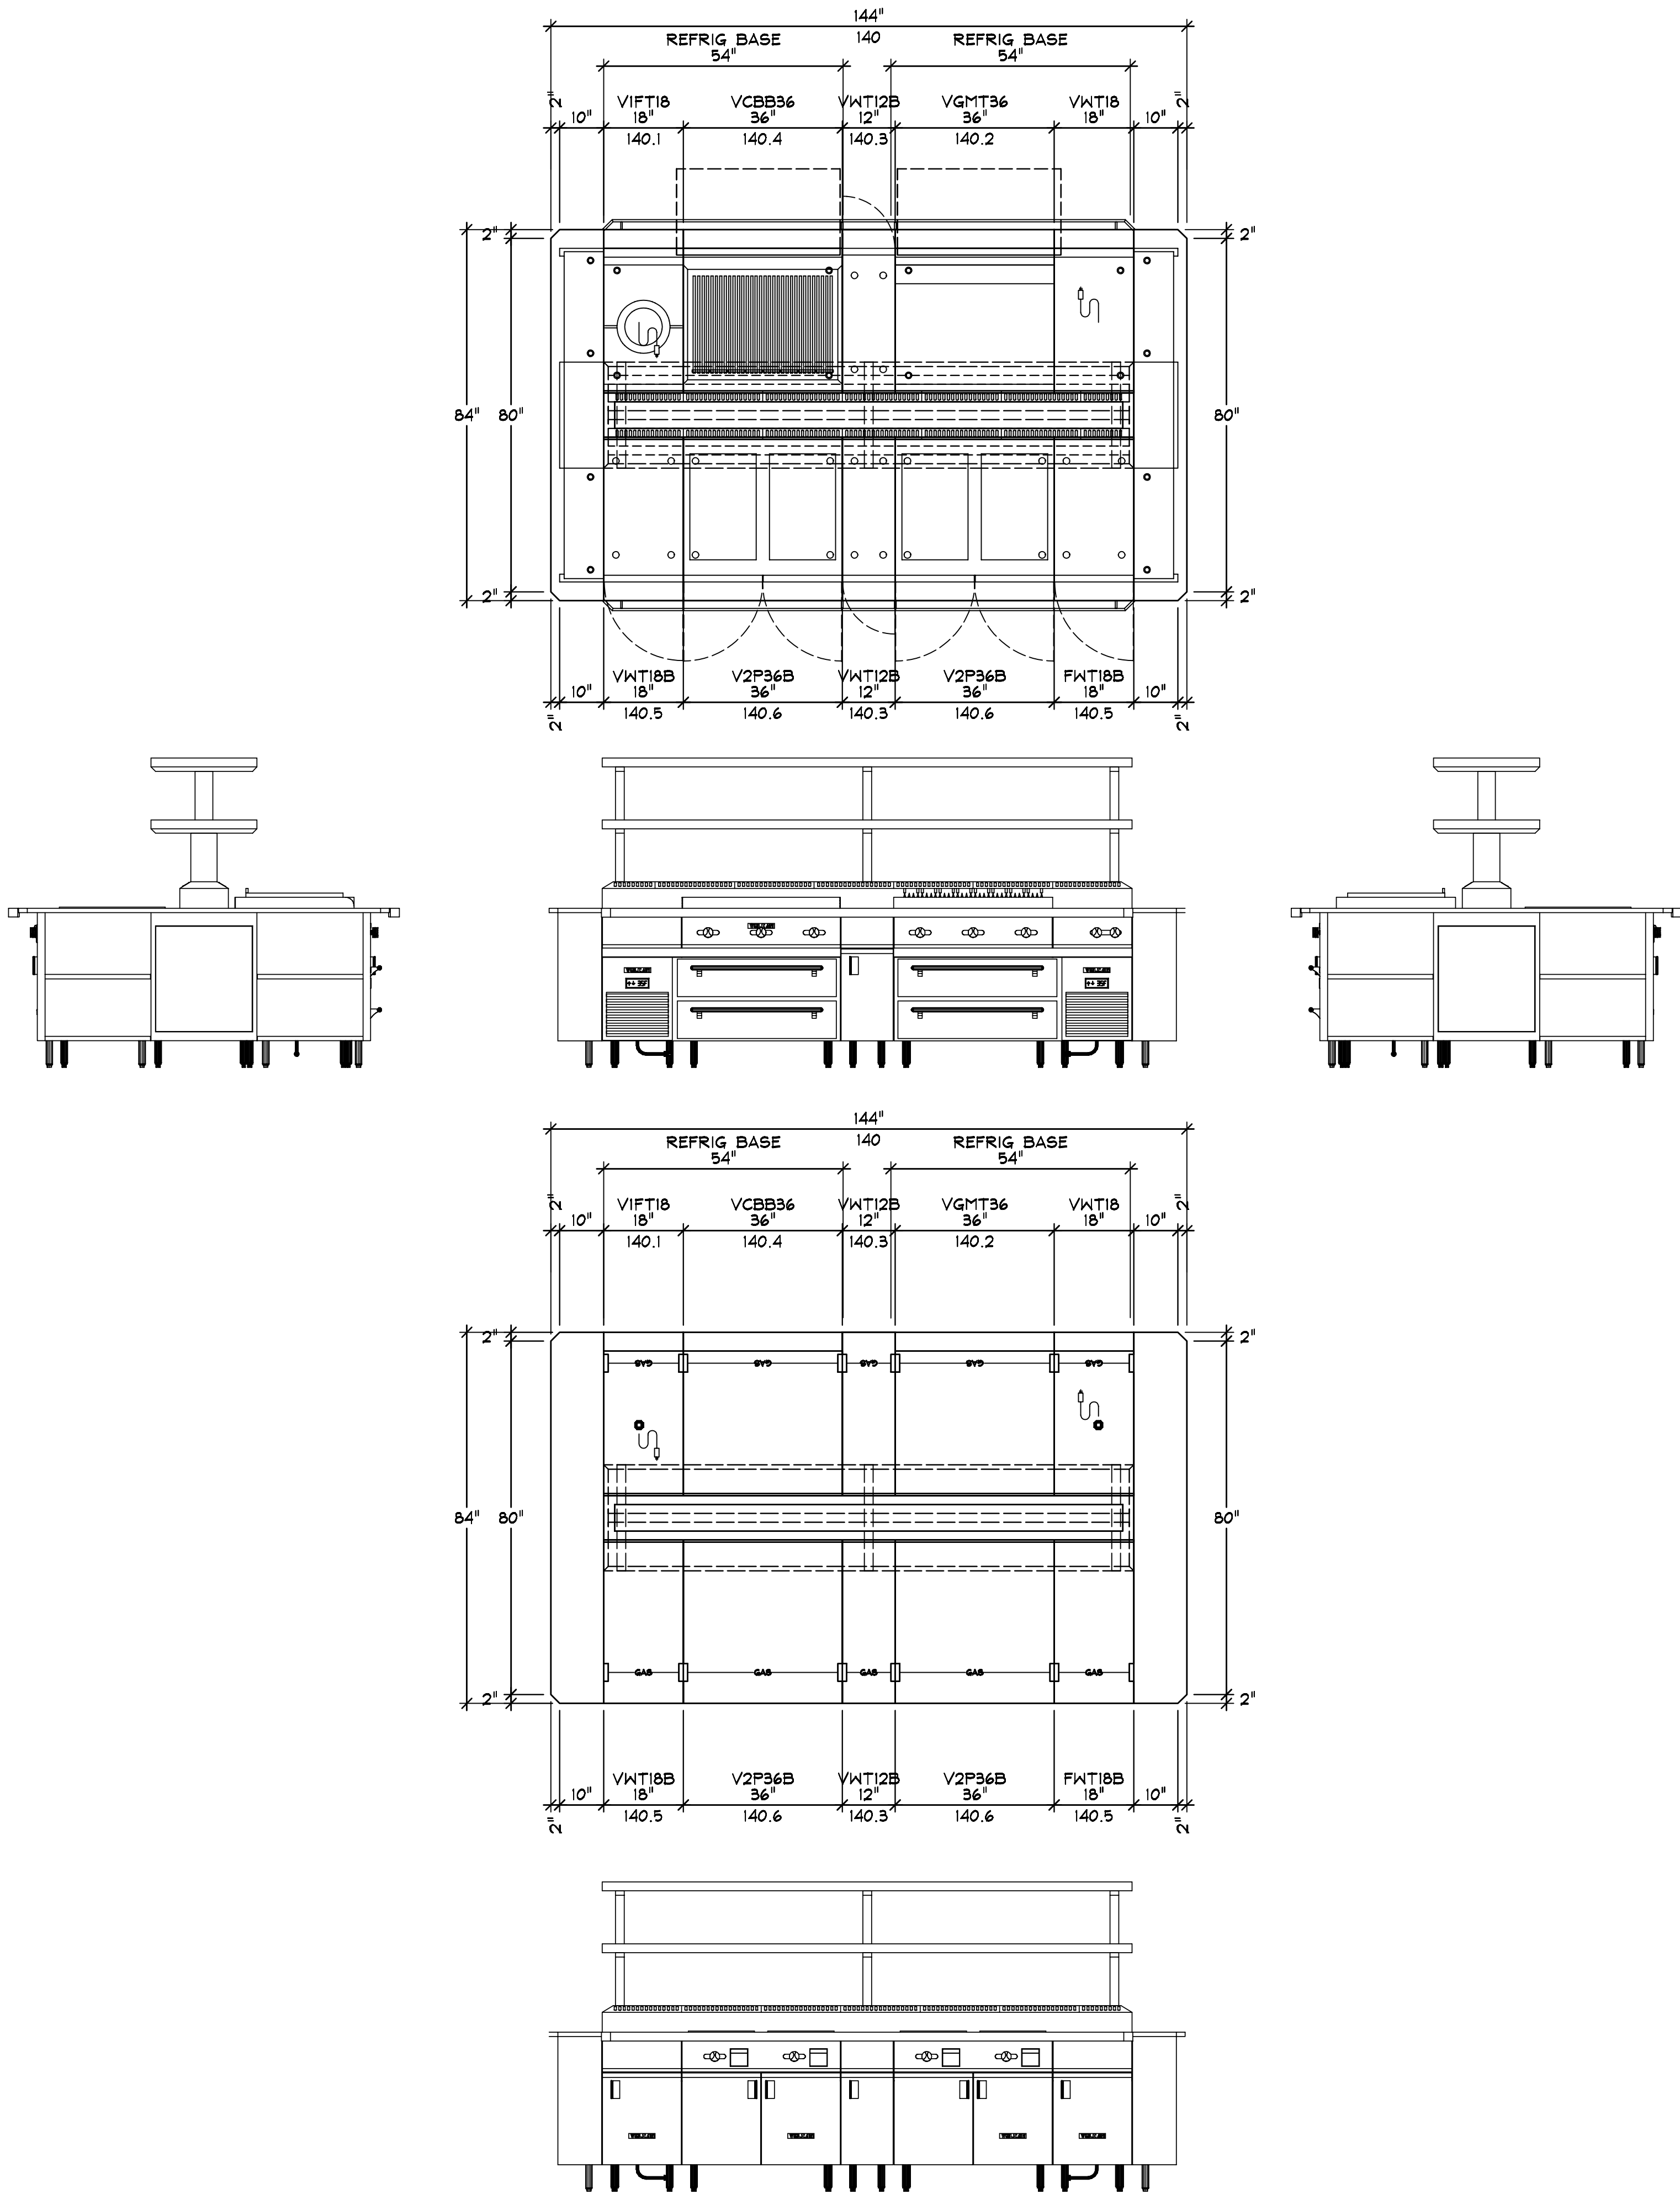

GENERAL NOTES - PLEASE READ

- VENTILATION:
ALL COOKING EQUIPMENT MUST BE VENTILATED BY AN APPROVED APPLIANCE IN ACCORDANCE WITH ALL APPLICABLE CODES.
- FIRE SUPPRESSION:
ALL COOKING EQUIPMENT MUST BE PROTECTED BY AN APPROVED FIRE SUPPRESSION SYSTEM IN ACCORDANCE WITH ALL APPLICABLE CODES.
- CONNECTIONS:
ALL PIPING, FITTINGS, AND INTERCONNECTION SERVICES SHOWN ARE TO BE SUPPLIED AND INSTALLED BY LICENSED CONTRACTORS IN ACCORDANCE WITH ALL LOCAL CODES.
- GAS CONNECTIONS:
EXTERNAL GAS REGULATORS, FLEXIBLE GAS LINES AND RESTRAINING CABLES PROVIDED WITH THE EQUIPMENT MUST BE INSTALLED BY LICENSED CONTRACTORS IN ACCORDANCE WITH ALL LOCAL CODES. INCOMING GAS MANIFOLD SUPPLY PRESSURE MUST NOT EXCEED 0.5 PSI (4" W.C.)
- BY OTHERS:
VERIFY ALL EQUIPMENT LISTED AS BY OTHERS FOR SIZE AND MECHANICAL SERVICE REQUIREMENTS.
- NOTE:
IN LINE WITH THE POLICY TO CONTINUALLY IMPROVE ITS PRODUCTS, THE MANUFACTURERS RESERVE THE RIGHT TO CHANGE MATERIALS AND SPECIFICATIONS WITHOUT NOTICE.
- CONNECTION POINT
 - COLD WATER
 - HOT WATER
 - HOT + COLD WATER
 - DRAIN
 - POWER
 - SWITCH
 - CORD SET
 - CONV. OUTLET RECP
 - DUPLEX RECP/TACTLE
 - SINGLE RECP/TACTLE
 - GAS
 - STEAM SUPPLY
 - STEAM RETURN
 - STEAM TAKE OFF
 - EXHAUST VENT
 - SUPPLY VENT
 - REFRIGERATION

03-28-2020

PROJECT CODE
SUNYB

SCOPOS Hospitality Group
Broadview Senior Living

REVISIONS		Revision
No.	Date	By
03	4/7/20	ddb
Large Format		

4 STAR REPS
4 Neshaminy Interplex Dr
Trevose, PA 19053

SCALE:
AS NOTED
DATE: 3/28/20
DRAWN BY: DDB
VH-SUNYB