

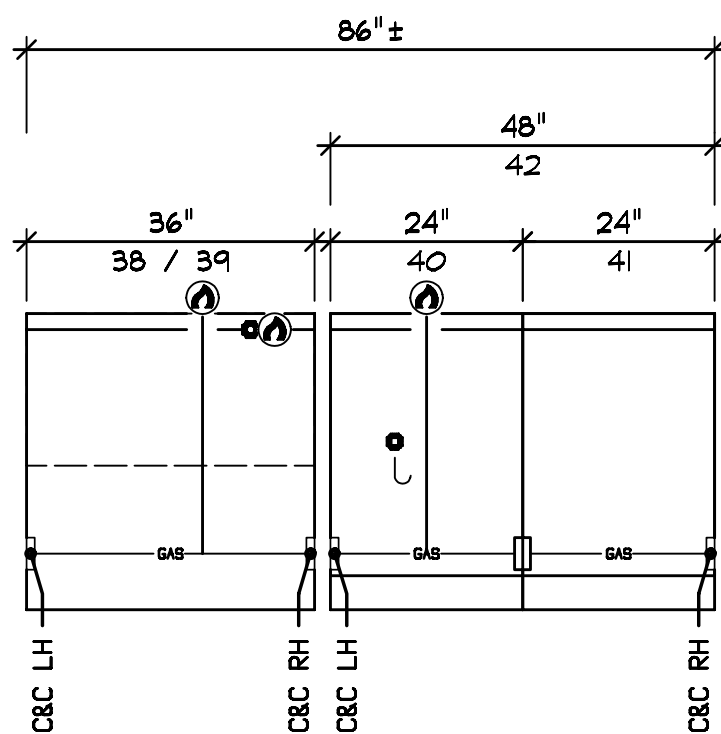
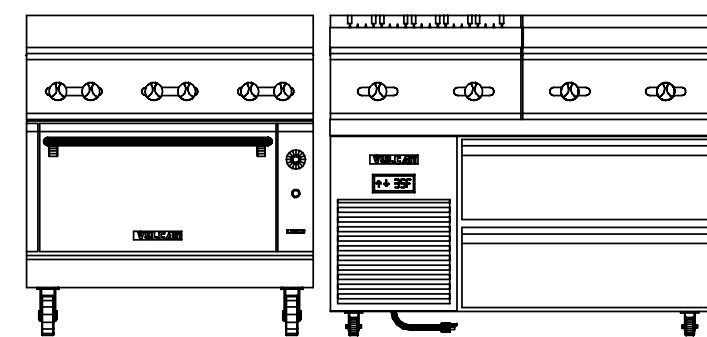
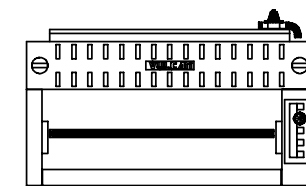
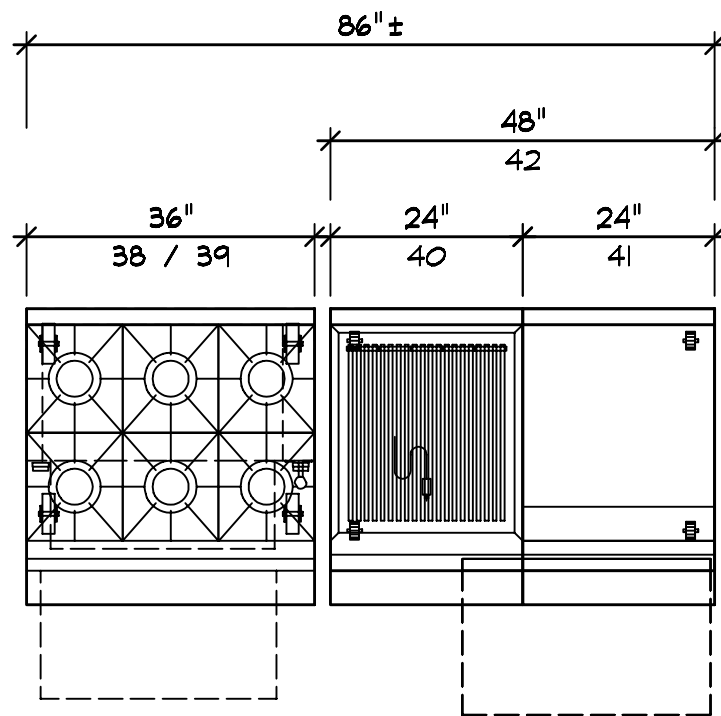
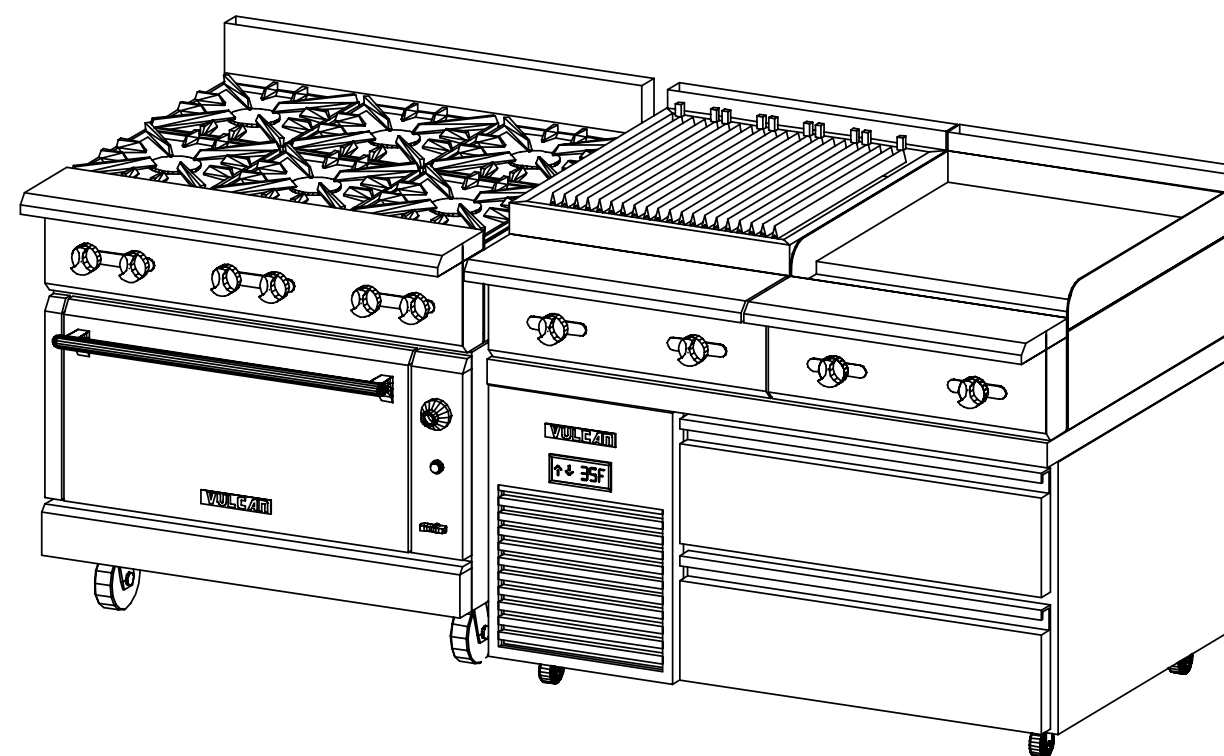
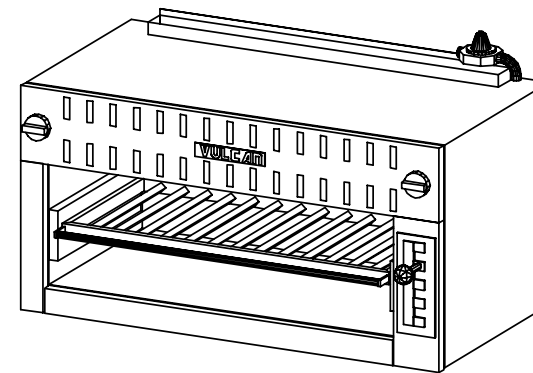


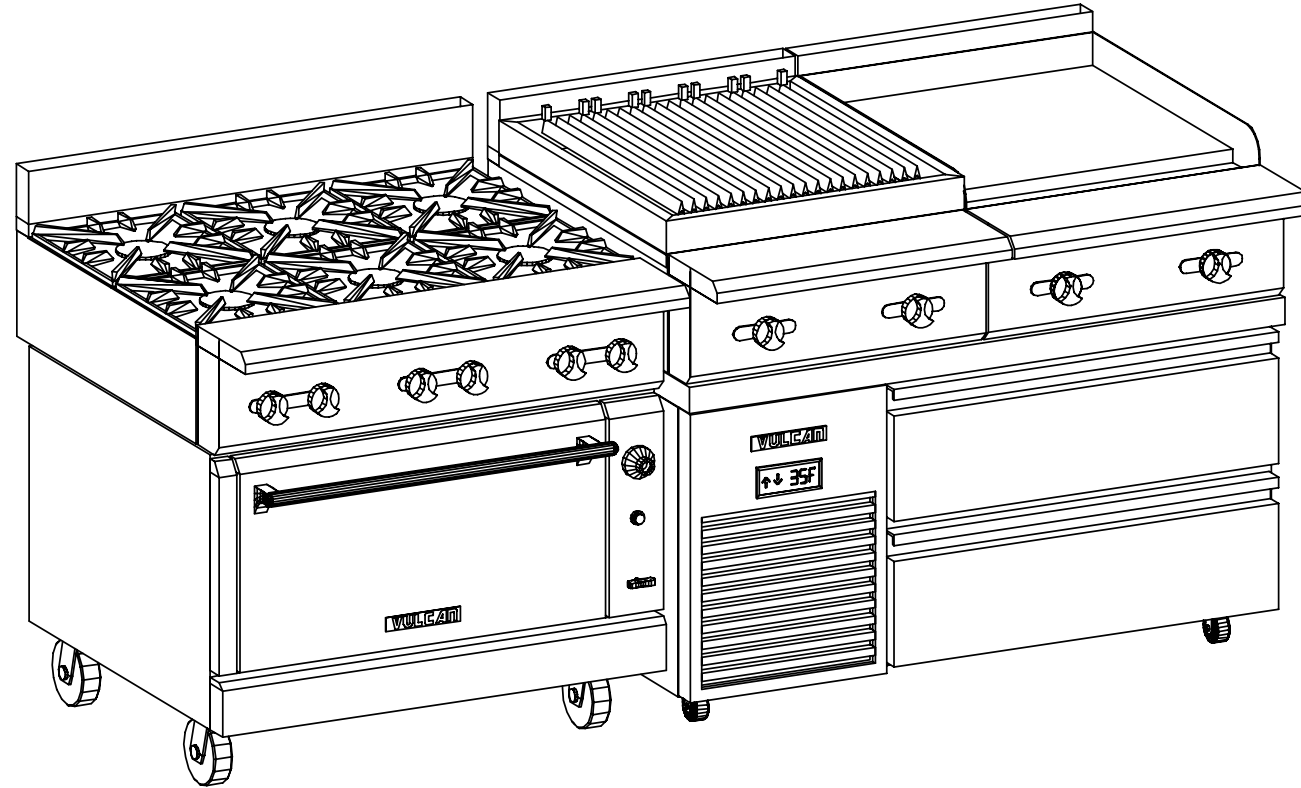

38	1 EA	36IRB	SALAMANDER	WALL MOUNT
30 MBTU	0.75			
39	1 EA	V6B36S	RANGE	
260 MBTU	1.25	32 AFF		
40	1 EA	VCB824	CHARBOILER	
65 MBTU	0.75	32 AFF		
41	1 EA	VG24	RANGE	
30 MBTU	1.25	MANIFOLD		
42	1 EA	VSC48	REFRIGERATED BASE	
120 (1)	6.7A	5-15		

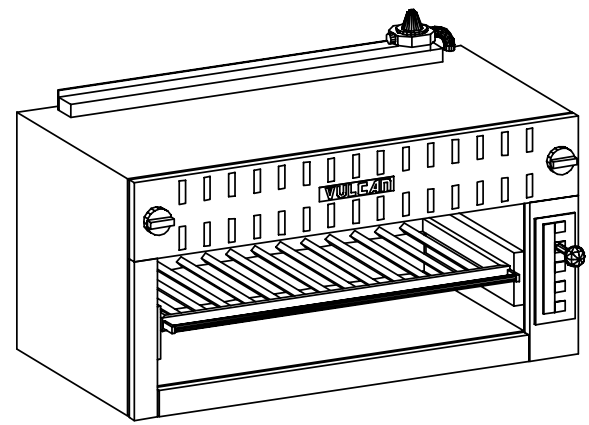

GENERAL NOTES - PLEASE READ

VENTILATION:
ALL COOKING EQUIPMENT MUST BE VENTILATED BY AN APPROVED APPLIANCE IN ACCORDANCE WITH ALL APPLICABLE CODES.

FIRE SUPPRESSION:
ALL COOKING EQUIPMENT MUST BE PROTECTED BY AN APPROVED FIRE SUPPRESSION SYSTEM IN ACCORDANCE WITH ALL APPLICABLE CODES.

CONNECTIONS:
ALL PIPING, FITTINGS, AND INTERCONNECTION SERVICES SHOWN ARE TO BE SUPPLIED AND INSTALLED BY LICENSED CONTRACTORS IN ACCORDANCE WITH ALL LOCAL CODES.

GAS CONNECTIONS:
EXTERNAL GAS REGULATORS, FLEXIBLE GAS LINES AND RESTRAINING CABLES PROVIDED WITH THE EQUIPMENT MUST BE INSTALLED BY LICENSED CONTRACTORS IN ACCORDANCE WITH ALL LOCAL CODES. INCOMING GAS MANIFOLD SUPPLY PRESSURE MUST NOT EXCEED 0.5 PSI (4" W.C.)

BY OTHERS:
VERIFY ALL EQUIPMENT LISTED AS BY OTHERS FOR SIZE AND MECHANICAL SERVICE REQUIREMENTS.

NOTE:
IN LINE WITH THE POLICY TO CONTINUALLY IMPROVE ITS PRODUCTS, THE MANUFACTURERS RESERVE THE RIGHT TO CHANGE MATERIALS AND SPECIFICATIONS WITHOUT NOTICE.

●	CONNECTION POINT
○	COLD WATER
○	FILTERED WATER
○	HOT WATER
○	HOT + COLD WATER
○	DRAIN
○	POWER
○	SWITCH
○	CORV OUTLET RECP
○	DUPLEX RECEPTACLE
○	SINGLE RECEPTACLE
○	GAS
○	STEAM SUPPLY
○	STEAM RETURN
○	EXHAUST VENT
○	SUPPLY VENT
○	REFRIGERATION

01-23-2022

PROJECT CODE
BOCAG

VULCAN
THE VULCAN HART COMPANY
BALTIMORE, MARYLAND
410-284-0660

3RD ST BISTRO
BOCA GRANDE, FL

REVISIONS
By ddb
Date 05/23/2022
Revision
LARGE FORMAT

NEXT STEP DESIGN
913 A West Street
Annapolis, MD 21401
410-263-1200

SCALE:
AS NOTED
DATE: 09/23/2022
DRAWN BY: DDB
VH_BOCAG