

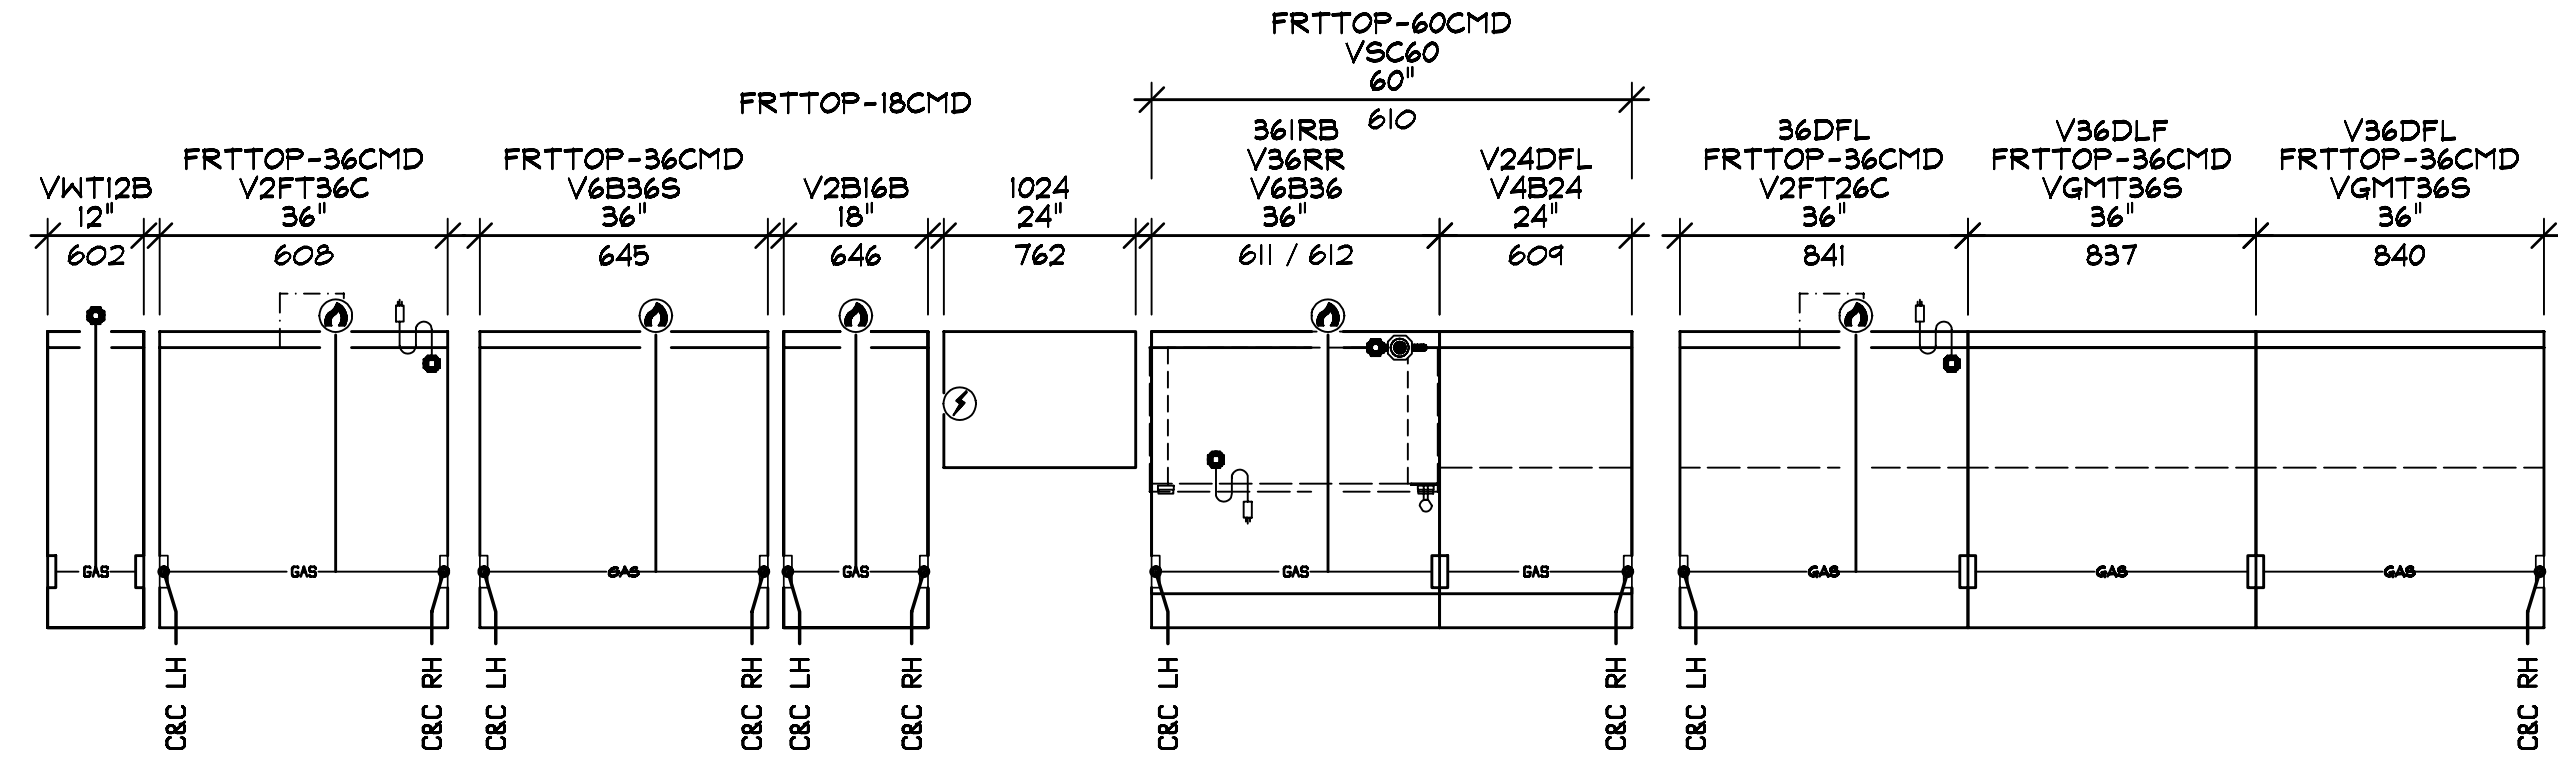
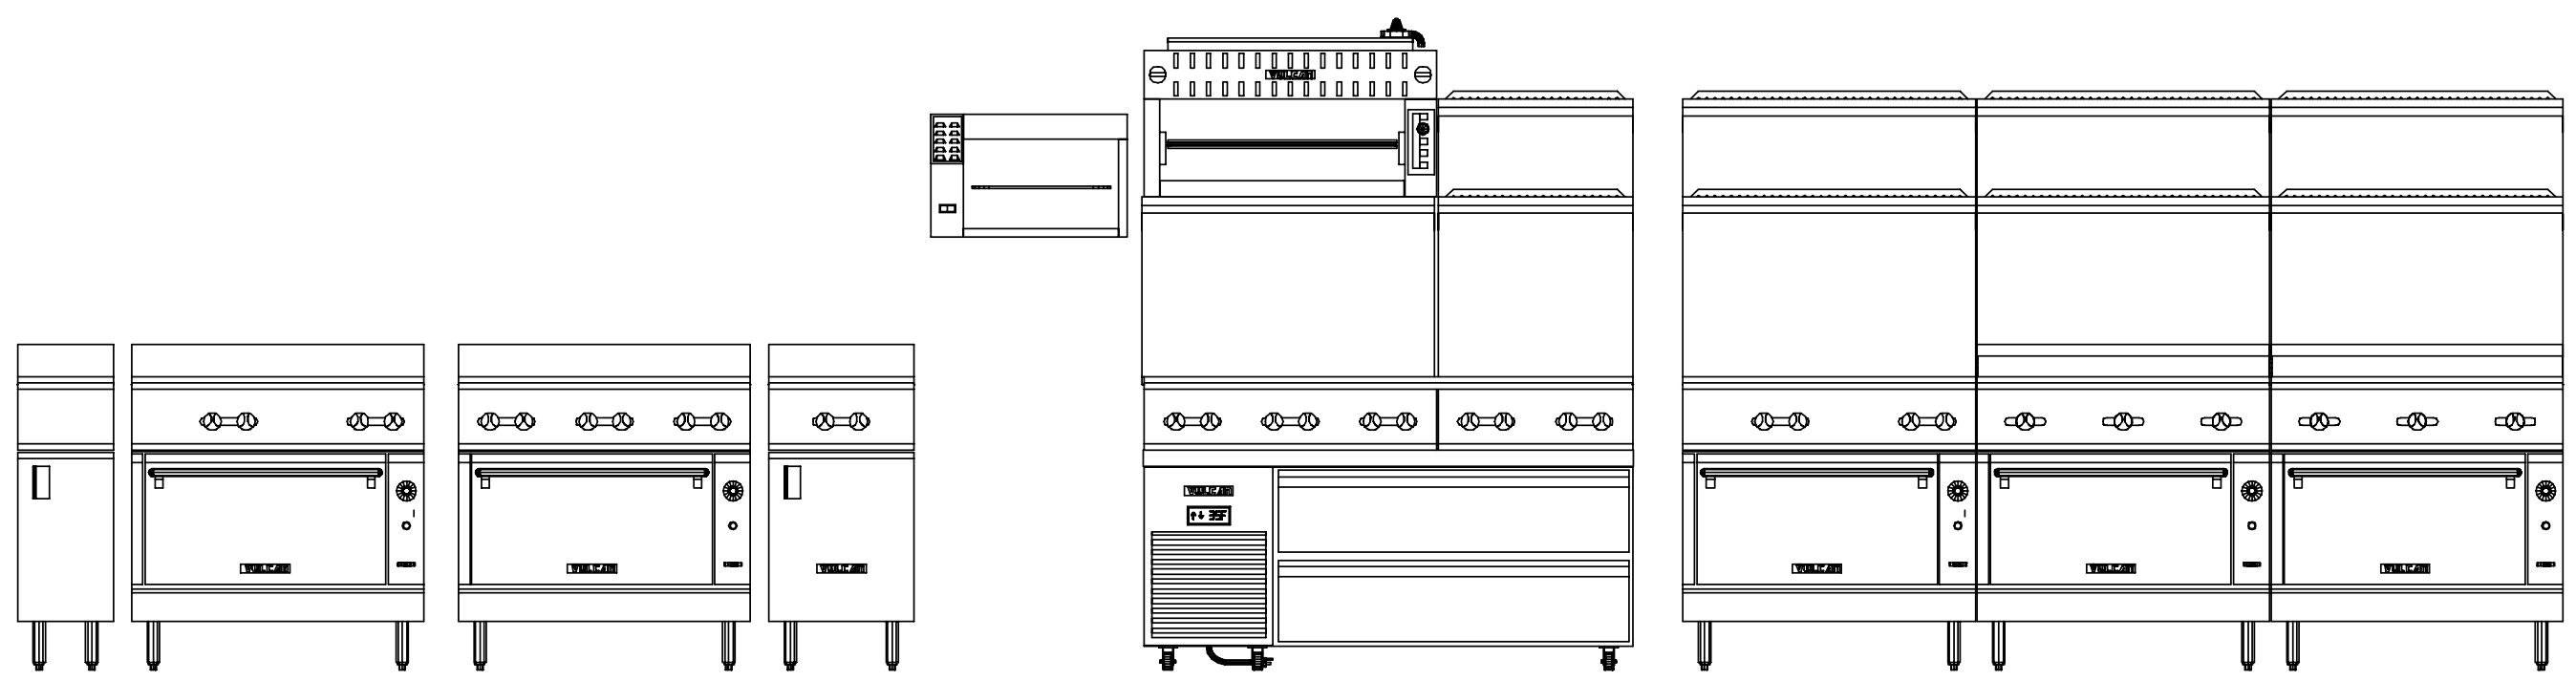
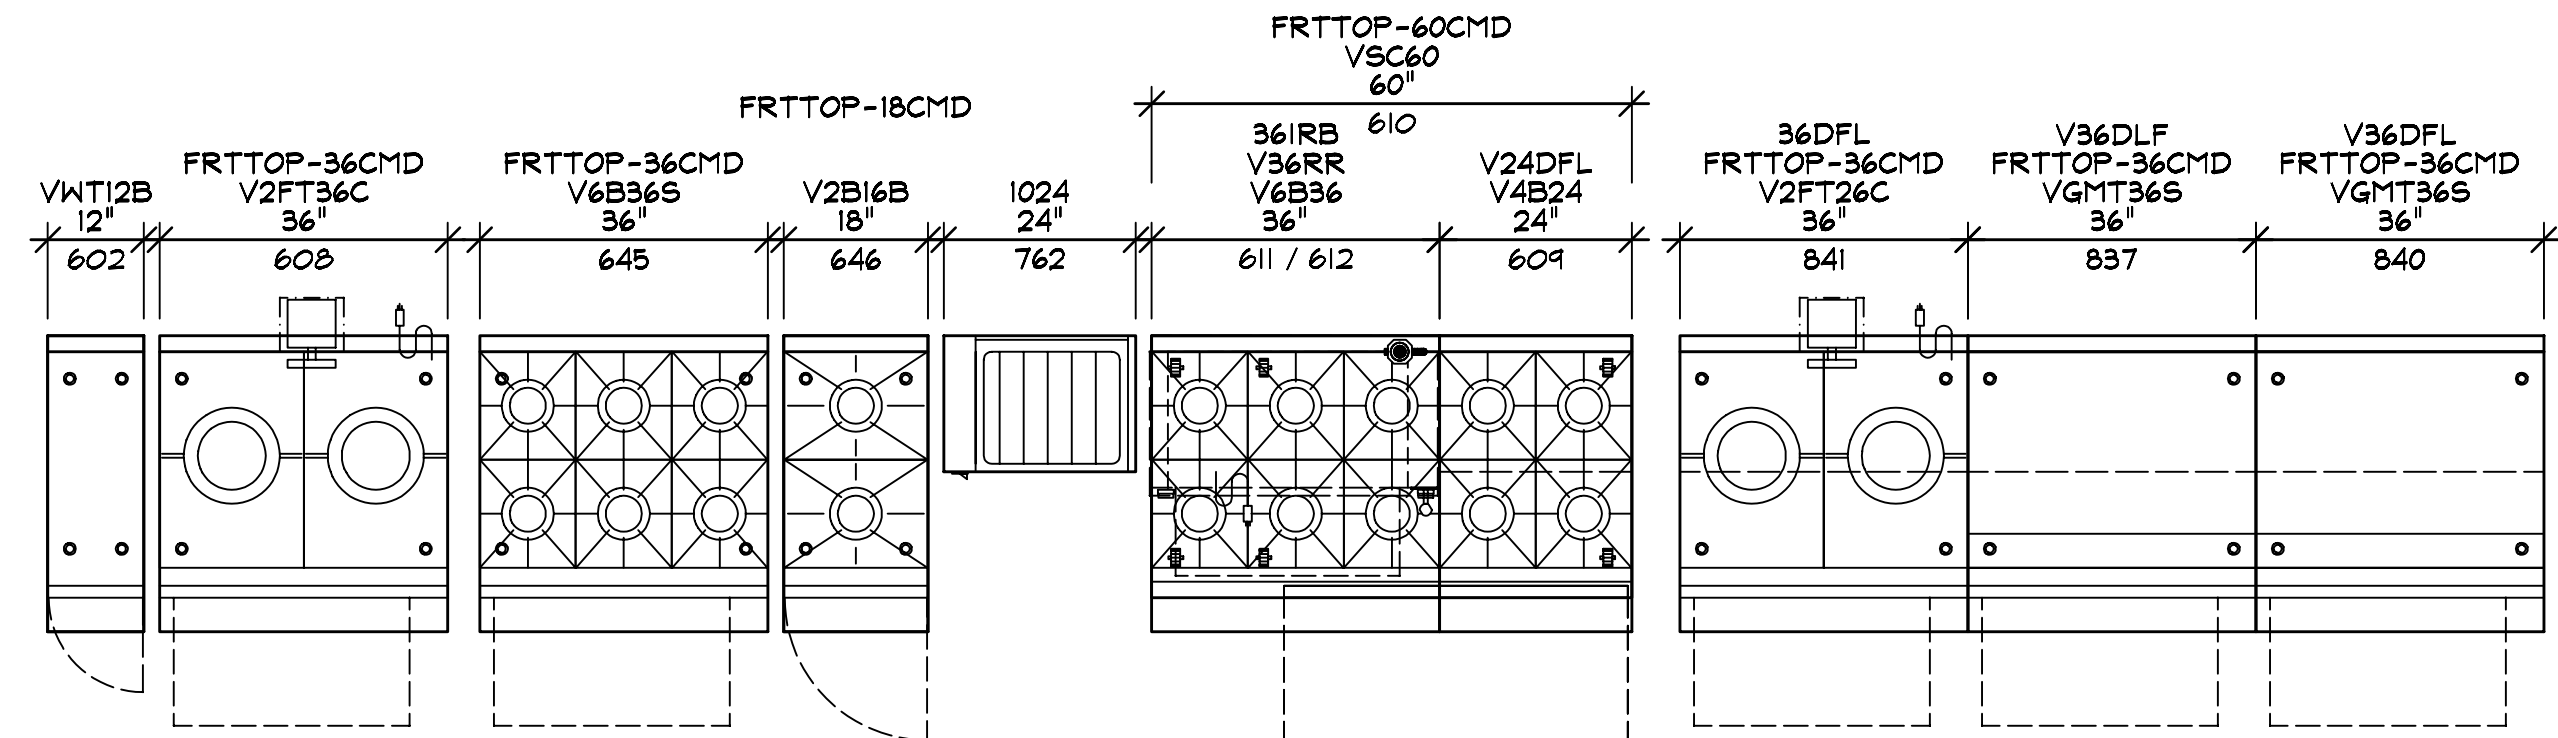


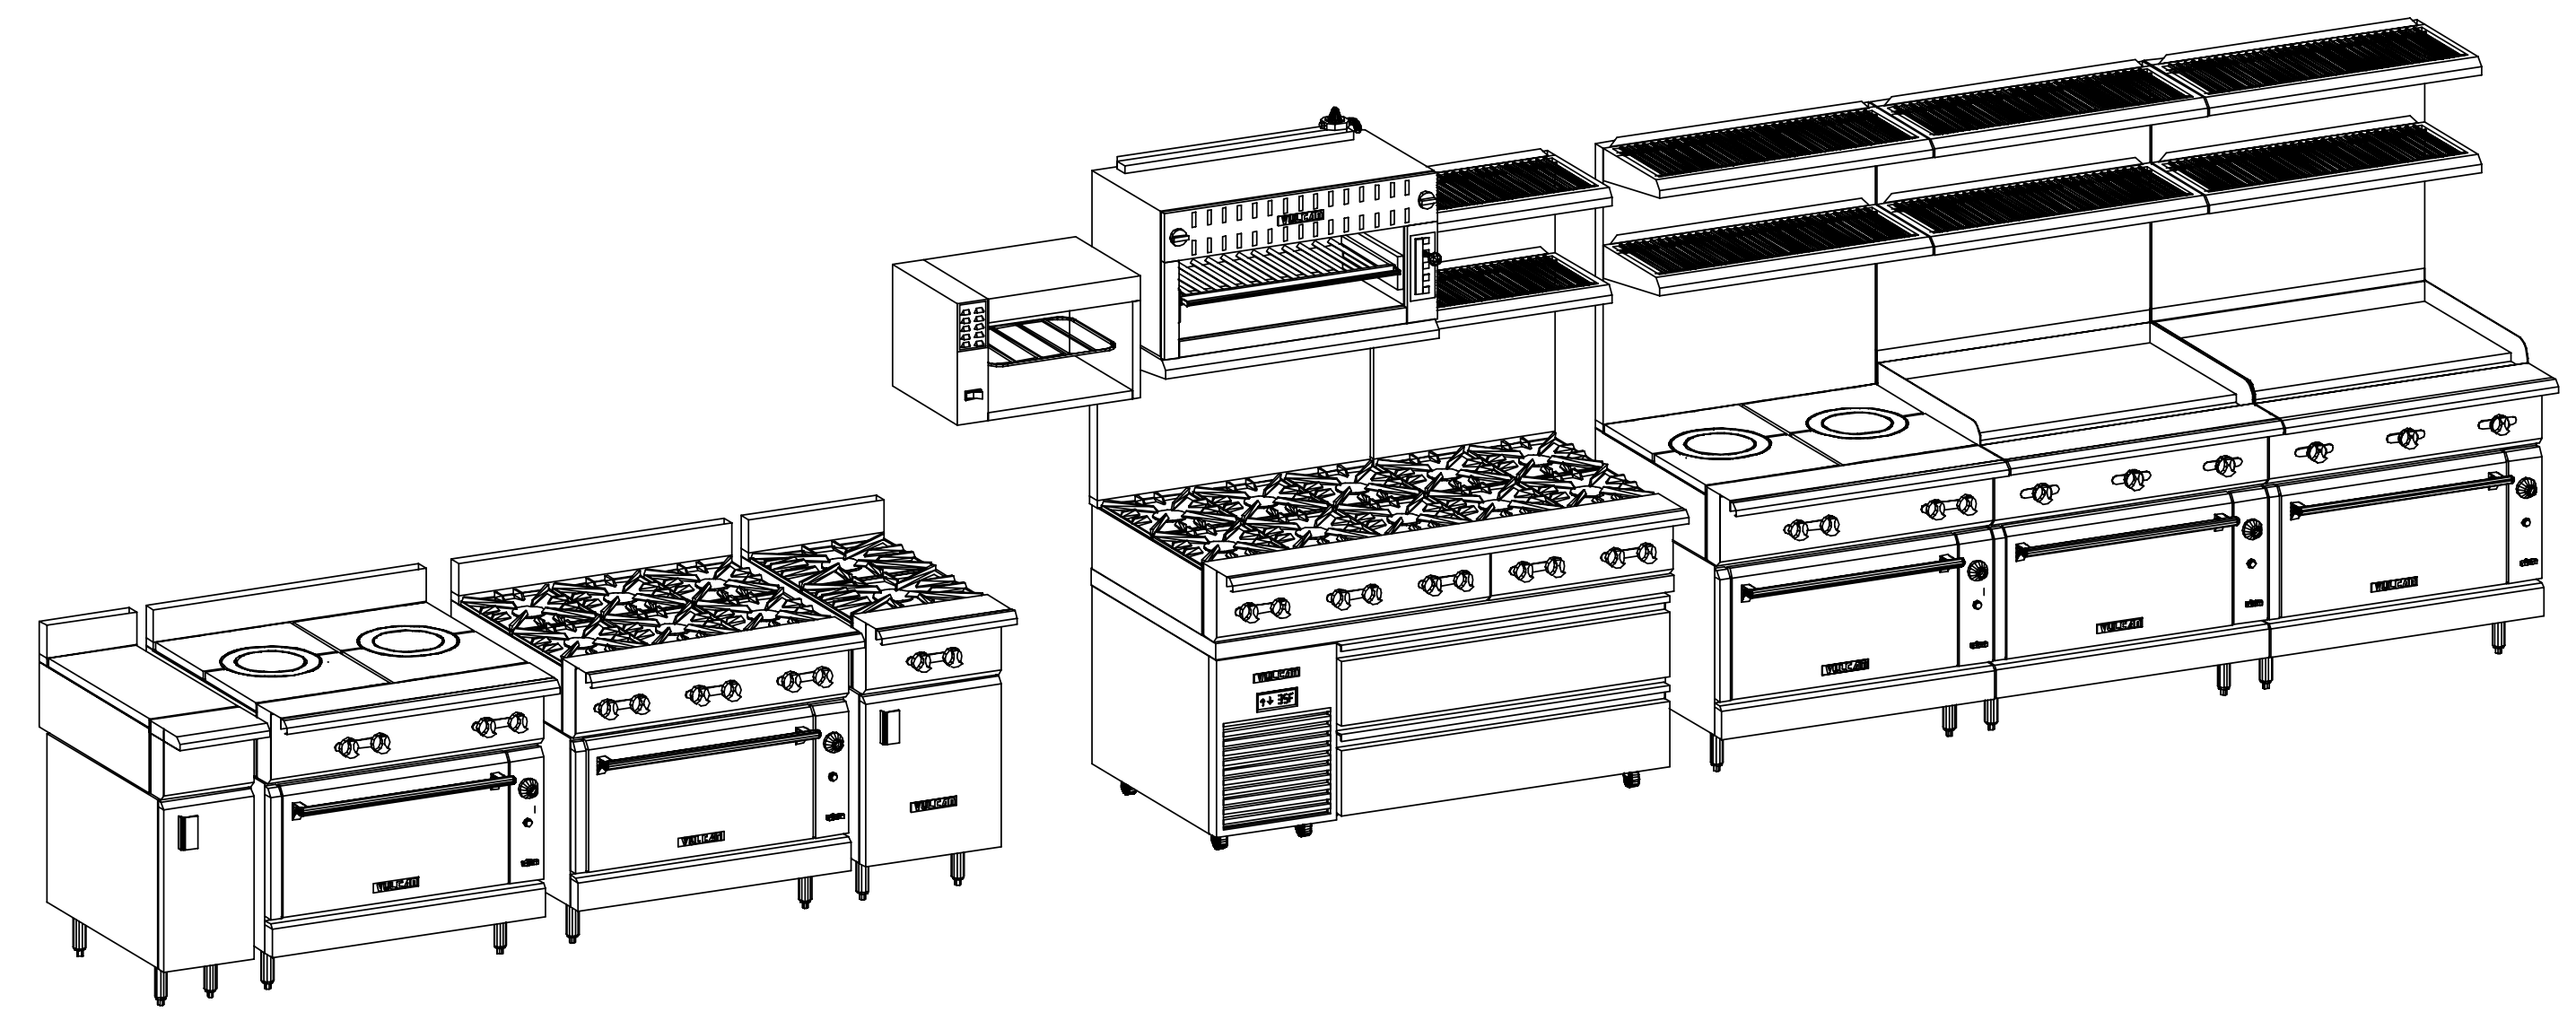

GAS CONNECTION #1:
LOCATED IN ITEM: 611
PIPE SIZE: 1.25 NPT
CP HEIGHT: 32" AFF
TOTAL GAS LOAD: 380 MBTU
INCLUDES ITEMS: 612 611 609
NOTE:

GAS CONNECTION #2:
LOCATED IN ITEM: 841
PIPE SIZE: 1.25 NPT
CP HEIGHT: 32" AFF
TOTAL GAS LOAD: 362 MBTU
INCLUDES ITEMS: 841 840 837
NOTE:

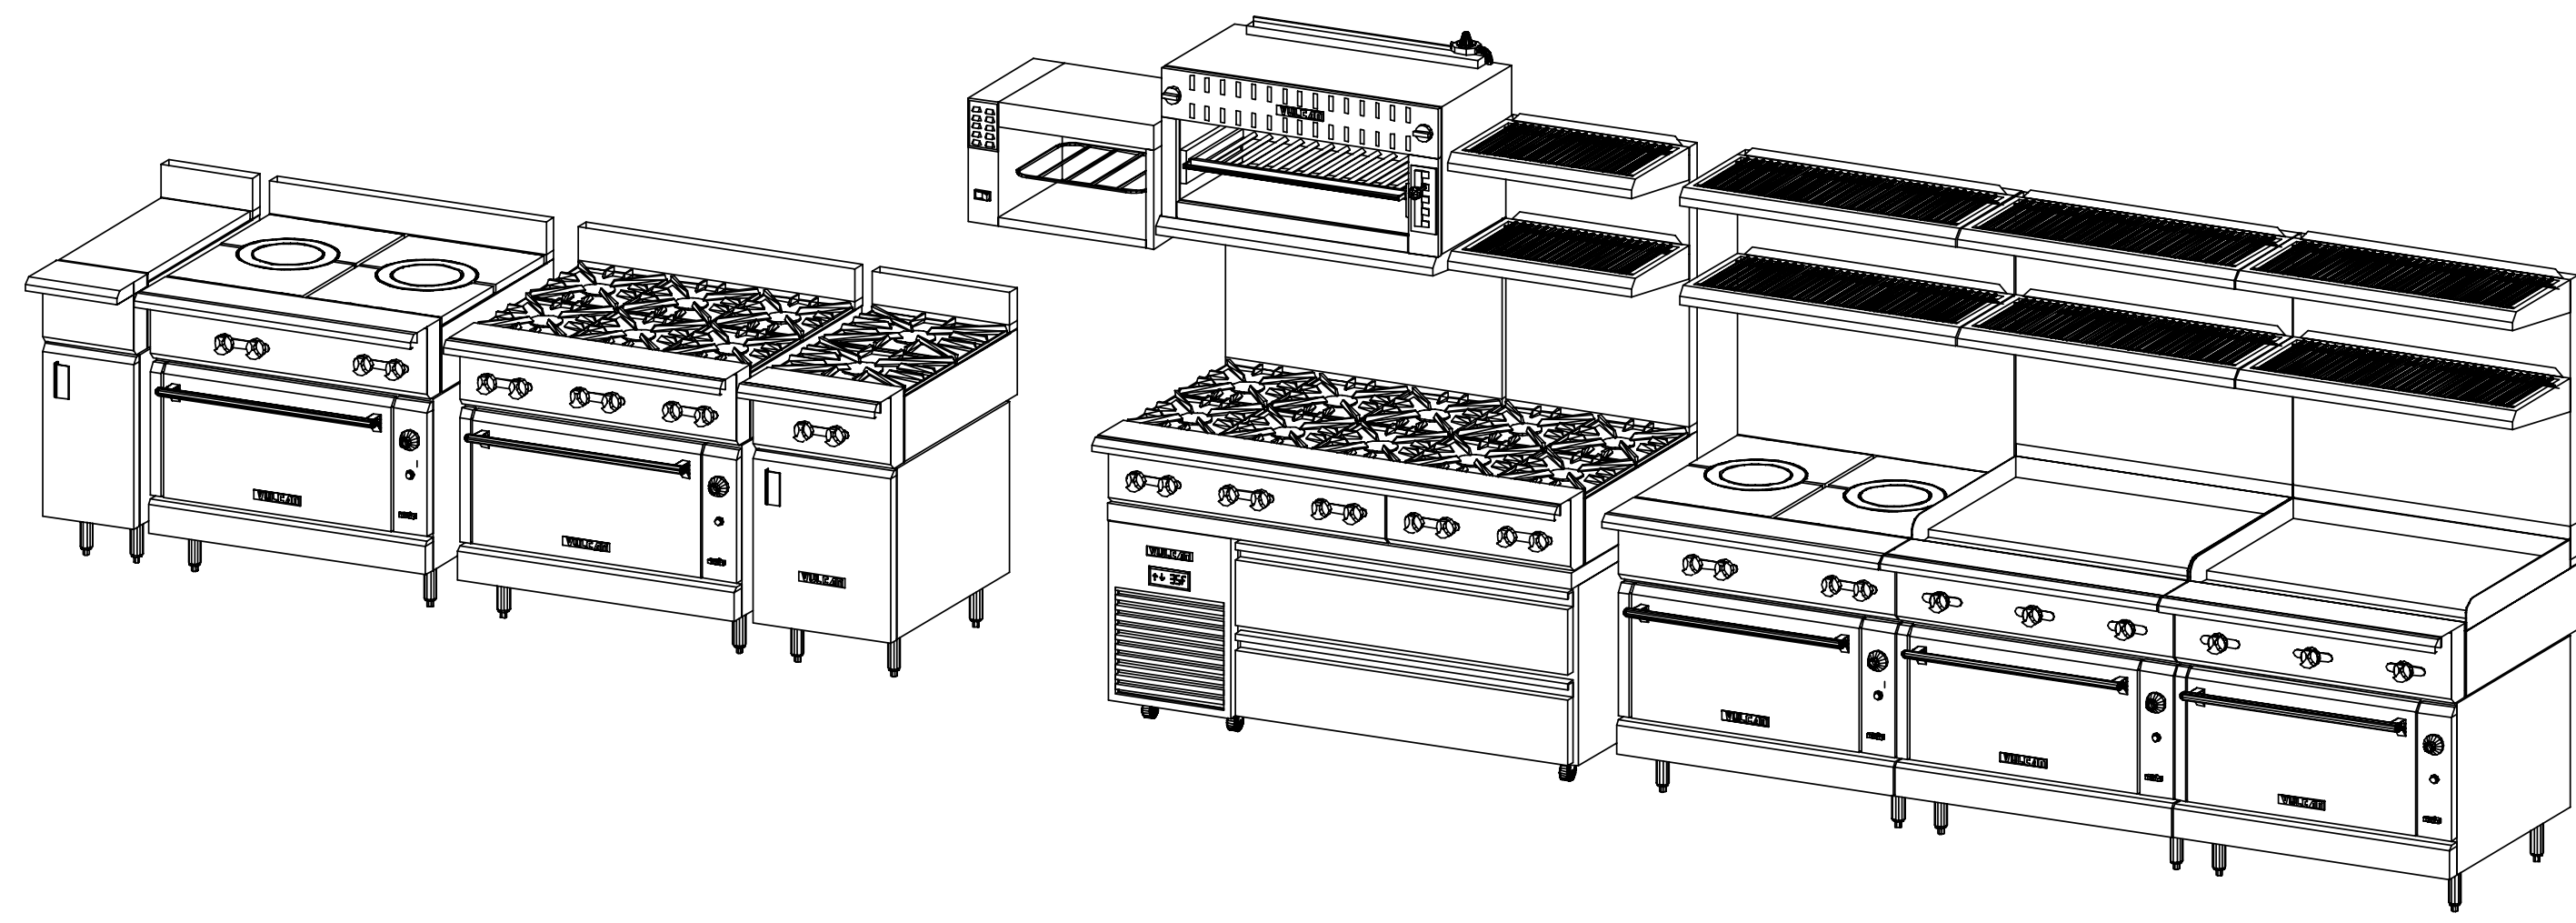

602	1 EA	VWT12B	SPREADER	
608	1 EA	V2FT36C	RANGE	
Ⓐ	82 MBTU	1.25	32 AFF	
②	120 (1)	4.0A	5-15	
609	1 EA	V4B24	RANGE	
Ⓐ	140 MBTU	1.25	MANIFOLD	
610	1 EA	VSC60	REFRIGERATED BASE	
②	120 (1)	7.8A	5-15	
611	1 EA	V6B36	RANGE	
Ⓐ	210 MBTU	1.25	MANIFOLD	
612	1 EA	36IRB	SALAMANDER	
Ⓐ	30 MBTU	0.75	INTERPLUMB	
645	1 EA	V6B36S	RANGE	
Ⓐ	260 MBTU	1.25	MANIFOLD	
646	1 EA	V2B16B	RANGE	
Ⓐ	140 MBTU	1.25	32 AFF	
762	1 EA	1024	CHEESE MELTER	
②	208 (1)	11.5A	78 AFF	
837	1 EA	VGMT36S	RANGE	
Ⓐ	90 MBTU	1.25	MANIFOLD	
840	1 EA	VCBB36B	CHAR BROILER	
Ⓐ	140 MBTU	1.25	MANIFOLD	1/27/21
841	1 EA	V2FT36C	RANGE	
Ⓐ	82 MBTU	1.25	32 AFF	
②	120 (1)	4.0A	5-15	

GENERAL NOTES - PLEASE READ

VENTILATION:
ALL COOKING EQUIPMENT MUST BE VENTILATED BY AN APPROVED APPLIANCE IN ACCORDANCE WITH ALL APPLICABLE CODES.

FIRE SUPPRESSION:
ALL COOKING EQUIPMENT MUST BE PROTECTED BY AN APPROVED FIRE SUPPRESSION SYSTEM IN ACCORDANCE WITH ALL APPLICABLE CODES.

CONNECTIONS:
ALL PIPING, FITTINGS, AND INTERCONNECTION SERVICES SHOWN ARE TO BE SUPPLIED AND INSTALLED BY LICENSED CONTRACTORS IN ACCORDANCE WITH ALL LOCAL CODES.

GAS CONNECTIONS:
EXTERNAL GAS REGULATORS, FLEXIBLE GAS LINES AND RESTRAINING CABLES PROVIDED WITH THE EQUIPMENT MUST BE INSTALLED BY LICENSED CONTRACTORS IN ACCORDANCE WITH ALL LOCAL CODES. INCOMING GAS MANIFOLD SUPPLY PRESSURE MUST NOT EXCEED 0.5 PSI (4" W.C.)

BY OTHERS:
VERIFY ALL EQUIPMENT LISTED AS BY OTHERS FOR SIZE AND MECHANICAL SERVICE REQUIREMENTS.

NOTE:
IN LINE WITH THE POLICY TO CONTINUALLY IMPROVE ITS PRODUCTS, THE MANUFACTURER RESERVE THE RIGHT TO CHANGE MATERIALS AND SPECIFICATIONS WITHOUT NOTICE.

- CONNECTION POINT
- Ⓒ COLD WATER
 - Ⓓ HOT WATER
 - Ⓔ HOT + COLD WATER
 - Ⓕ DRAIN
 - Ⓖ POWER
 - Ⓗ SWITCH
 - Ⓘ CORD SET
 - Ⓢ CONV OUTLET RECP
 - Ⓣ DUPLEX RECPTABLE
 - Ⓤ SINGLE RECPTABLE
 - Ⓦ GAS
 - Ⓢ STEAM SUPPLY
 - Ⓢ STEAM RETURN
 - Ⓢ STEAM TAKE OFF
 - Ⓤ EXHAUST VENT
 - Ⓤ SUPPLY VENT
 - Ⓤ REFRIGERATION

10-13-2020
10-13-2020 : 10:40:09a

PROJECT CODE
BRRCS

VULCAN
THE VULCAN HART COMPANY
BALTIMORE, MARYLAND
410-284-0660

BOCA RATON
BRRCS

REVISIONS	By	Date	Revision
5	ddb	10/14/20	Items 609 611 612
6	ddb	01/27/21	Item 837 840 841

NEXT STEP DESIGN
913 WEST ST.
ANNAPOLIS, MD 21401

SCALE:
AS NOTED
DATE: 10-13-2020
DRAWN BY: ddb
VH-BRCC5