



VH-CBACK COPYRIGHT (C) 2021






VH-CBACK COPYRIGHT (C) 2021

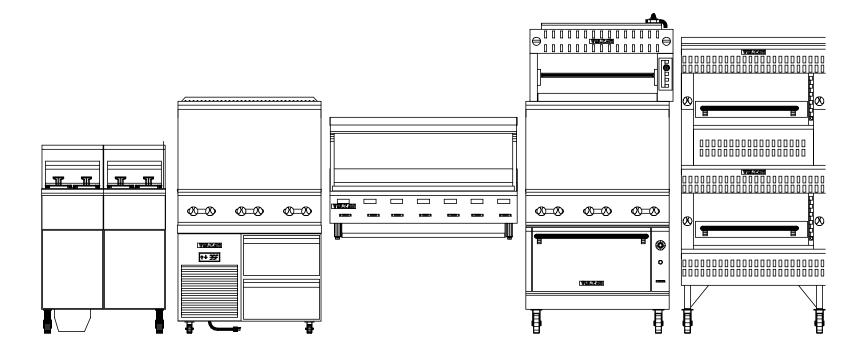

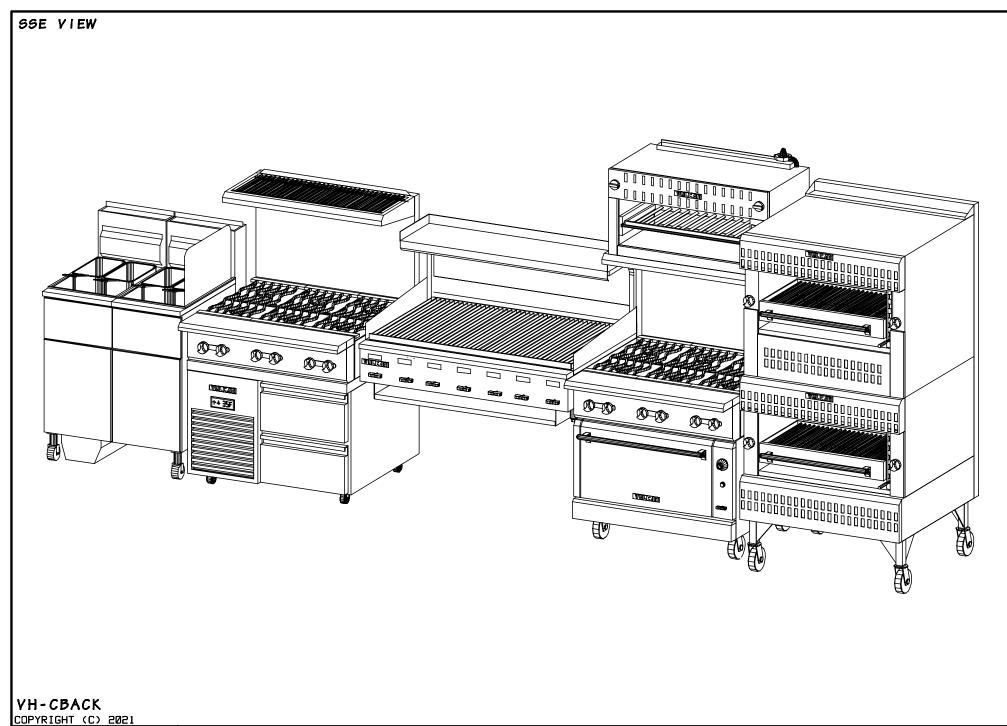



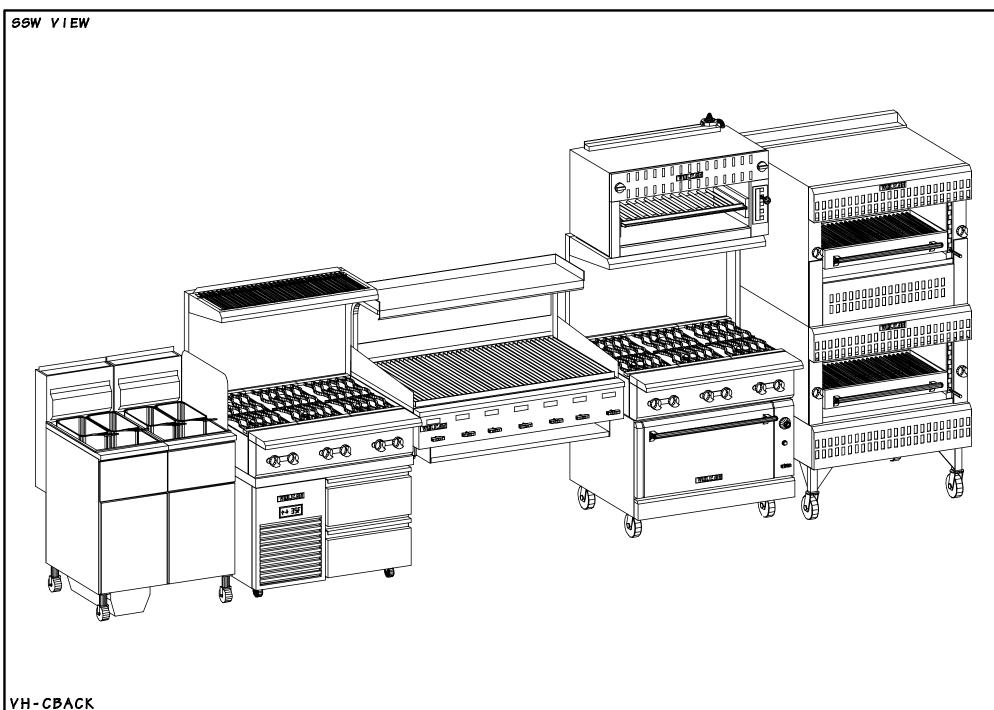





## GENERAL NOTES - PLEASE READ

**VENTILATION:** 

ALL COOKING EQUIPMENT MUST BE VENTILATED BY AN APPROVED APPLIANCE IN ACCORDANCE WITH ALL APPLICABLE CODES.

FIRE SUPPRIESSION:

ALL COOKING EQUIPMENT MUST BE PROTECTED BY AN APPROVED FIRE SUPPRESSION SYSTEM IN ACCORDANCE WITH ALL APPLICABLE CODES.

CONNECTIONS:

ALL PIPING, FITTINGS, AND INTERCONNECTION SERVICES SHOWN ARE TO BE SUPPLIED AND INSTALLED BY LICENSED CONTRACTORS IN ACCORDANCE WITH ALL LOCAL CODES.

GAS CONNECTIONS:

EXTERNAL GAS REGULATORS, FLEXIBLE GAS LINES AND RESTRAINING CABLES PROVIDED WITH THE EQUIPMENT MUST BE INSTALLED BY LICENSED CONTRACTORS IN ACCORDANCE WITH ALL LOCAL CODES. INCOMING GAS MANIFOLD SUPPLY PRESSURE MUST NOT EXCEED 0.5 PSI (14" W.C.)

BY OTHERS:

VERIFY ALL EQUIPMENT LISTED AS BY OTHERS FOR SIZE AND MECHANICAL SERVICE REQUIREMENTS.

NOTE:

IN LINE WITH THE POLICY TO CONTINUALLY IMPROVE ITS PRODUCTS, THE MANUFACTURES RESERVE THE RIGHT TO CHANGE MATERIALS AND SPECIFICATIONS WITHOUT NOTICE.

HOT + COLD
WATER

D DRAIN

POWER

SWITCH
CORD SET

€ CONV OUTLET RECP

CONNECTION POINT

(C) COLD WATER

(H) HOT WATER

DUPLEX RECPTACLE

SINGLE RECPTACLE

GAS

(SS) STEAM SUPPLY

CR STEAM RETURN

ST STEAM TAKE OFF

VE EXHAUST VENT

VS SUPPLY VENT

(RF) REFRIGERATION

02-14-2021

02-|4-202| : 07:52:43a

Steve Heraty 4 STAR REPS

PROJECT CODE

**CBACK** 

v. 267-522-8991

Email:steve@4starreps.com

VH-CBACK
COPYRIGHT (C) 2021

