
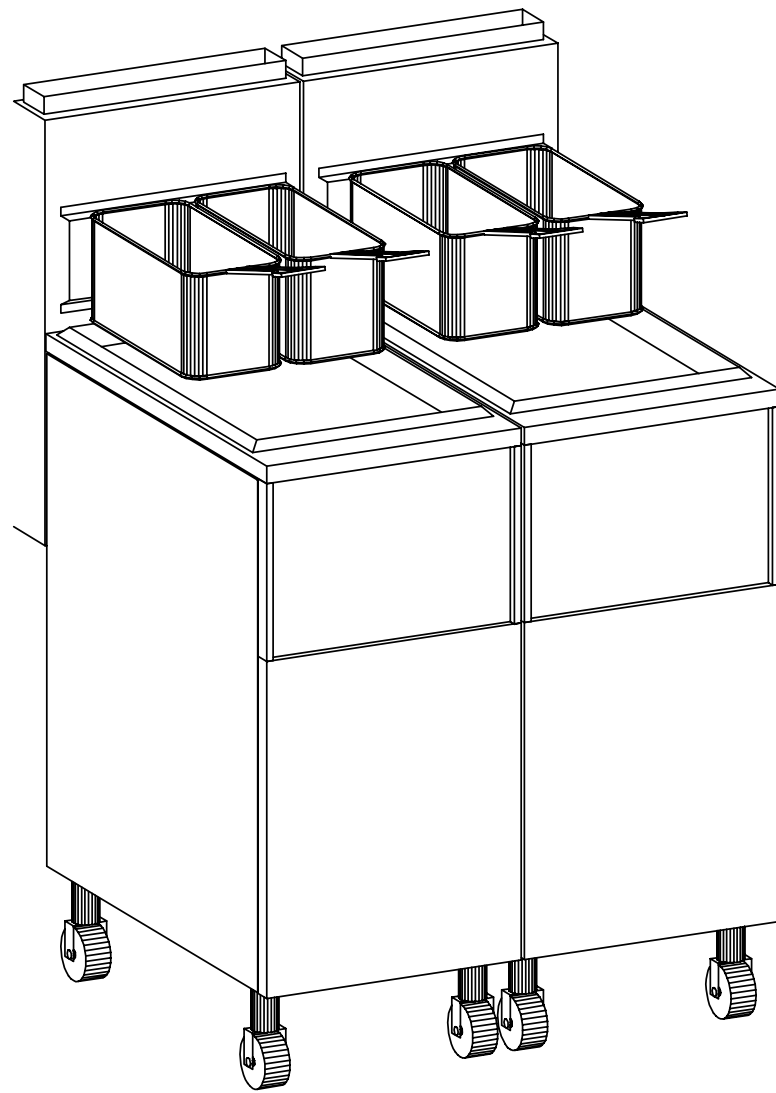


295	2 EA	1TR45CF	FRYER
⚡	120 (1)	2.0A	5-15
🔥	70 MBTU	0.75	12 AFF

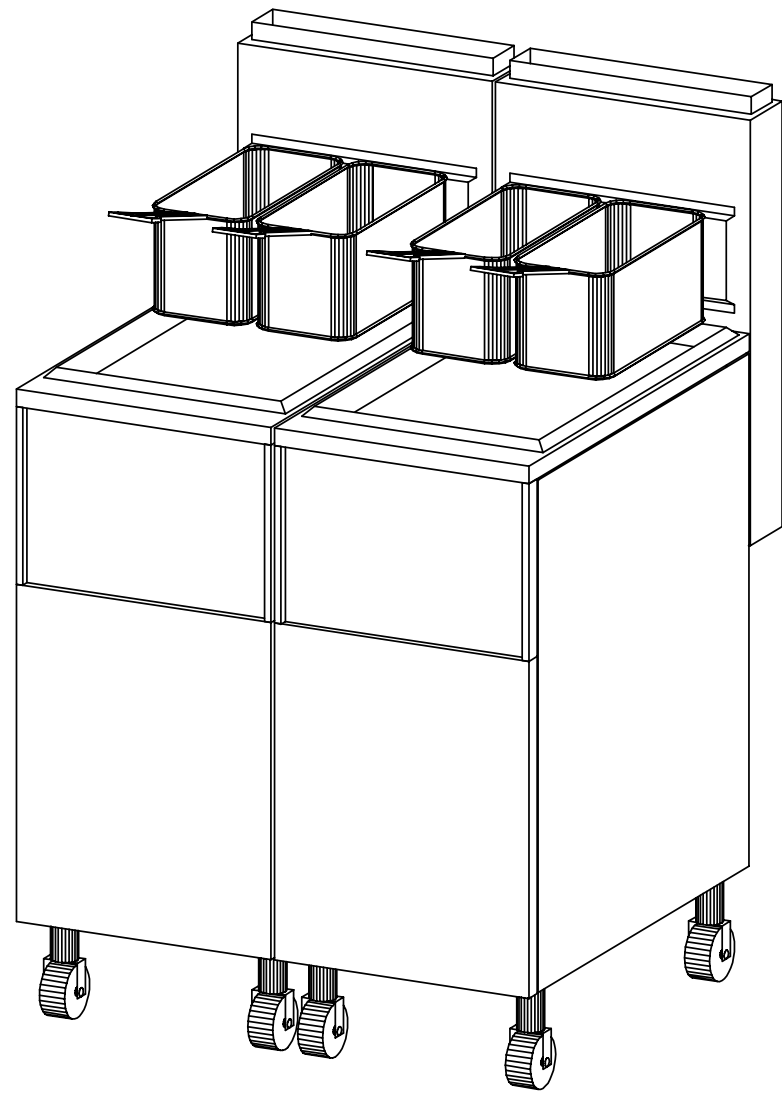

#### GENERAL NOTES - PLEASE READ

VENTILATION:  
ALL COOKING EQUIPMENT MUST BE VENTILATED BY AN APPROVED APPLIANCE IN ACCORDANCE WITH ALL APPLICABLE CODES.

FIRE SUPPRESSION:  
ALL COOKING EQUIPMENT MUST BE PROTECTED BY AN APPROVED FIRE SUPPRESSION SYSTEM IN ACCORDANCE WITH ALL APPLICABLE CODES.

CONNECTIONS:  
ALL PIPING, FITTINGS, AND INTERCONNECTION SERVICES SHOWN ARE TO BE SUPPLIED AND INSTALLED BY LICENSED CONTRACTORS IN ACCORDANCE WITH ALL LOCAL CODES.

GAS CONNECTIONS:  
EXTERNAL GAS REGULATORS, FLEXIBLE GAS LINES AND RESTRAINING CABLES PROVIDED WITH THE EQUIPMENT MUST BE INSTALLED BY LICENSED CONTRACTORS IN ACCORDANCE WITH ALL LOCAL CODES. INCOMING GAS MANIFOLD SUPPLY PRESSURE MUST NOT EXCEED 0.5 PSI (4\"/>

⬮	CONNECTION POINT
❄	COLD WATER
🔥	HOT WATER
❄🔥	HOT + COLD WATER
⬮	DRAIN
⚡	POWER
🔌	SWITCH
🔌	CORD SET
Ⓒ	CONV. OUTLET RECP
Ⓓ	DUPLEX RECP/TACLE
Ⓔ	SINGLE RECP/TACLE
🔥	GAS
🔥	STEAM SUPPLY
🔥	STEAM RETURN
🔥	STEAM TAKE OFF
🔥	EXHAUST VENT
🔥	SUPPLY VENT
🔥	REFRIGERATION

08-24-2021

PROJECT CODE  
GAMM8

#### NEXT STEP DESIGN

913 WEST ST.  
ANNAPOLIS, MD 21401

SCALE: AS NOTED  
DATE: 08/24/2021  
DRAWN BY: DDB  
VH-GAMM8

**VULCAN**  
THE VULCAN HART COMPANY  
BALTIMORE, MARYLAND  
410-284-0660

GAMMA - 8  
Item 295  
FRYERS

REVISIONS			
No.	Date	By	Revision
02	08/24/2021	ddb	FRYER