


107	1 EA	VWT12B	SPREADER
190	0 MBTU	1.25	32 AFF REAR GAS
50	1 EA	V4B36S	RANGE
190	0 MBTU	1.25	MANIFOLD

GAS CONNECTION #1
LOCATED IN ITEM# 1
PIPE SIZE# 1.25 NPT
CP HEIGHT# 32" AFF
TOTAL GAS LOAD# 190 MBTU
INCLUDES ITEMS# 50 49
NOTE#

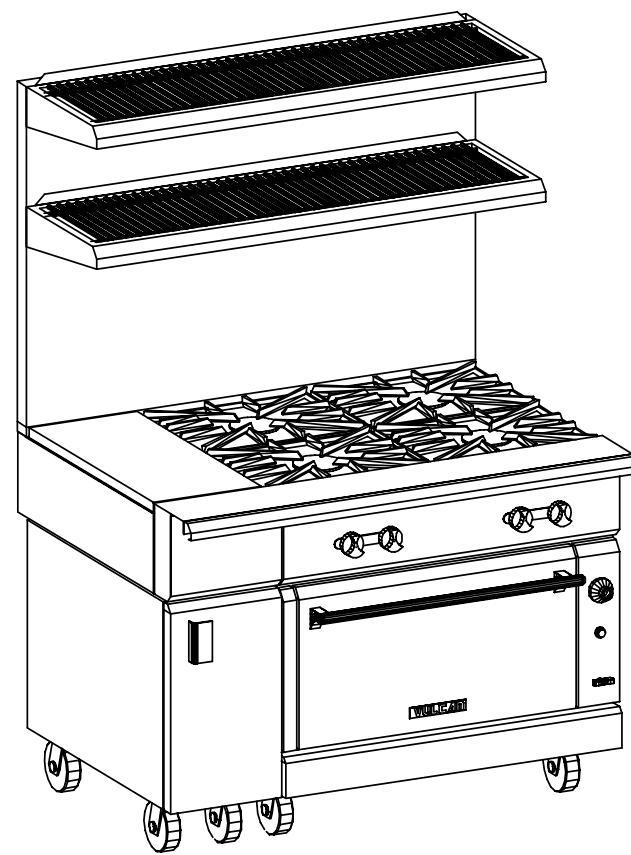

GENERAL NOTES - PLEASE READ

VENTILATION:
ALL COOKING EQUIPMENT MUST BE VENTILATED BY AN APPROVED APPLIANCE IN ACCORDANCE WITH ALL APPLICABLE CODES.

FIRE SUPPRESSION:
ALL COOKING EQUIPMENT MUST BE PROTECTED BY AN APPROVED FIRE SUPPRESSION SYSTEM IN ACCORDANCE WITH ALL APPLICABLE CODES.

CONNECTIONS:
ALL PIPING, FITTINGS, AND INTERCONNECTION SERVICES SHOWN ARE TO BE SUPPLIED AND INSTALLED BY LICENSED CONTRACTORS IN ACCORDANCE WITH ALL LOCAL CODES.

GAS CONNECTIONS:
EXTERNAL GAS REGULATORS, FLEXIBLE GAS LINES AND RESTRAINING CABLES PROVIDED WITH THE EQUIPMENT MUST BE INSTALLED BY LICENSED CONTRACTORS IN ACCORDANCE WITH ALL LOCAL CODES. INCOMING GAS MANIFOLD SUPPLY PRESSURE MUST NOT EXCEED 0.5 PSI (4" W.C.)

BY OTHERS:
VERIFY ALL EQUIPMENT LISTED AS BY OTHERS FOR SIZE AND MECHANICAL SERVICE REQUIREMENTS.

NOTE:
IN LINE WITH THE POLICY TO CONTINUALLY IMPROVE ITS PRODUCTS, THE MANUFACTURER RESERVE THE RIGHT TO CHANGE MATERIALS AND SPECIFICATIONS WITHOUT NOTICE.

CONNECTION POINT
COLD WATER
HOT WATER
HOT + COLD WATER
DRAIN
POWER
SWITCH
CORD SET
CONV. OUTLET RECP
DUPLEX RECP/TABLE
SINGLE RECP/TABLE
GAS
STEAM SUPPLY
STEAM RETURN
STEAM TAKE OFF
EXHAUST VENT
SUPPLY VENT
REFRIGERATION

06-02-2021

PROJECT CODE
LAXT3

VULCAN
THE VULCAN HART COMPANY
BALTIMORE, MARYLAND
410-284-0660

DELAT LAX
T3 P3C

REVISIONS		Revision	
No.	Date	By	ddb
003	06-02-2021		

NEXT STEP DESIGN
913 WEST ST.
ANNAPOLIS, MD 21401

SCALE:
AS NOTED
DATE: 06-02-2021
DRAWN BY: DDB
VH-LAXT3

1
OF 1