
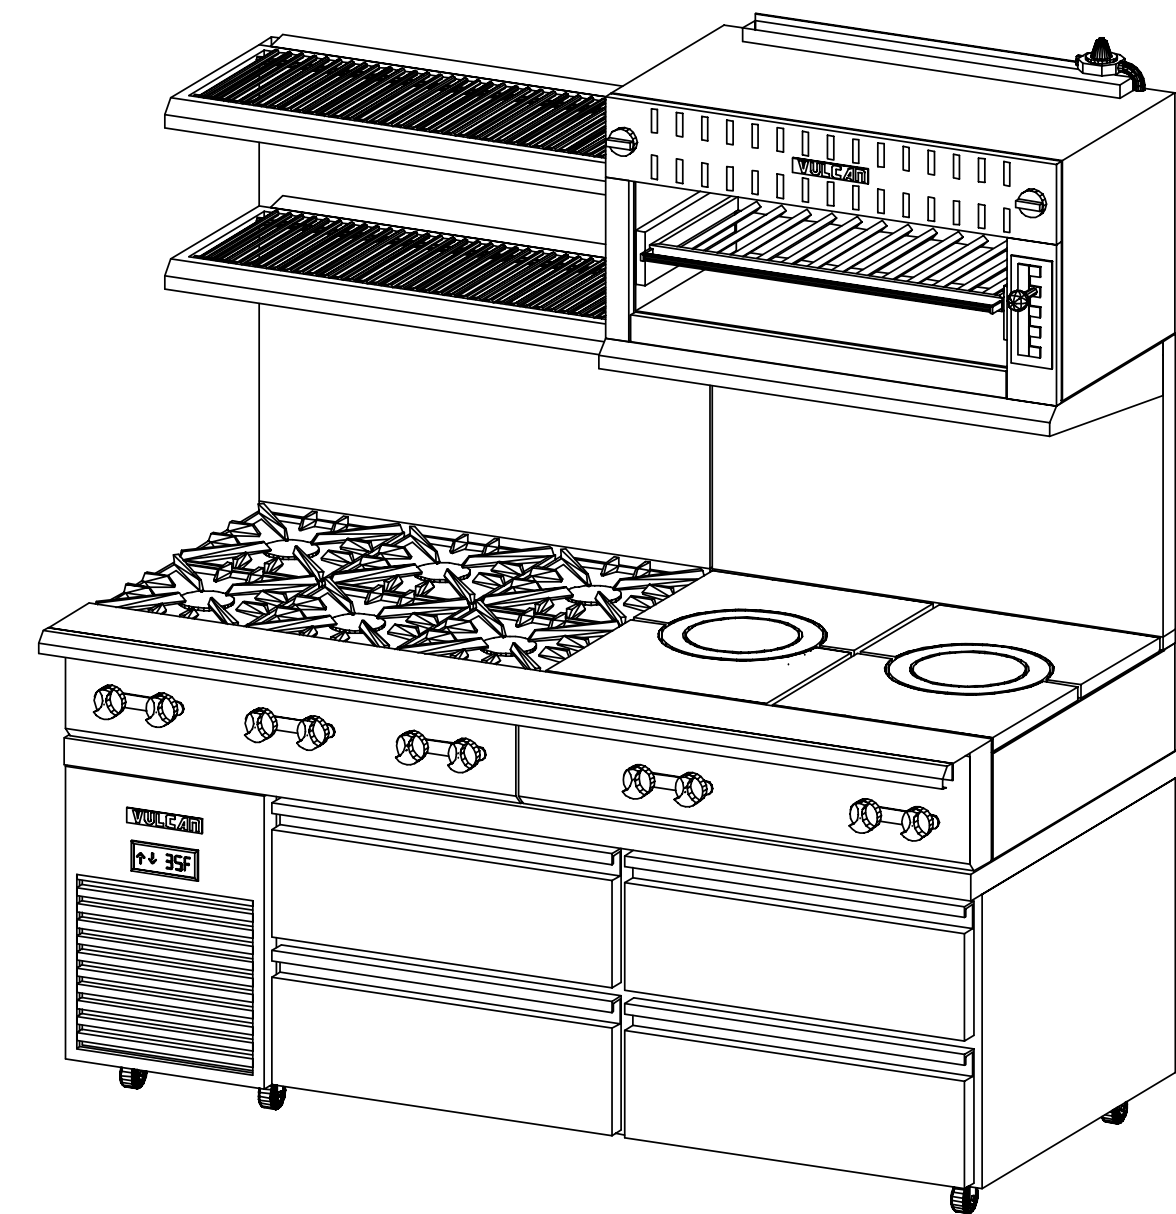


151	1 EA	36IRB	SALAMANDER
148	1 EA	V2FT36	RANGE
149	1 EA	VSC72	REFRIGERATED BASE
152	1 EA	V6B36	RANGE

GAS CONNECTION: #1  
LOCATED IN ITEM: 148  
PIPE SIZE: 1.25 NPT  
CP HEIGHT: 32" AFF  
TOTAL GAS LOAD: 230 MBTU  
FEEDS: 148 149 151  
NOTE:

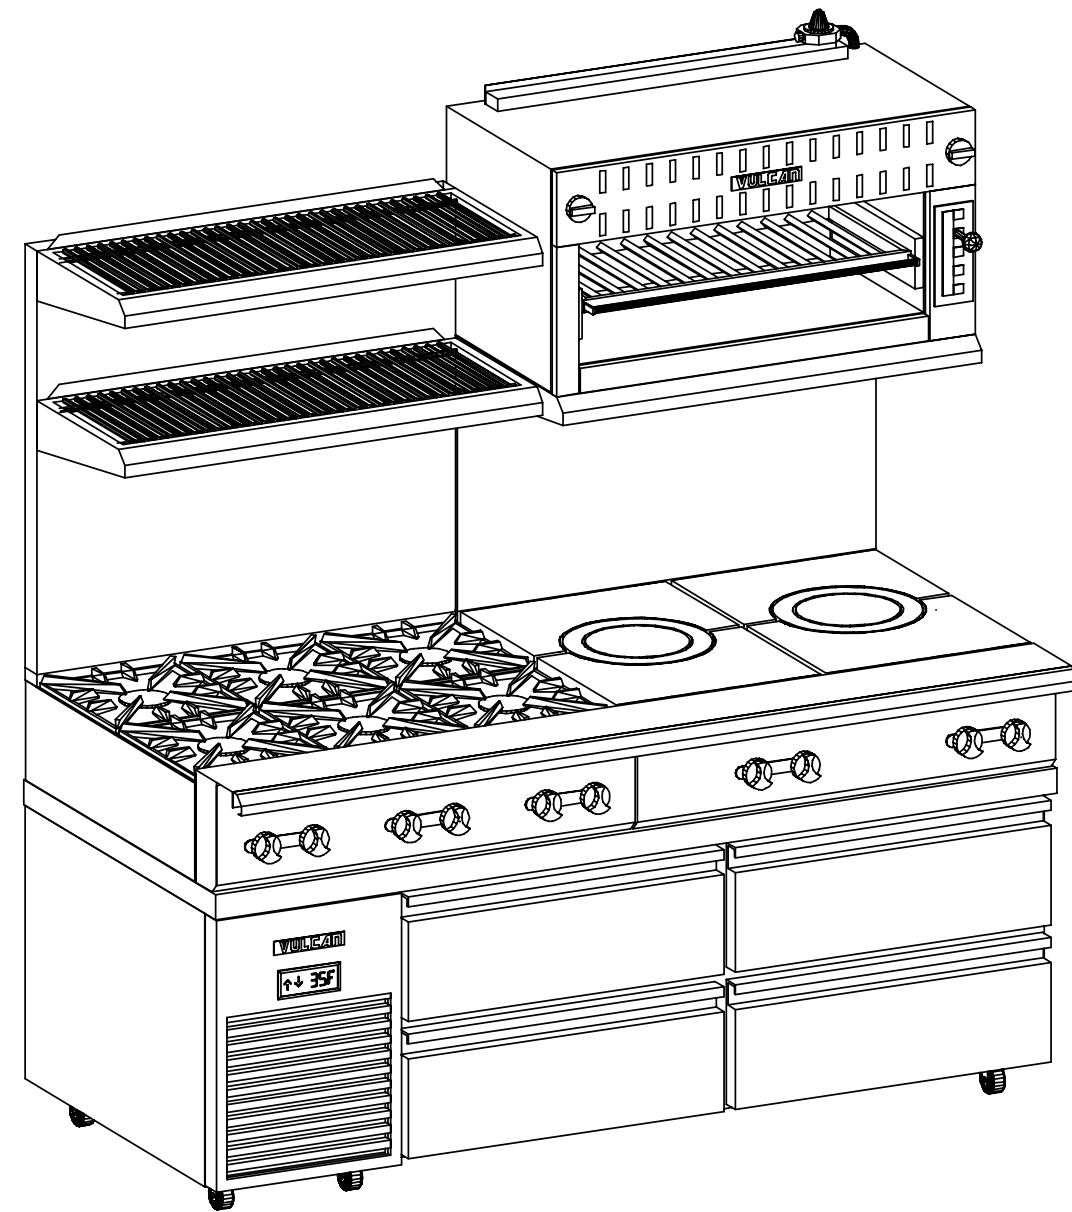

#### GENERAL NOTES - PLEASE READ

VENTILATION:  
ALL COOKING EQUIPMENT MUST BE VENTILATED BY AN APPROVED APPLIANCE IN ACCORDANCE WITH ALL APPLICABLE CODES.

FIRE SUPPRESSION:  
ALL COOKING EQUIPMENT MUST BE PROTECTED BY AN APPROVED FIRE SUPPRESSION SYSTEM IN ACCORDANCE WITH ALL APPLICABLE CODES.

CONNECTIONS:  
ALL PIPING, FITTINGS, AND INTERCONNECTION SERVICES SHOWN ARE TO BE SUPPLIED AND INSTALLED BY LICENSED CONTRACTORS IN ACCORDANCE WITH ALL LOCAL CODES.

GAS CONNECTIONS:  
EXTERNAL GAS REGULATORS, FLEXIBLE GAS LINES AND RESTRAINING CABLES PROVIDED WITH THE EQUIPMENT MUST BE INSTALLED BY LICENSED CONTRACTORS IN ACCORDANCE WITH ALL LOCAL CODES. INCOMING GAS MANIFOLD SUPPLY PRESSURE MUST NOT EXCEED 0.5 PSI (4" W.C.)

BY OTHERS:  
VERIFY ALL EQUIPMENT LISTED AS BY OTHERS FOR SIZE AND MECHANICAL SERVICE REQUIREMENTS.

NOTE:  
IN LINE WITH THE POLICY TO CONTINUALLY IMPROVE ITS PRODUCTS, THE MANUFACTURER RESERVE THE RIGHT TO CHANGE MATERIALS AND SPECIFICATIONS WITHOUT NOTICE.

CONNECTION POINT
COLD WATER
HOT WATER
HOT + COLD WATER
DRAIN
POWER
SWITCH
CORD SET
CONV. OUTLET RECP
DUPLEX RECP/TACTLE
SINGLE RECP/TACTLE
GAS
STEAM SUPPLY
STEAM RETURN
STEAM TAKE OFF
EXHAUST VENT
SUPPLY VENT
REFRIGERATION

06-18-2022

PROJECT CODE  
MAVR2

**VULCAN**  
THE VULCAN HART COMPANY  
BALTIMORE, MARYLAND  
410-284-0660

200 MASS AVE  
Line B1 - Revised

No.	Date	By	Revision
4	06/17/2022	ddb	TOTAL REVISE
2	07/20/2022	ddb	ADD SALAMANDER
6	09/29/2022	ddb	151 UPDATE ITEM NUMBER

**NEXT STEP DESIGN**  
**913 A West Street**  
**Annapolis, MD 21401**  
**410-263-1200**

SCALE:  
AS NOTED  
DATE: 06/17/2022  
DRAWN BY: ddb  
VH-BAVR1