
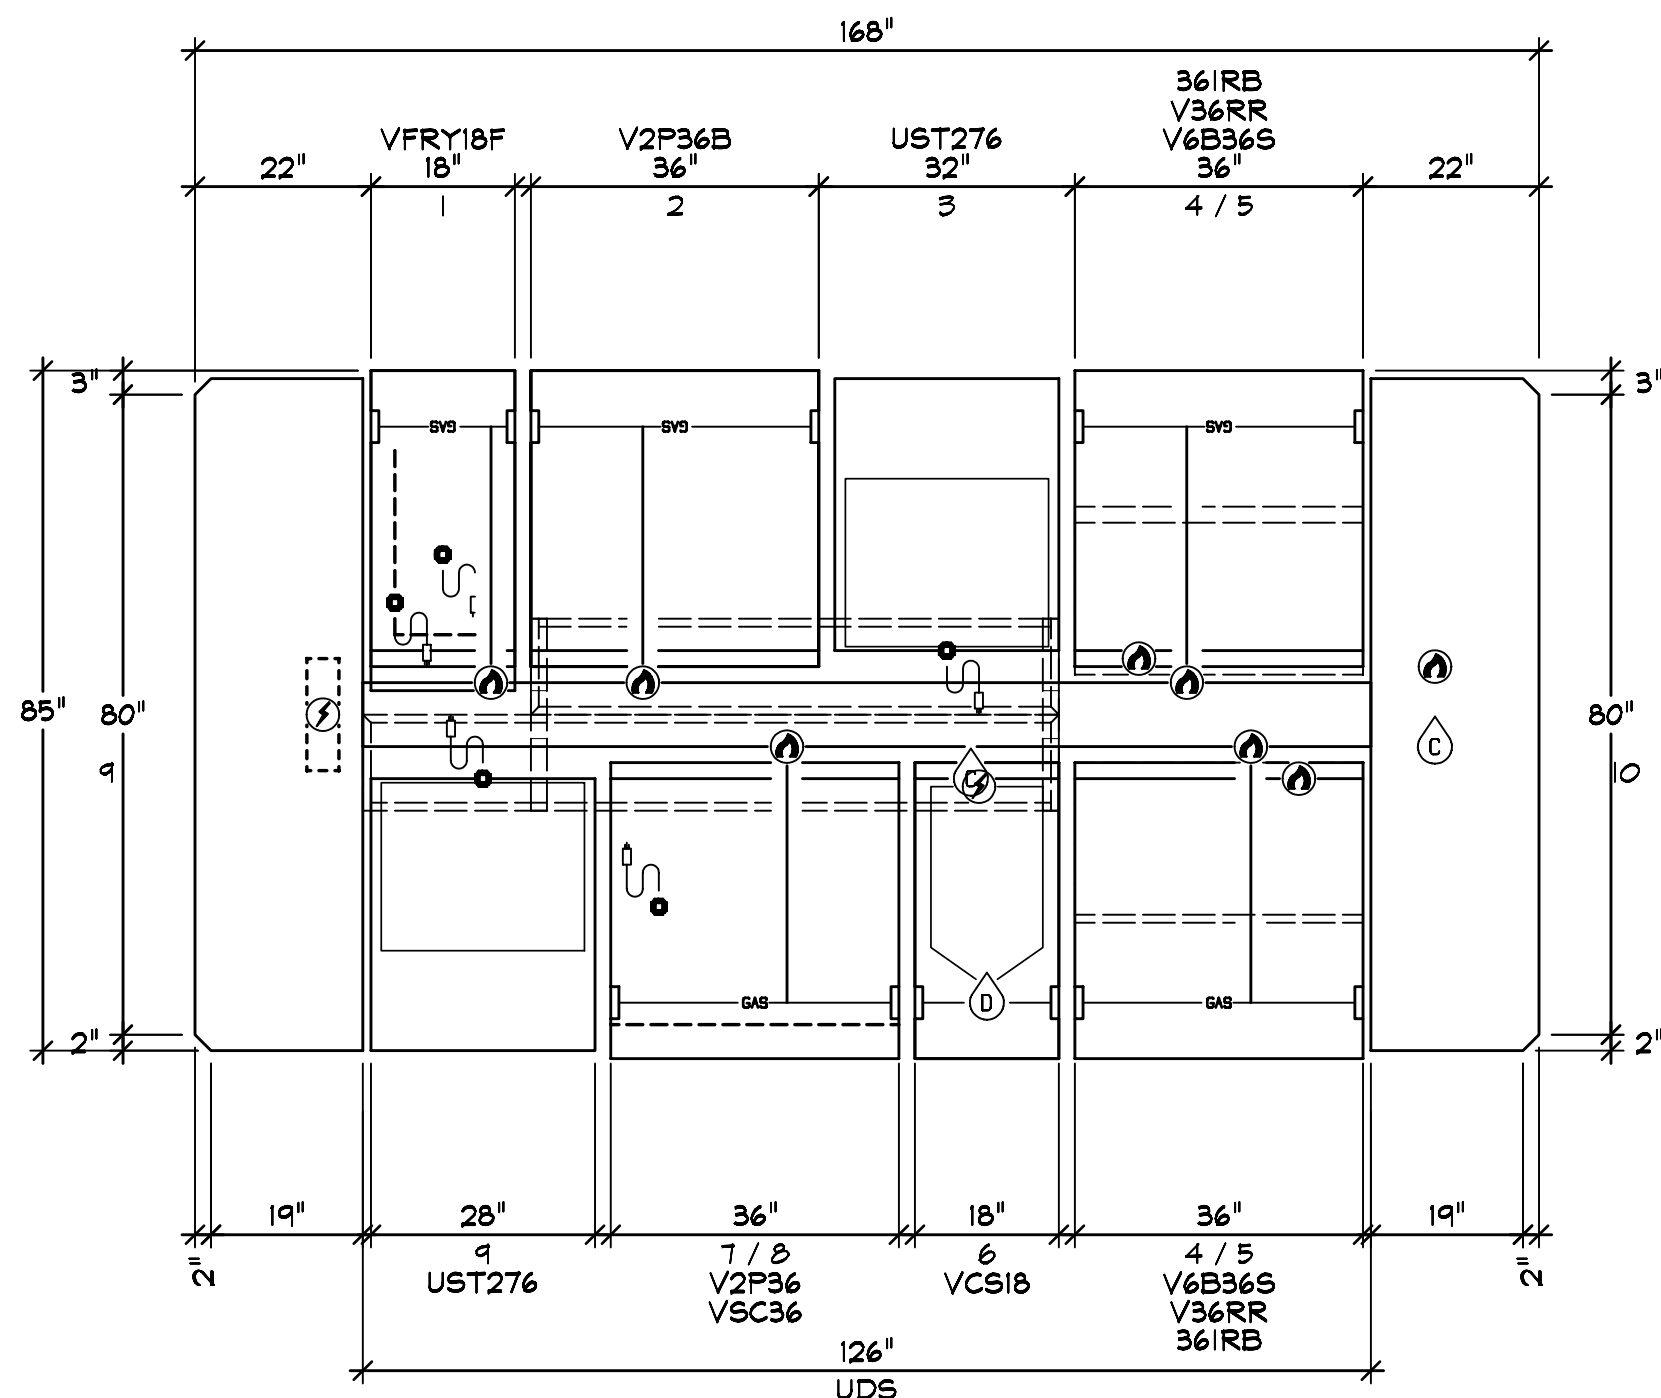
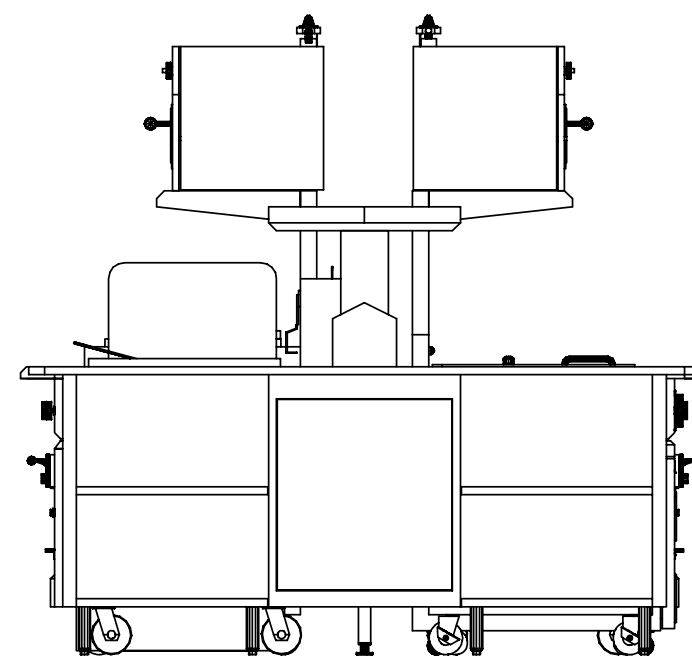
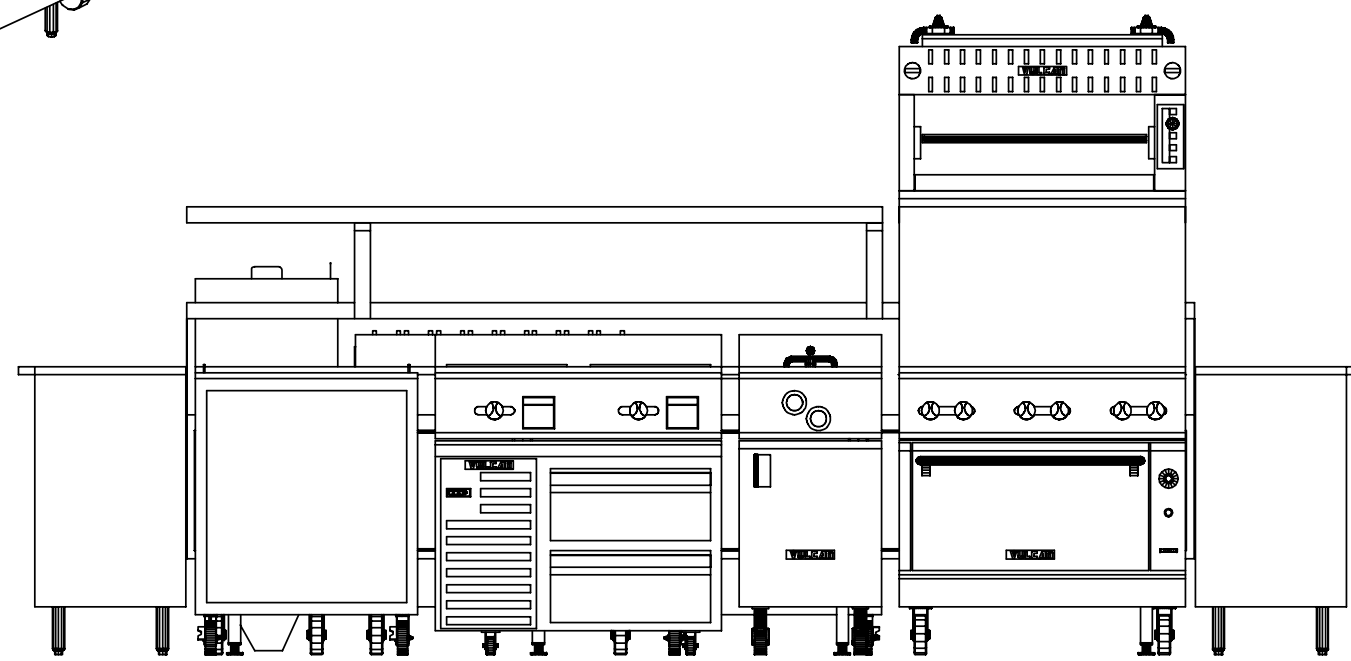
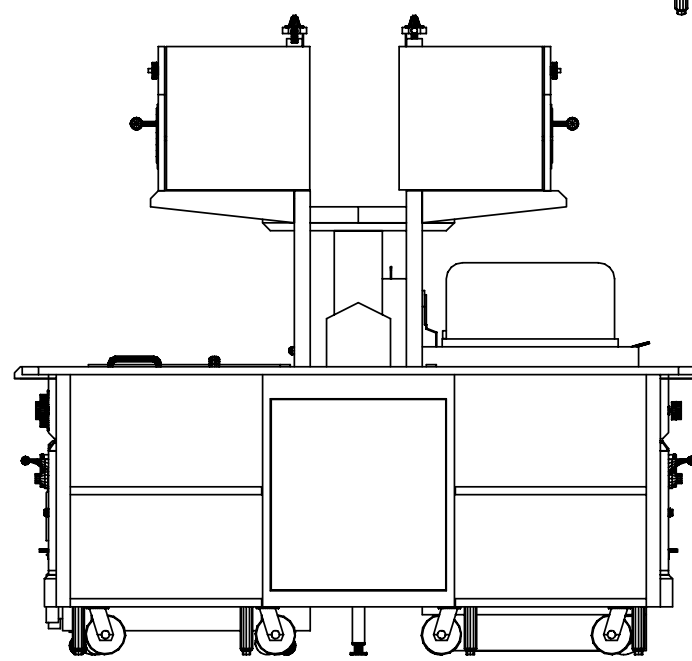
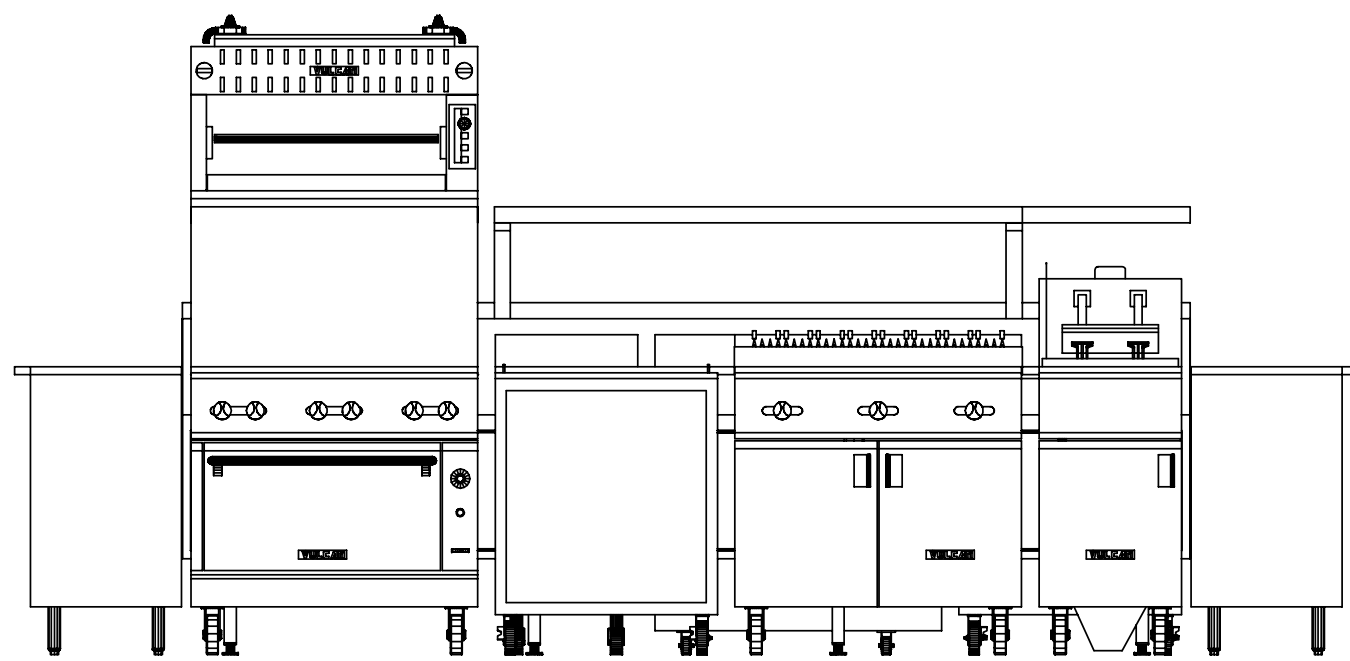
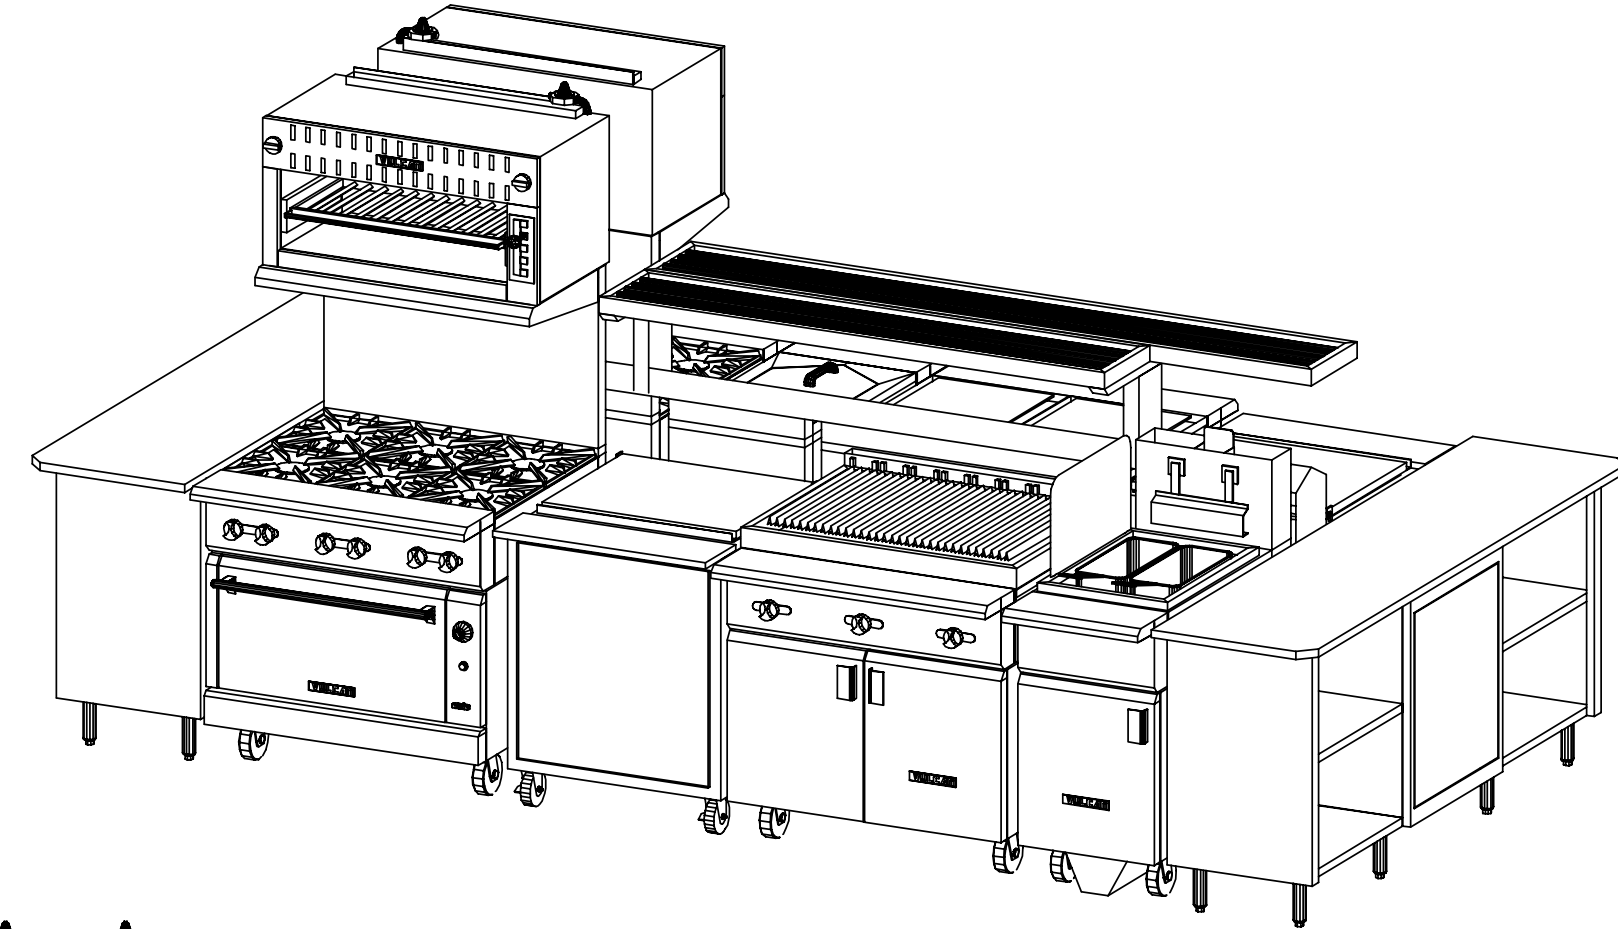
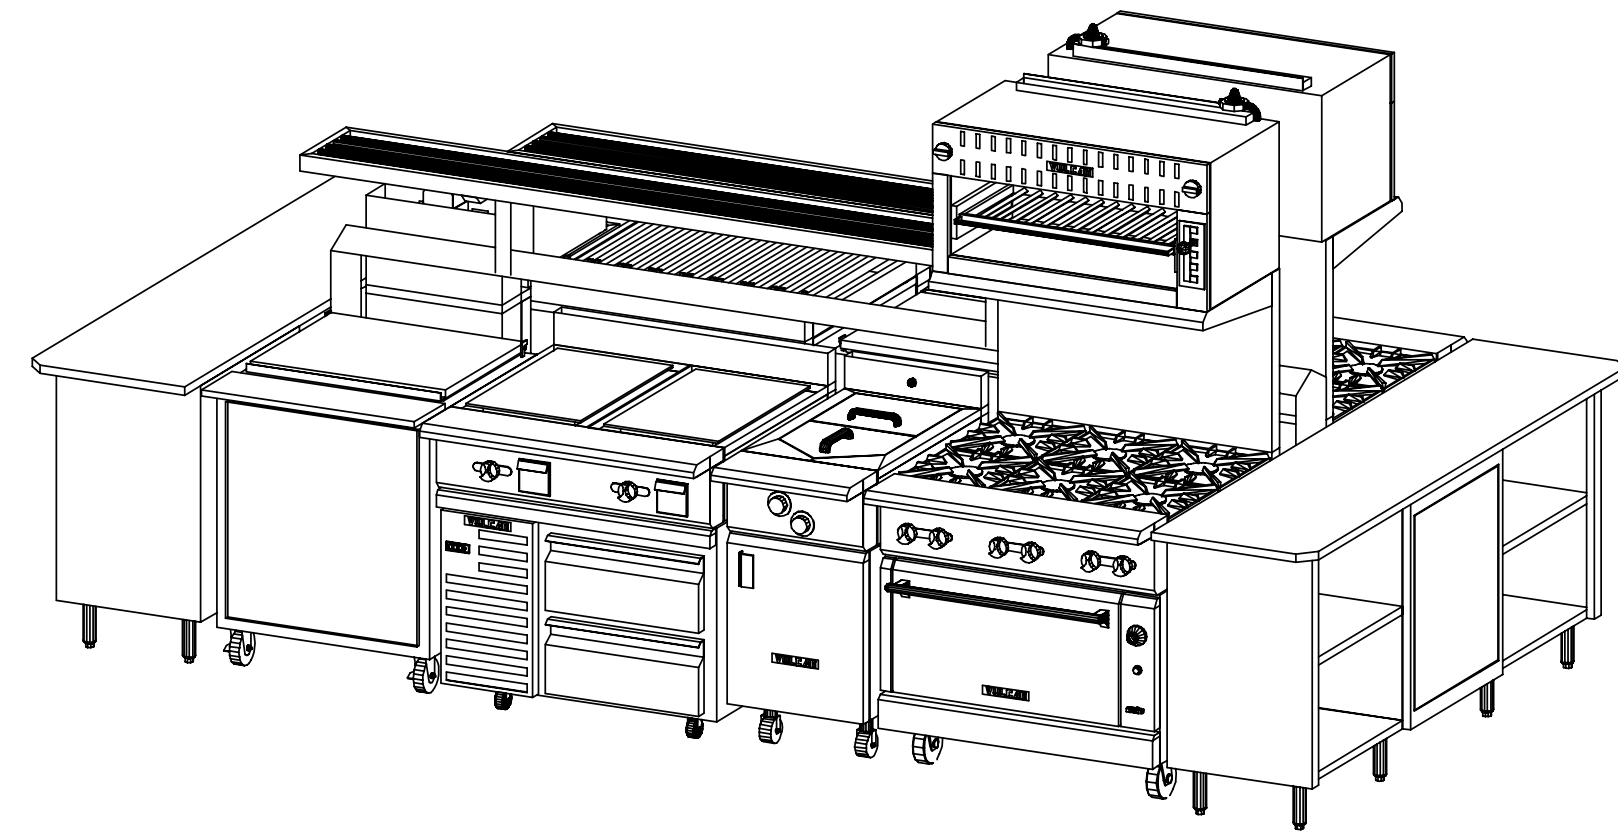
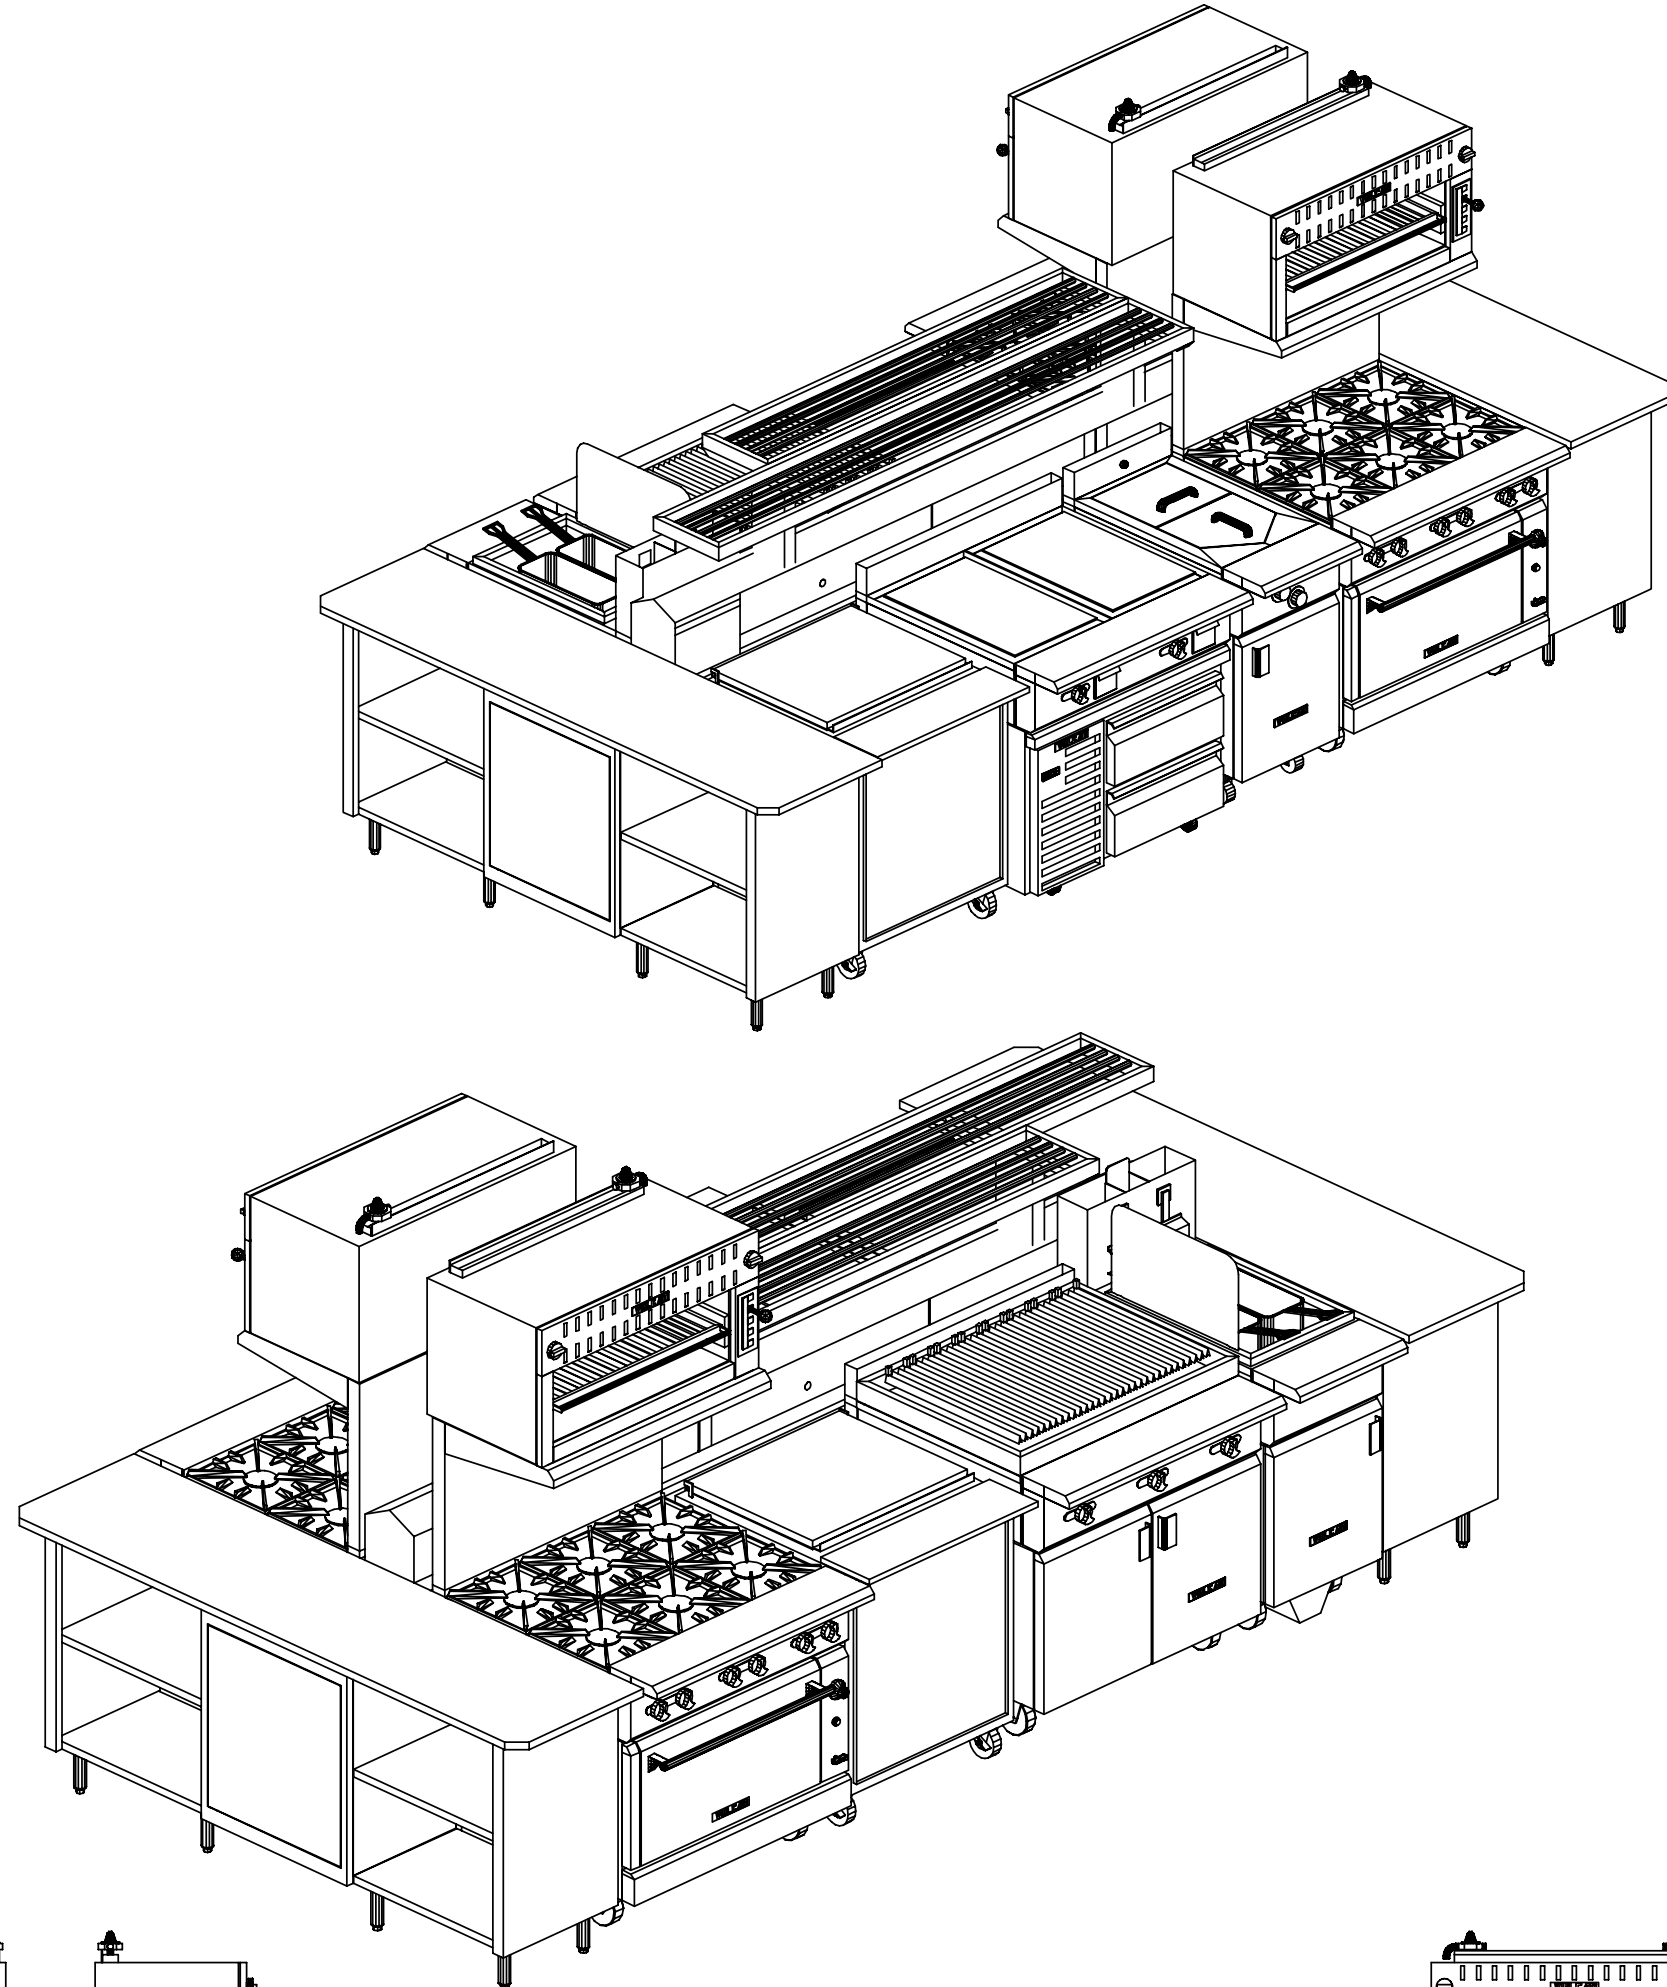


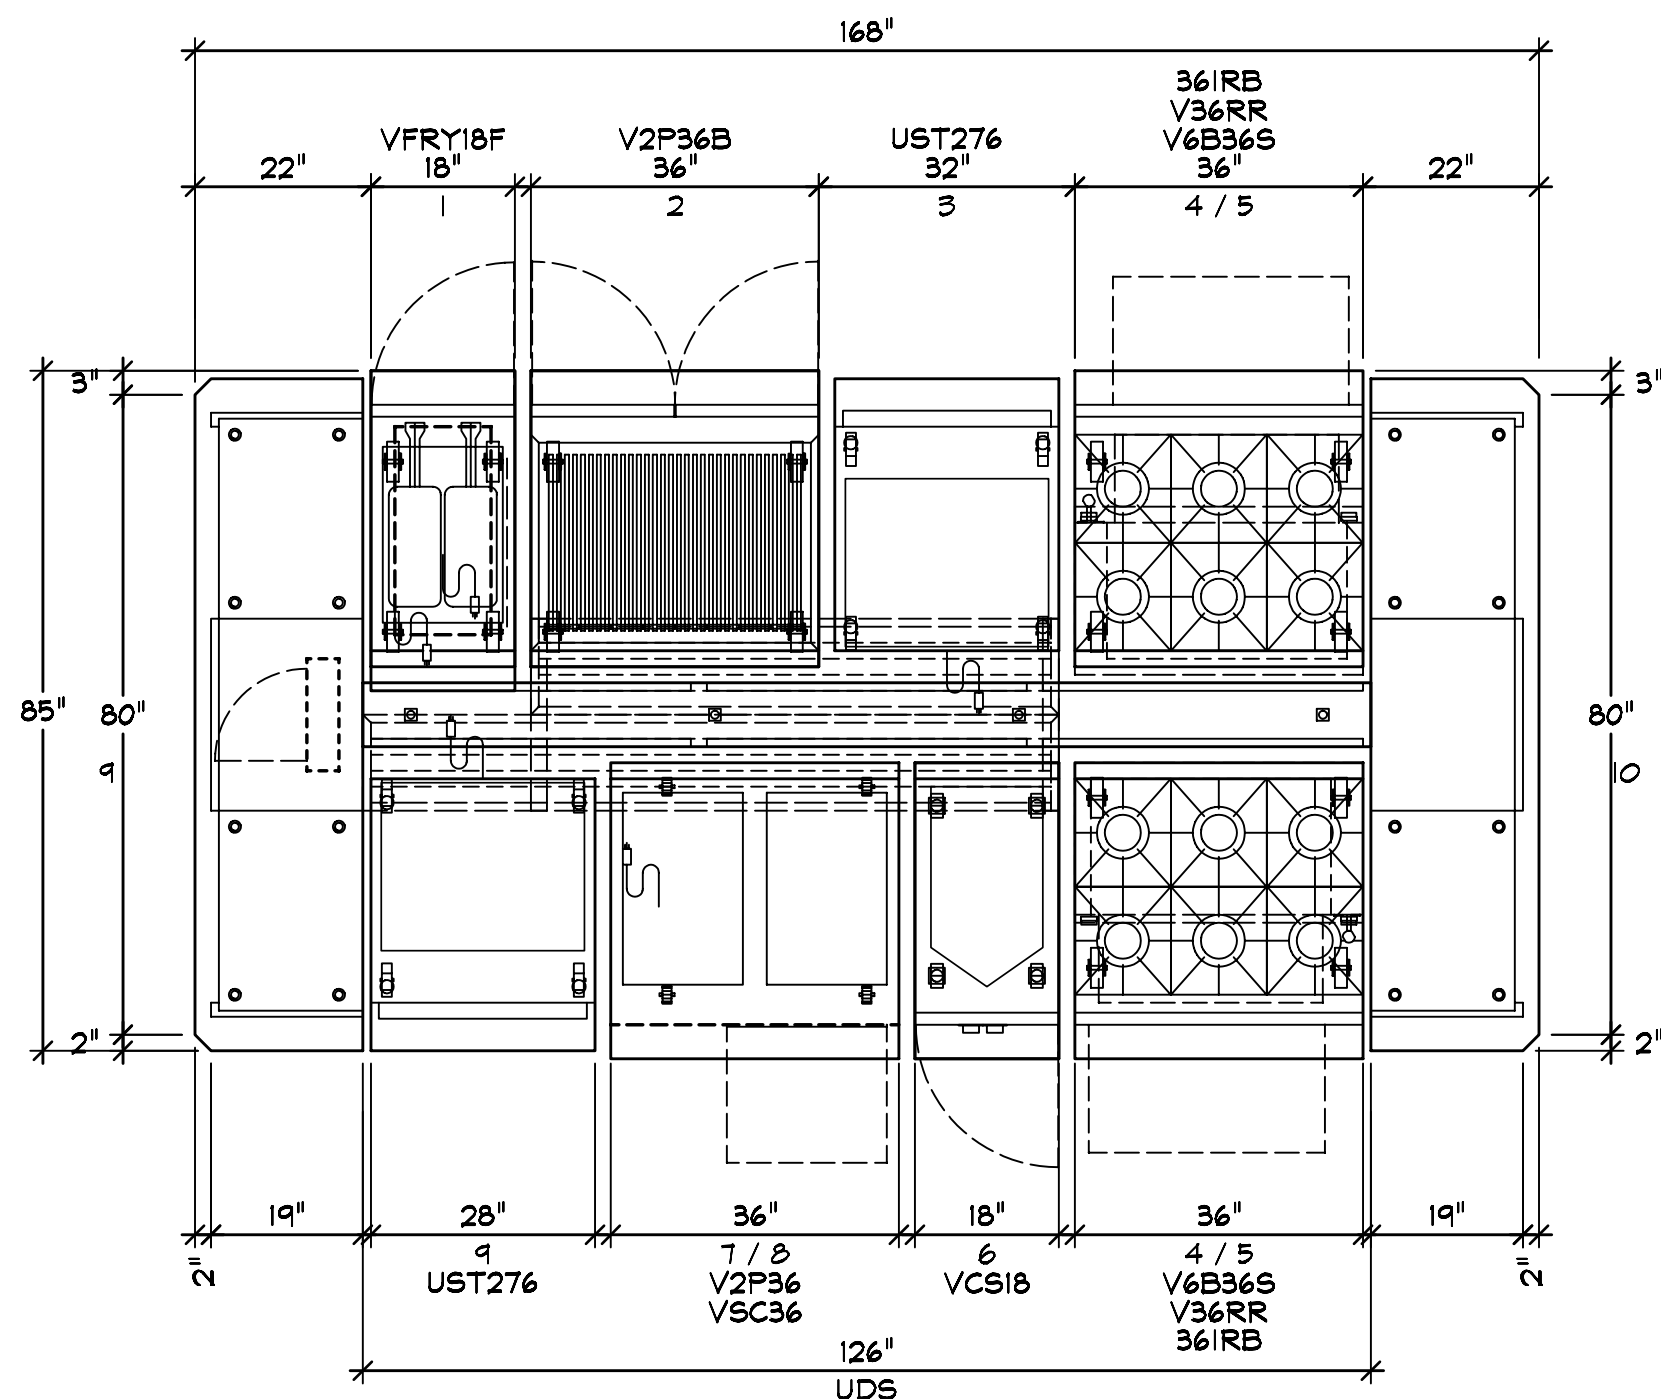

GAS CONNECTION #1:
LOCATED IN ITEM: 10
PIPE SIZE: 1.50
CP HEIGHT: 12
TOTAL GAS LOAD: 650
INCLUDES ITEMS: ALL
NOTE: FULL LOAD

CONNECTION #1:
LOCATED IN ITEM: 10
CONNECTION TYPE: CW
PIPE SIZE: 0.5
CP HEIGHT: 12
INCLUDES ITEMS: 6
NOTE:

1	1 EA	VFRY18F	FRYER		
	120 (1)	6.0A	5-15		FILTER
	70	MBTU	0.75	12	AFF
2	1 EA	V2P36B	RANGE		
	35	MBTU	1.25		MANIFOLD
3	1 EA	UST276	REFRIGERATOR		
	120 (1)	4.5A	5-15		
4	2 EA	V6B36S	RANGE		
	260	MBTU	1.25	32	
99	2 EA	36IRB	SALAMANDER		
	30	MBTU	0.75	78	
6	1 EA	VCS18	CHEF STATION		
	208 (3)	25.0A	12	AFF	
	CW	0.50	12	AFF	
	1W	1.00	12	AFF	
7	1 EA	V2P36	PLANCHA		
	35	MBTU	0.75	32	AFF
8	1 EA	VSC36	REFRIG BASE		
	120 (1)	6.7A	5-15		
9	1 EA	ENDCAB	END CABINET		CUSTOM
	120/208 (3)	40.0A	12	AFF	LOAD CENTER
10	1 EA	ENDCABGP	END CABINET		CUSTOM
	650	MBTU	1.50	12	AFF
	CW	0.50	12	AFF	ITEM 6

GENERAL NOTES - PLEASE READ

VENTILATION:
ALL COOKING EQUIPMENT MUST BE VENTILATED BY AN APPROVED APPLIANCE IN ACCORDANCE WITH ALL APPLICABLE CODES.

FIRE SUPPRESSION:
ALL COOKING EQUIPMENT MUST BE PROTECTED BY AN APPROVED FIRE SUPPRESSION SYSTEM IN ACCORDANCE WITH ALL APPLICABLE CODES.

CONNECTIONS:
ALL PIPING, FITTINGS, AND INTERCONNECTION SERVICES SHOWN ARE TO BE SUPPLIED AND INSTALLED BY LICENSED CONTRACTORS IN ACCORDANCE WITH ALL LOCAL CODES.

GAS CONNECTIONS:
EXTERNAL GAS REGULATORS, FLEXIBLE GAS LINES AND RESTRAINING CABLES PROVIDED WITH THE EQUIPMENT MUST BE INSTALLED BY LICENSED CONTRACTORS IN ACCORDANCE WITH ALL LOCAL CODES. INCOMING GAS MANIFOLD SUPPLY PRESSURE MUST NOT EXCEED 0.5 PSI (4" W.C.)

BY OTHERS:
VERIFY ALL EQUIPMENT LISTED AS BY OTHERS FOR SIZE AND MECHANICAL SERVICE REQUIREMENTS.

NOTE:
IN LINE WITH THE POLICY TO CONTINUALLY IMPROVE ITS PRODUCTS, THE MANUFACTURER RESERVE THE RIGHT TO CHANGE MATERIALS AND SPECIFICATIONS WITHOUT NOTICE.

CONNECTION POINT
COLD WATER
HOT WATER
HOT + COLD WATER
DRAIN
POWER
SWITCH
CORD SET
CONV. OUTLET RECP
DUPLEX RECEPTACLE
SINGLE RECEPTACLE
GAS
STEAM SUPPLY
STEAM RETURN
STEAM TAKE OFF
EXHAUST VENT
SUPPLY VENT
REFRIGERATION

Equipment	Line1Amp	Line2Amp	Line3Amp
LOAD CENTER 120/208	31.7	34.0	31.7
Total Amps	34	31.0	31.7

REVISIONS	By	SCHEDULES
Revision	ddb	4 VIEWS
No.	07	5
Date	7/15/2020	08/22/2022