


72	1 EA	VWT12B	SPREADER	
Ⓐ	0 MBTU	1.25	32 AFF	
76	1 EA	V6B36S	RANGE	
Ⓐ	260 MBTU	1.25	MANIFOLD	
	1 EA	36IRB	SALAMANDER	WALL MOUNT
Ⓐ	30 MBTU	0.75		
78	1 EA	ARS36	REFRIGERATED BASE	
Ⓐ	120 (1)	6.7A	5-15	
79	1 EA	VCB836	CHRAIROILER	
Ⓐ	99 MBTU	1.25	32 AFF	
80	1 EA	V6B36S	RANGE	
Ⓐ	260 MBTU	1.25	32 AFF	
82	1 EA	ARS36	REFRIGERATED BASE	
Ⓐ	120 (1)	6.7A	5-15	
82	1 EA	VGMT36	GRIDDLE	
Ⓐ	90 MBTU	1.25	32 AFF	
88	1 EA	36IRB	SALAMANDER	WALL MOUNT
Ⓐ	30 MBTU	0.75		

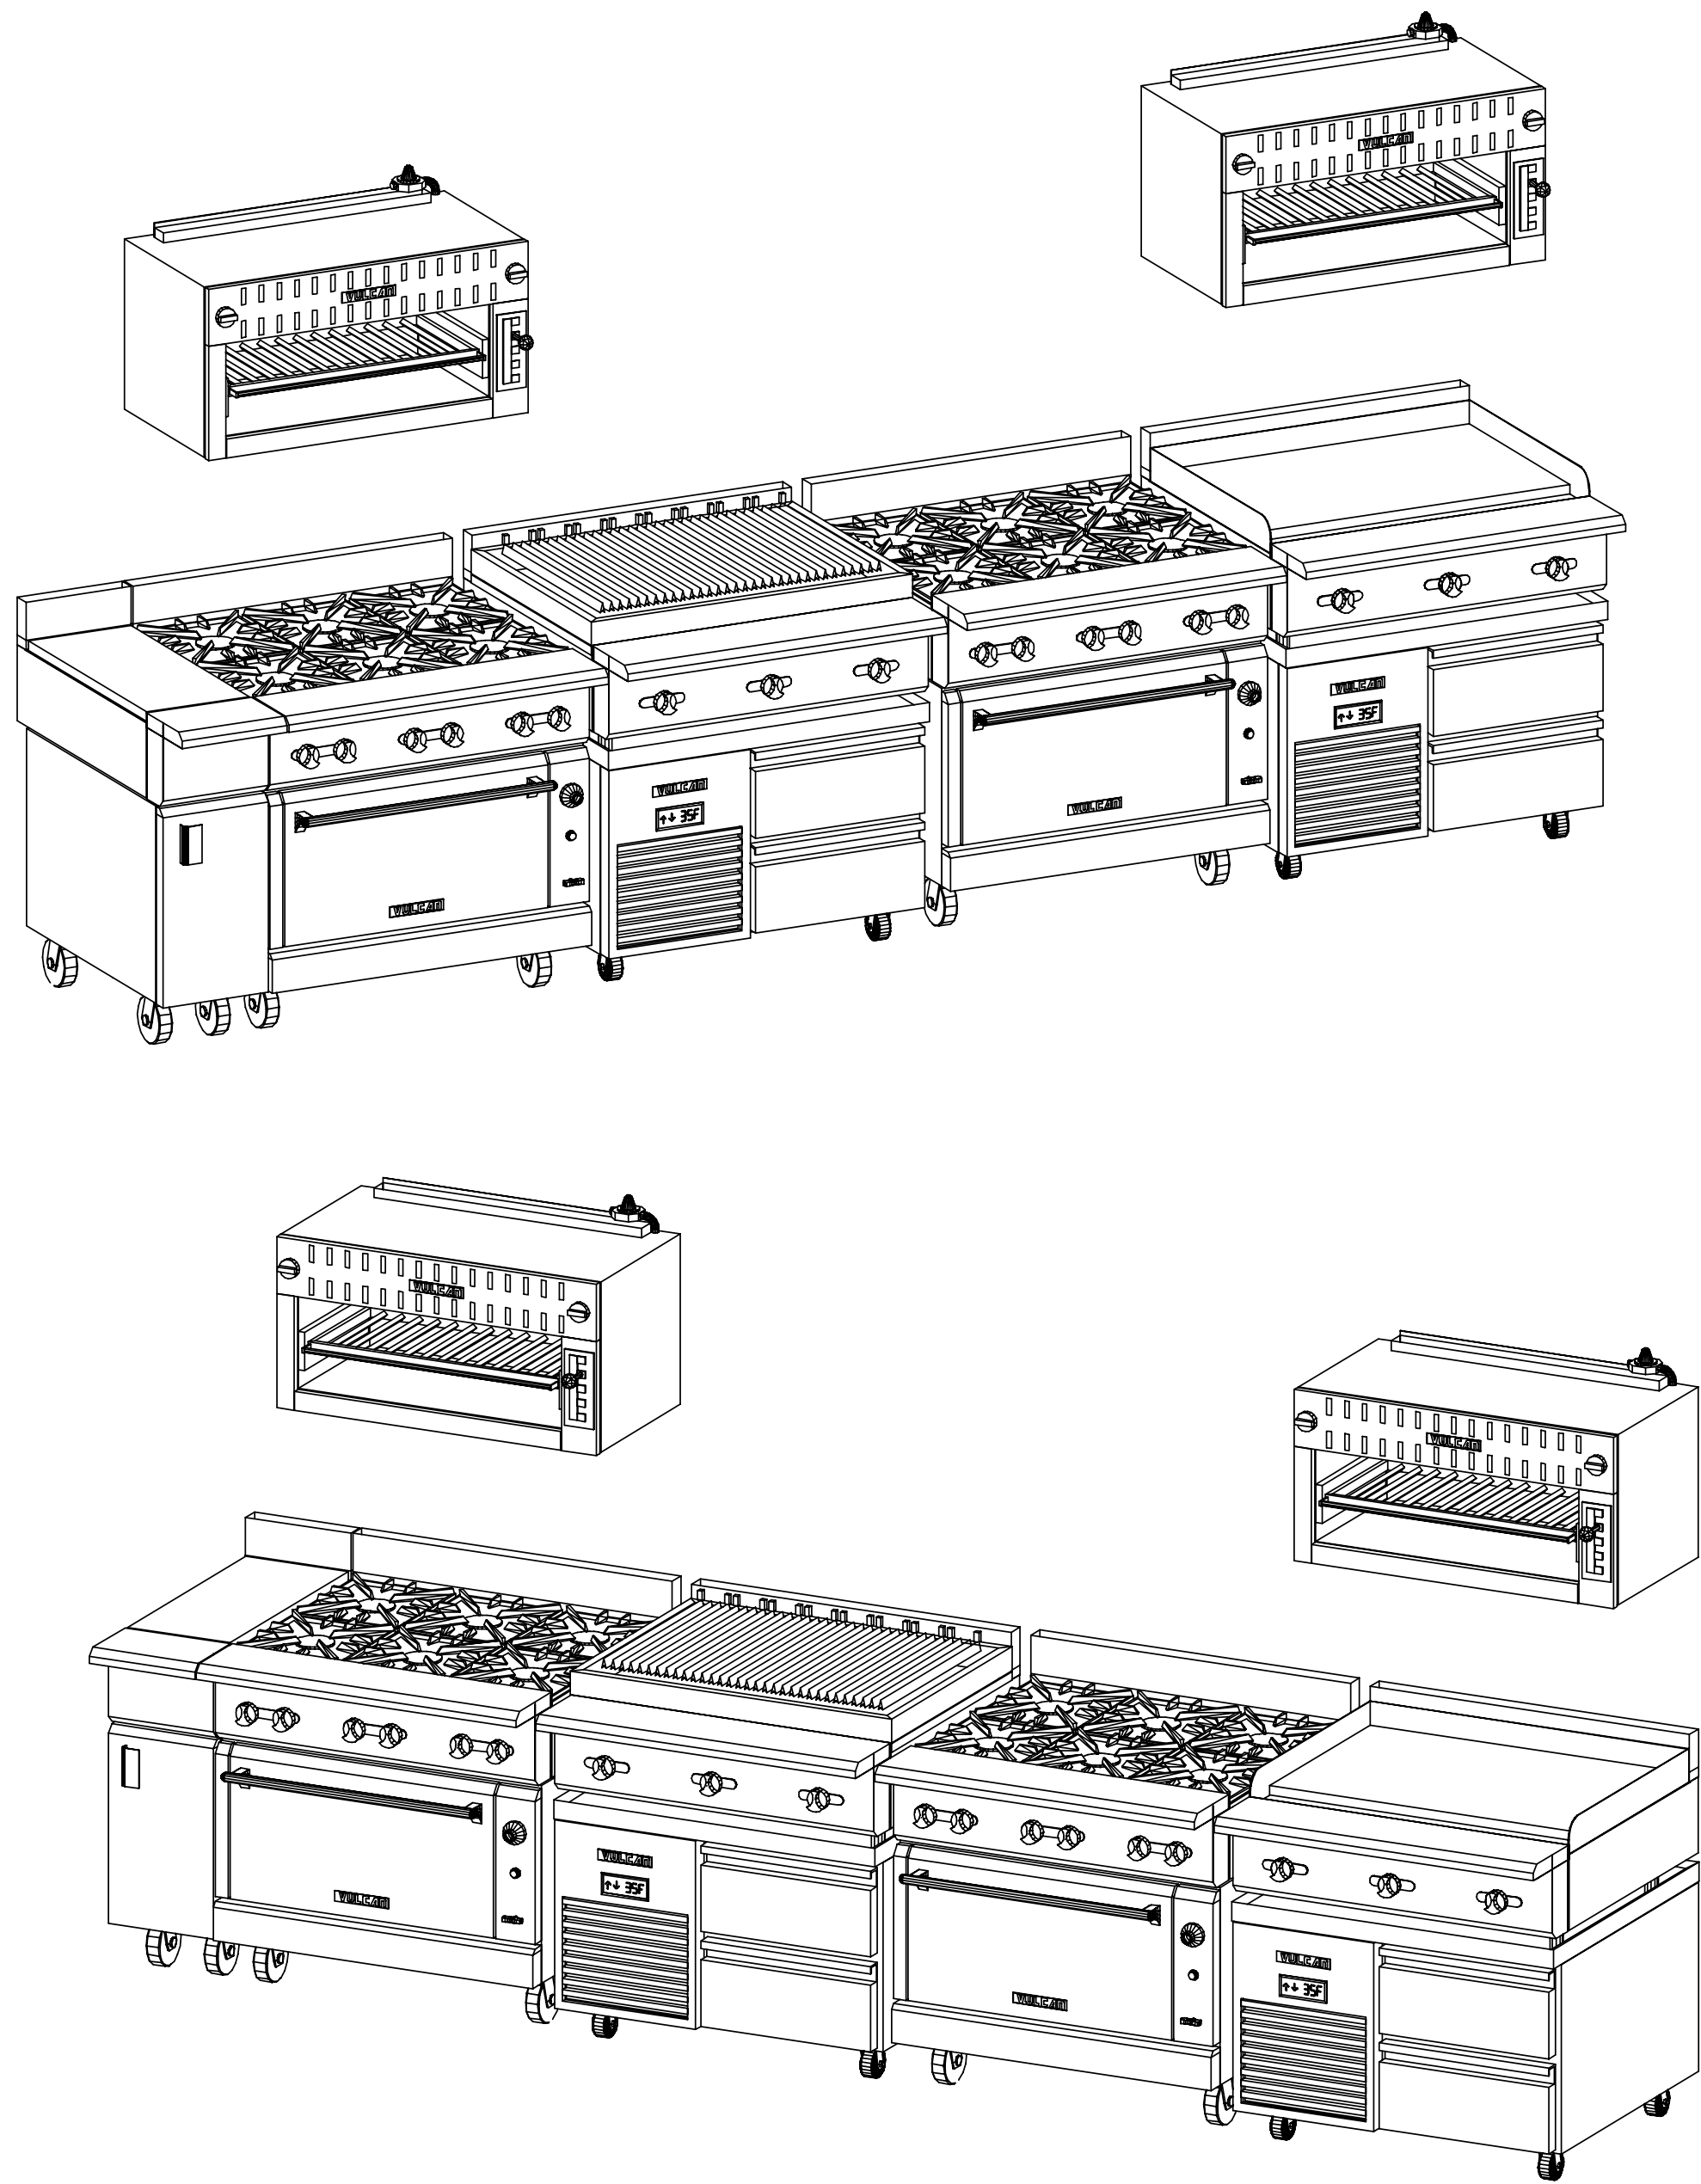

GENERAL NOTES - PLEASE READ

VENTILATION:
ALL COOKING EQUIPMENT MUST BE VENTILATED BY AN APPROVED APPLIANCE IN ACCORDANCE WITH ALL APPLICABLE CODES.

FIRE SUPPRESSION:
ALL COOKING EQUIPMENT MUST BE PROTECTED BY AN APPROVED FIRE SUPPRESSION SYSTEM IN ACCORDANCE WITH ALL APPLICABLE CODES.

CONNECTIONS:
ALL PIPING, FITTINGS, AND INTERCONNECTION SERVICES SHOWN ARE TO BE SUPPLIED AND INSTALLED BY LICENSED CONTRACTORS IN ACCORDANCE WITH ALL LOCAL CODES.

GAS CONNECTIONS:
EXTERNAL GAS REGULATORS, FLEXIBLE GAS LINES AND RESTRAINING CABLES PROVIDED WITH THE EQUIPMENT MUST BE INSTALLED BY LICENSED CONTRACTORS IN ACCORDANCE WITH ALL LOCAL CODES. INCOMING GAS MANIFOLD SUPPLY PRESSURE MUST NOT EXCEED 0.5 PSI (4" W.C.)

BY OTHERS:
VERIFY ALL EQUIPMENT LISTED AS BY OTHERS FOR SIZE AND MECHANICAL SERVICE REQUIREMENTS.

NOTE:
IN LINE WITH THE POLICY TO CONTINUALLY IMPROVE ITS PRODUCTS, THE MANUFACTURES RESERVE THE RIGHT TO CHANGE MATERIALS AND SPECIFICATIONS WITHOUT NOTICE.

09-13-2022
09-14-2022

Ⓐ	CONNECTION POINT
Ⓐ	COLD WATER
Ⓐ	FILTERED WATER
Ⓐ	HOT WATER
Ⓐ	HOT + COLD WATER
Ⓐ	DRAIN
Ⓐ	POWER
Ⓐ	SWITCH
Ⓐ	COND OUTLET RECP
Ⓐ	DUPLEX RECP
Ⓐ	SINGLE RECP
Ⓐ	GAS
Ⓐ	STEAM SUPPLY
Ⓐ	STEAM RETURN
Ⓐ	EXHAUST VENT
Ⓐ	SUPPLY VENT
Ⓐ	REFRIGERATION

PROJECT CODE
RXRT2

VULCAN
THE VULCAN HART COMPANY
BALTIMORE, MARYLAND
410-284-0660

RXR 5X Times Square
Line 2

REVISIONS		Revision
No.	Date	By
02	06/13/2022	ddb
04	06/14/2022	ddb

NEXT STEP DESIGN
913 A West Street
Annapolis, MD 21401
410-263-1200

SCALE:
AS NOTED
DATE: 09/13/2022
DRAWN BY: DDB
VH-RXRT2

1
OF 1