
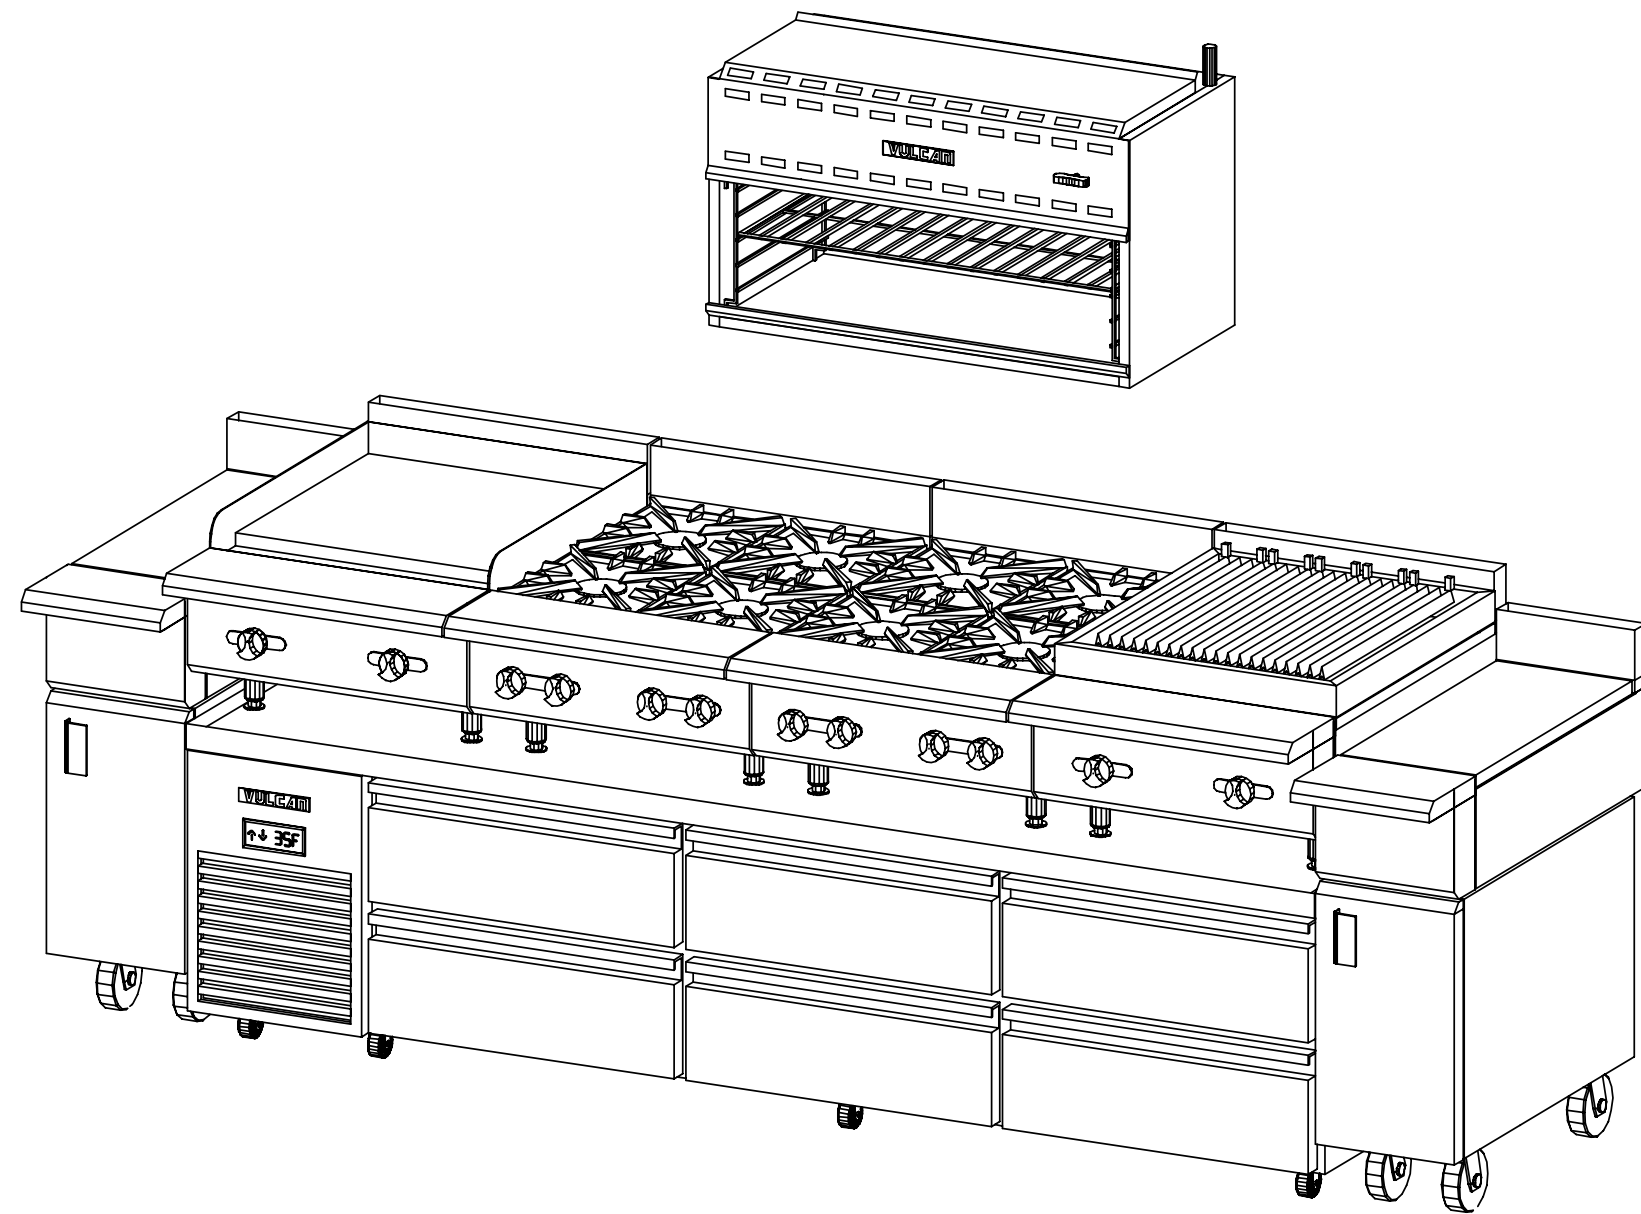


16	1 EA	VWT12B	SPREADER
17	1 EA	ARS96	REFRIGERATED STAND
18	1 EA	VG24	RANGE
19	1 EA	V4B24	RANGE
20	1 EA	V4B24	RANGE
21	1 EA	CHEESE METLER	WALL MOUNT
22	1 EA	VCBB24	CHARBOILER
25	1 EA	VWT12B	SPREADER

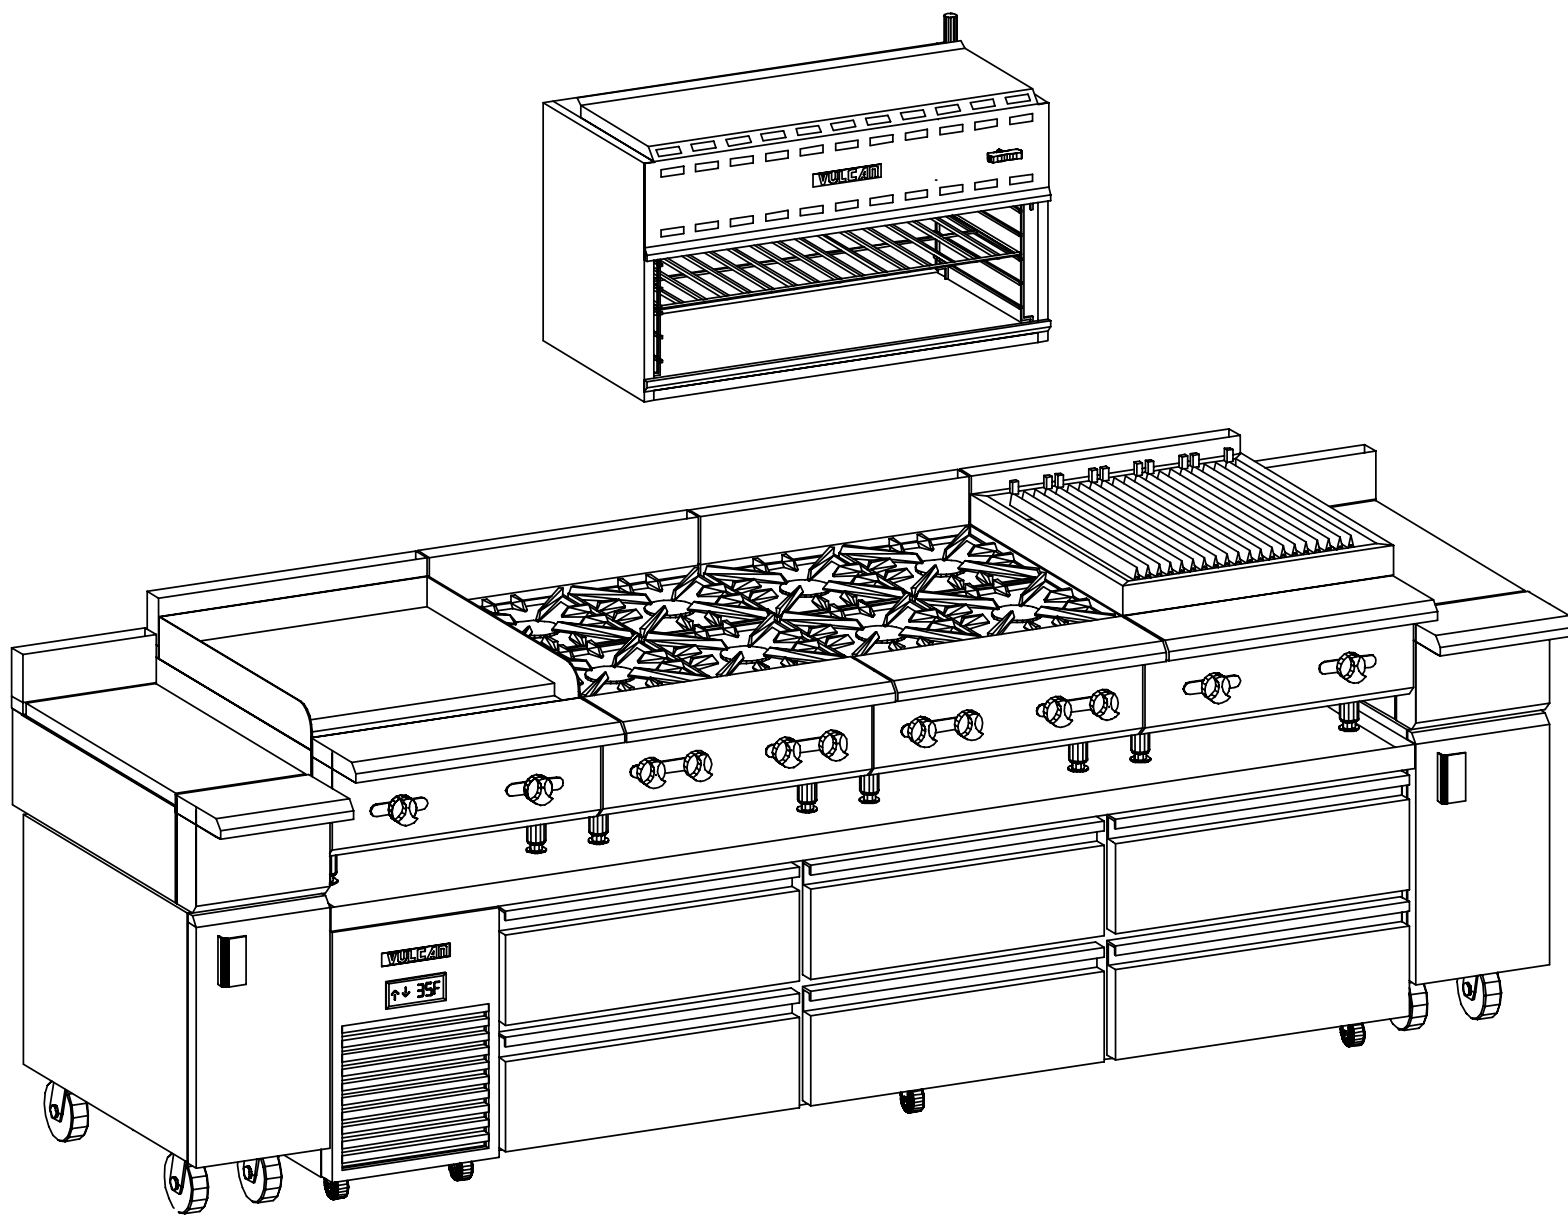

GENERAL NOTES - PLEASE READ

VENTILATION:
ALL COOKING EQUIPMENT MUST BE VENTILATED BY AN APPROVED APPLIANCE IN ACCORDANCE WITH ALL APPLICABLE CODES.

FIRE SUPPRESSION:
ALL COOKING EQUIPMENT MUST BE PROTECTED BY AN APPROVED FIRE SUPPRESSION SYSTEM IN ACCORDANCE WITH ALL APPLICABLE CODES.

CONNECTIONS:
ALL PIPING, FITTINGS, AND INTERCONNECTION SERVICES SHOWN ARE TO BE SUPPLIED AND INSTALLED BY LICENSED CONTRACTORS IN ACCORDANCE WITH ALL LOCAL CODES.

GAS CONNECTIONS:
EXTERNAL GAS REGULATORS, FLEXIBLE GAS LINES AND RESTRAINING CABLES PROVIDED WITH THE EQUIPMENT MUST BE INSTALLED BY LICENSED CONTRACTORS IN ACCORDANCE WITH ALL LOCAL CODES. INCOMING GAS MANIFOLD SUPPLY PRESSURE MUST NOT EXCEED 0.5 PSI (4" W.C.)

BY OTHERS:
VERIFY ALL EQUIPMENT LISTED AS BY OTHERS FOR SIZE AND MECHANICAL SERVICE REQUIREMENTS.

NOTE:
IN LINE WITH THE POLICY TO CONTINUALLY IMPROVE ITS PRODUCTS, THE MANUFACTURERS RESERVE THE RIGHT TO CHANGE MATERIALS AND SPECIFICATIONS WITHOUT NOTICE.

●	CONNECTION POINT
○	COLD WATER
○	HOT WATER
○	HOT + COLD WATER
○	DRAIN
○	POWER
○	SWITCH
○	CORD SET
○	CONV. OUTLET RECP
○	DUPLEX RECP
○	SINGLE RECP
○	GAS
○	STEAM SUPPLY
○	STEAM RETURN
○	STEAM TAKE OFF
○	EXHAUST VENT
○	SUPPLY VENT
○	REFRIGERATION

08-26-2022

PROJECT CODE
TBE01

VULCAN
THE VULCAN HART COMPANY
BALTIMORE, MARYLAND
410-284-0660

TREASURE BEACH
RECEPTION LOBBY
16 -> 25

REVISIONS	
No.	By
	ddb

NEXT STEP DESIGN
913 A West Street
Annapolis, MD 21401
410-263-1200

SCALE:
AS NOTED
DATE:
DRAWN BY: DDB
VH-TBE01

1
OF 1