
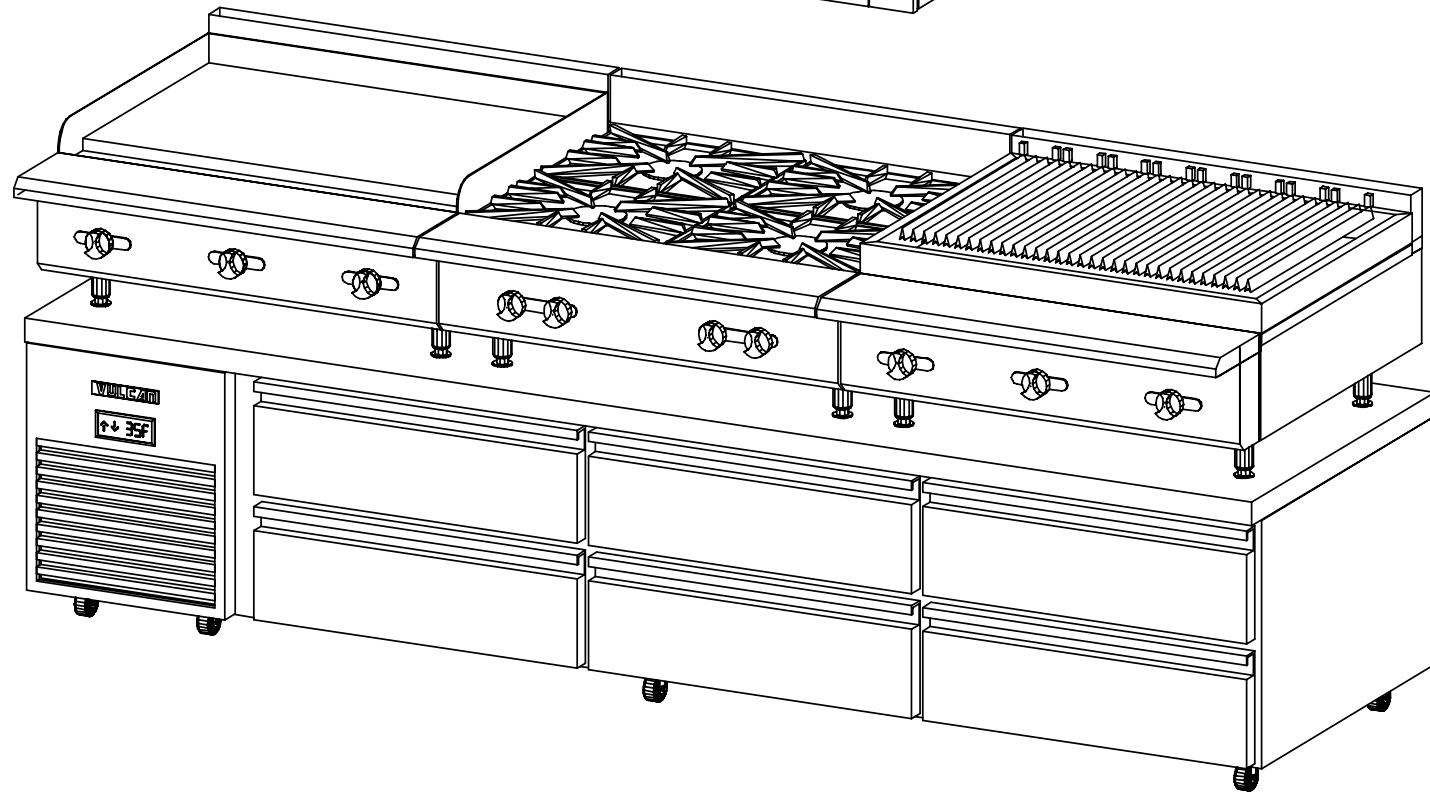
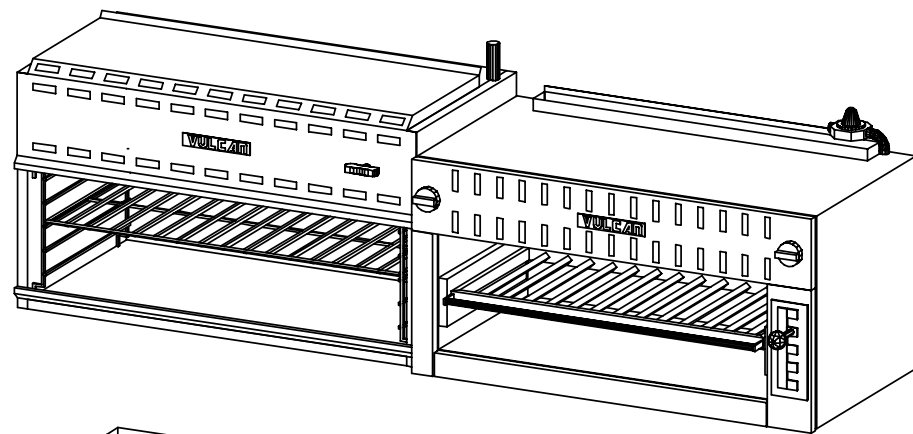


60	1 EA	ARS110	REFRIGERATED STAND
120	(1)	12.0A	5-15
61	1 EA	VGMT36	GRIDDLE
90	MBTU	1.25	32 AFF
9	1 EA	VICM 36	CHEESE MELTER WALL MOUNT
30	MBTU	0.75	78 AFF
65	1 EA	V4836	RANGE
140	MBTU	1.25	32 AFF
66	1 EA	36IRB	SALAMANDER WALL MOUNT
30	MBTU	0.75	78 AFF
67	1 EA	VC8B36	CHRAIROILER
99	MBTU	1.25	32 AFF

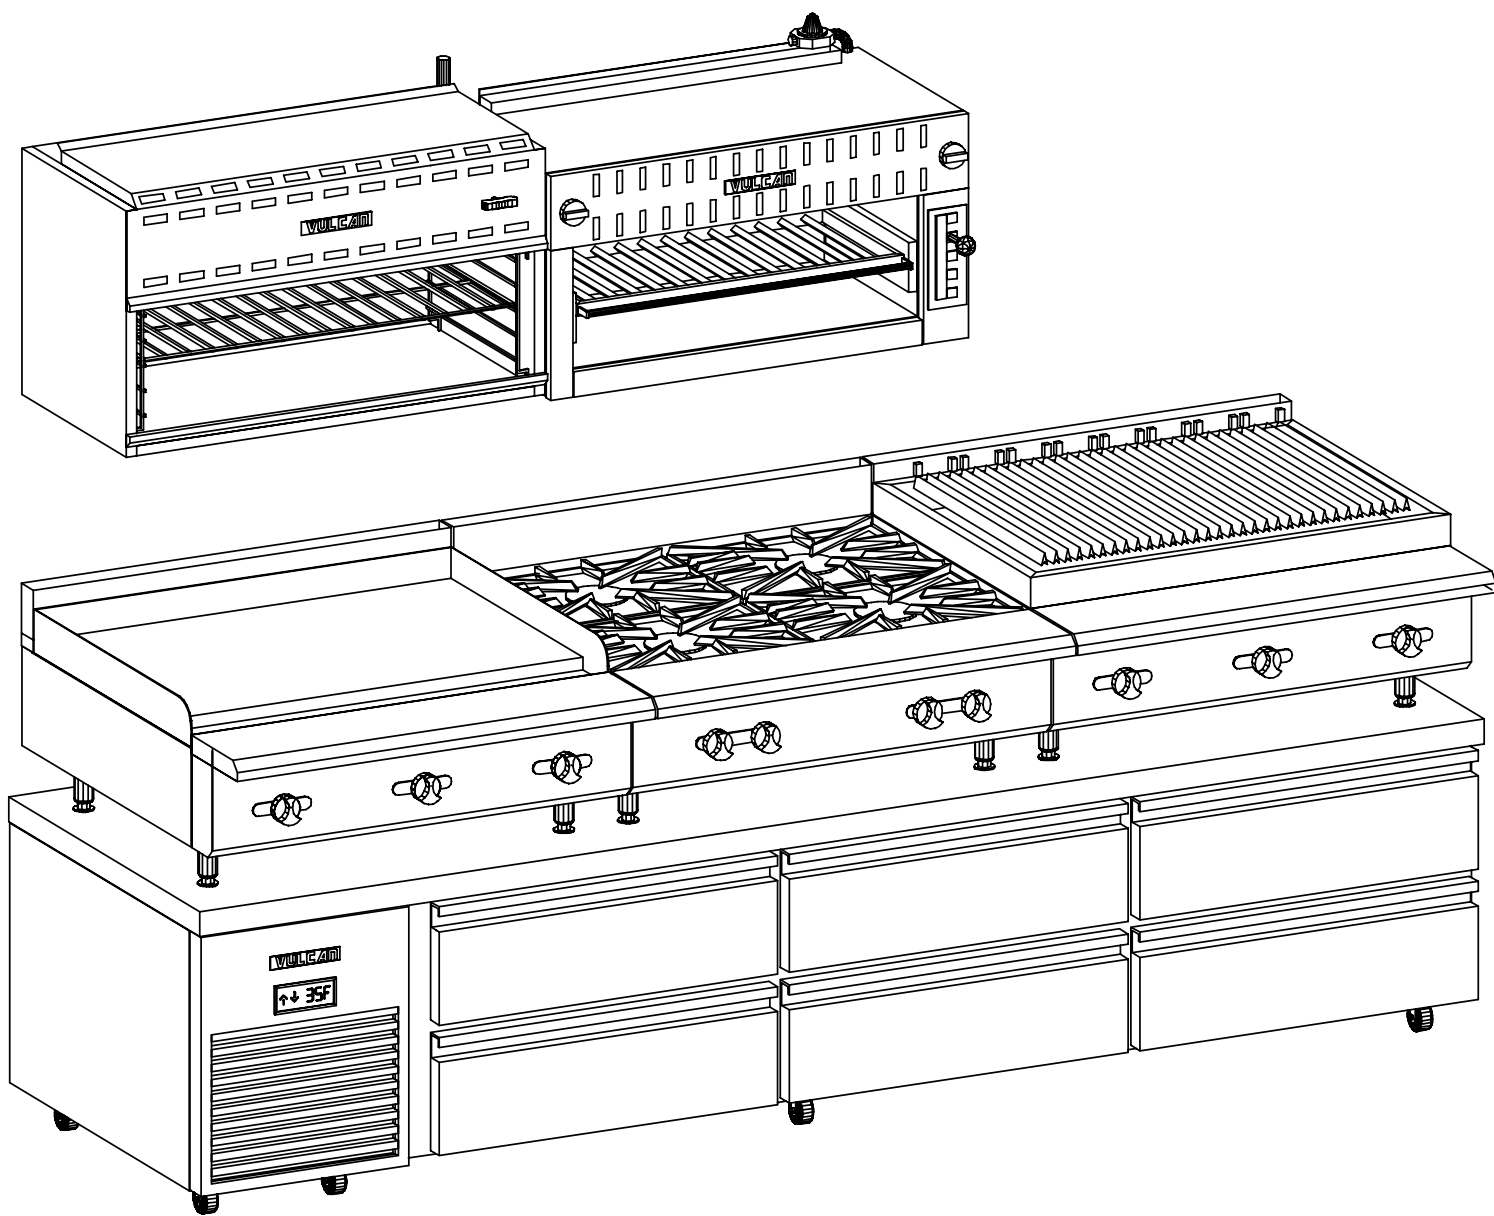

#### GENERAL NOTES - PLEASE READ

VENTILATION:  
ALL COOKING EQUIPMENT MUST BE VENTILATED BY AN APPROVED APPLIANCE IN ACCORDANCE WITH ALL APPLICABLE CODES.

FIRE SUPPRESSION:  
ALL COOKING EQUIPMENT MUST BE PROTECTED BY AN APPROVED FIRE SUPPRESSION SYSTEM IN ACCORDANCE WITH ALL APPLICABLE CODES.

CONNECTIONS:  
ALL PIPING, FITTINGS, AND INTERCONNECTION SERVICES SHOWN ARE TO BE SUPPLIED AND INSTALLED BY LICENSED CONTRACTORS IN ACCORDANCE WITH ALL LOCAL CODES.

GAS CONNECTIONS:  
EXTERNAL GAS REGULATORS, FLEXIBLE GAS LINES AND RESTRAINING CABLES PROVIDED WITH THE EQUIPMENT MUST BE INSTALLED BY LICENSED CONTRACTORS IN ACCORDANCE WITH ALL LOCAL CODES. INCOMING GAS MANIFOLD SUPPLY PRESSURE MUST NOT EXCEED 0.5 PSI (4" W.C.)

BY OTHERS:  
VERIFY ALL EQUIPMENT LISTED AS BY OTHERS FOR SIZE AND MECHANICAL SERVICE REQUIREMENTS.

NOTE:  
IN LINE WITH THE POLICY TO CONTINUALLY IMPROVE ITS PRODUCTS, THE MANUFACTURERS RESERVE THE RIGHT TO CHANGE MATERIALS AND SPECIFICATIONS WITHOUT NOTICE.

●	CONNECTION POINT
○	COLD WATER
△	HOT WATER
⊕	HOT + COLD WATER
○	DRAIN
⚡	POWER
⚡	SWITCH
⚡	CORD SET
⚡	CONV. OUTLET RECP
⚡	DUPLEX RECP
⚡	SINGLE RECP
⚡	GAS
⚡	STEAM SUPPLY
⚡	STEAM RETURN
⚡	STEAM TAKE OFF
⚡	EXHAUST VENT
⚡	SUPPLY VENT
⚡	REFRIGERATION

08-30-2022

PROJECT CODE  
TBE03

**VULCAN**  
THE VULCAN HART COMPANY  
BALTIMORE, MARYLAND  
410-284-0660

TREASURE BEACH  
RESTAURANT 60 -> 67

REVISIONS		Revision	
No.	Date	By	ddb

**NEXT STEP DESIGN**  
**913 A West Street**  
**Annapolis, MD 21401**  
**410-263-1200**

SCALE:  
AS NOTED  
DATE: 08-30-2022  
DRAWN BY: DDB  
VH-TBE03