
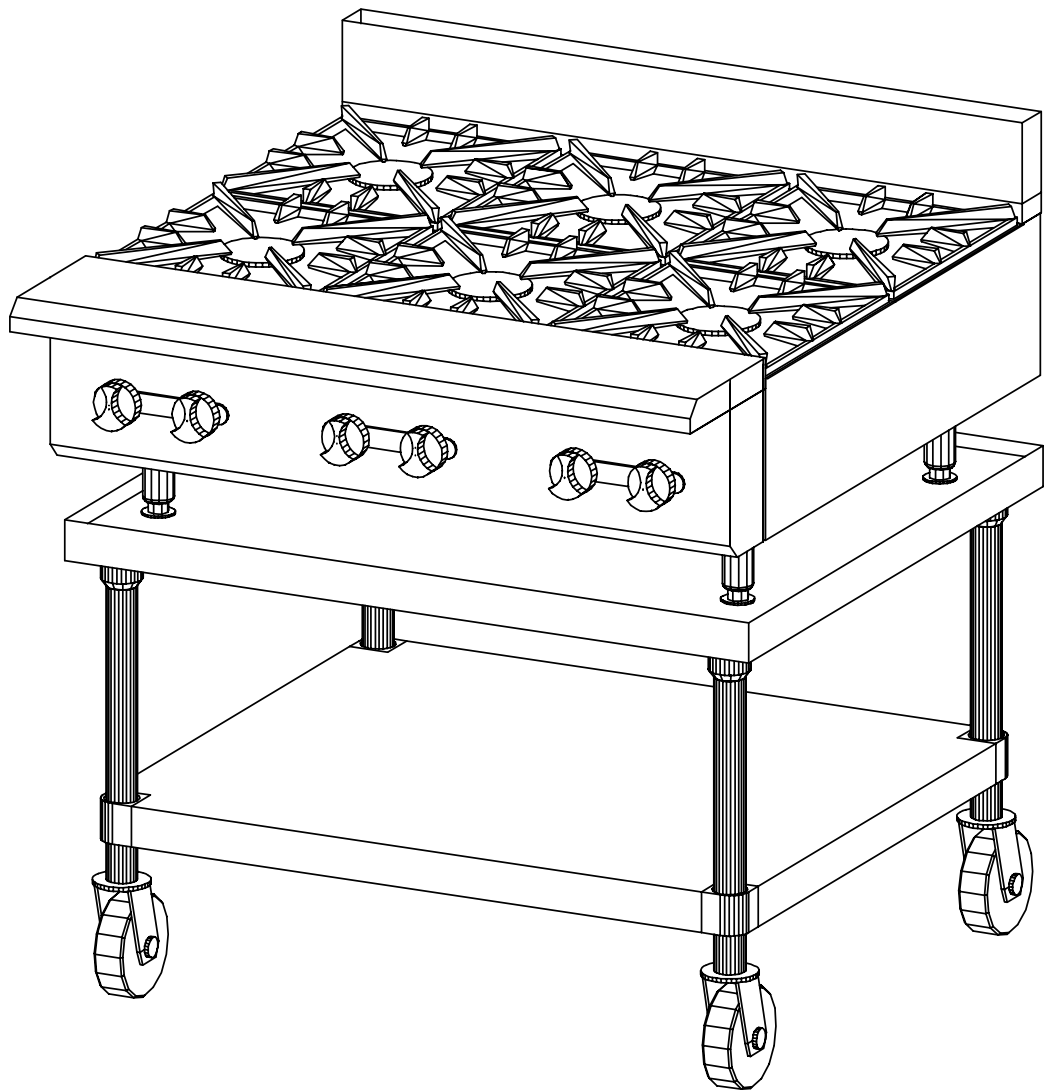


175	1 EA	STANDNEW	EQUIPMENT STAND
176	1 EA	V6B36	RANGE
210 MBTU	1.25	32 AFF	

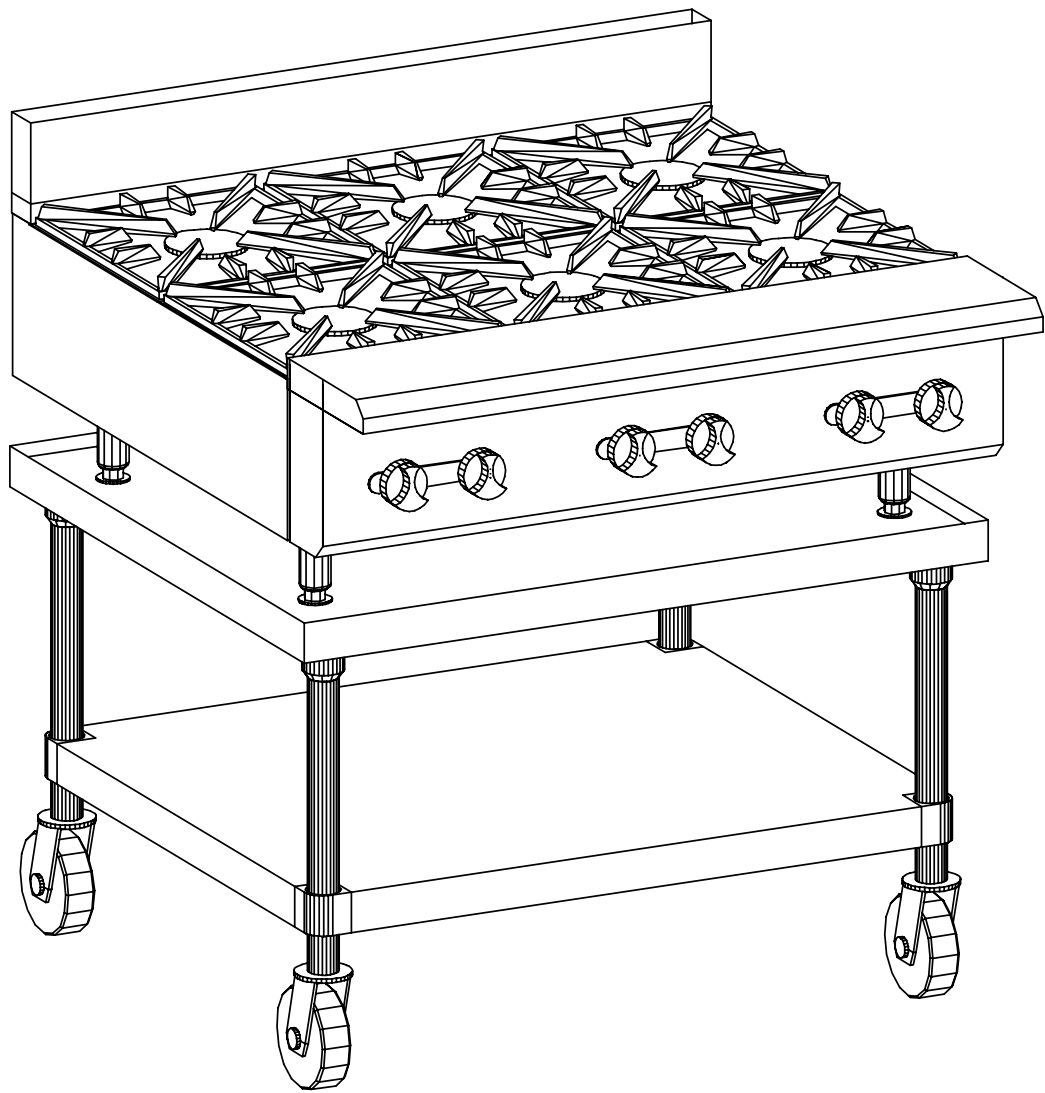

GENERAL NOTES - PLEASE READ

VENTILATION:
ALL COOKING EQUIPMENT MUST BE VENTILATED BY AN APPROVED APPLIANCE IN ACCORDANCE WITH ALL APPLICABLE CODES.

FIRE SUPPRESSION:
ALL COOKING EQUIPMENT MUST BE PROTECTED BY AN APPROVED FIRE SUPPRESSION SYSTEM IN ACCORDANCE WITH ALL APPLICABLE CODES.

CONNECTIONS:
ALL PIPING, FITTINGS, AND INTERCONNECTION SERVICES SHOWN ARE TO BE SUPPLIED AND INSTALLED BY LICENSED CONTRACTORS IN ACCORDANCE WITH ALL LOCAL CODES.

GAS CONNECTIONS:
EXTERNAL GAS REGULATORS, FLEXIBLE GAS LINES AND RESTRAINING CABLES PROVIDED WITH THE EQUIPMENT MUST BE INSTALLED BY LICENSED CONTRACTORS IN ACCORDANCE WITH ALL LOCAL CODES. INCOMING GAS MANIFOLD SUPPLY PRESSURE MUST NOT EXCEED 0.5 PSI (4" W.C.)

BY OTHERS:
VERIFY ALL EQUIPMENT LISTED AS BY OTHERS FOR SIZE AND MECHANICAL SERVICE REQUIREMENTS.

NOTE:
IN LINE WITH THE POLICY TO CONTINUALLY IMPROVE ITS PRODUCTS, THE MANUFACTURERS RESERVE THE RIGHT TO CHANGE MATERIALS AND SPECIFICATIONS WITHOUT NOTICE.

CONNECTION POINT
COLD WATER
HOT WATER
HOT + COLD WATER
DRAIN
POWER
SWITCH
CORD SET
CONV. OUTLET RECP
DUPLEX RECP/TACLE
SINGLE RECP/TACLE
GAS
STEAM SUPPLY
STEAM RETURN
STEAM TAKE OFF
EXHAUST VENT
SUPPLY VENT
REFRIGERATION

08-30-2022

PROJECT CODE
TBE04

Treasue beach
Restaurant - 165 -> 167

REVISIONS		Revision
No.	Date	By
		ddb

NEXT STEP DESIGN
913 A West Street
Annapolis, MD 21401
410-263-1200

SCALE:
As Noted
DATE: 08-30-2022
DRAWN BY: DDB
VH-TRE05